

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910294

Luminaire Tested: DFN2DIP-TR4F0-120D060US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910294
REPORT IS A COMBINATION OF REPORTS P900421 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D060US840-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17359.6 lumens
Efficiency: N/A
Efficacy: 101.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

Luminous Intensity Polar Plot

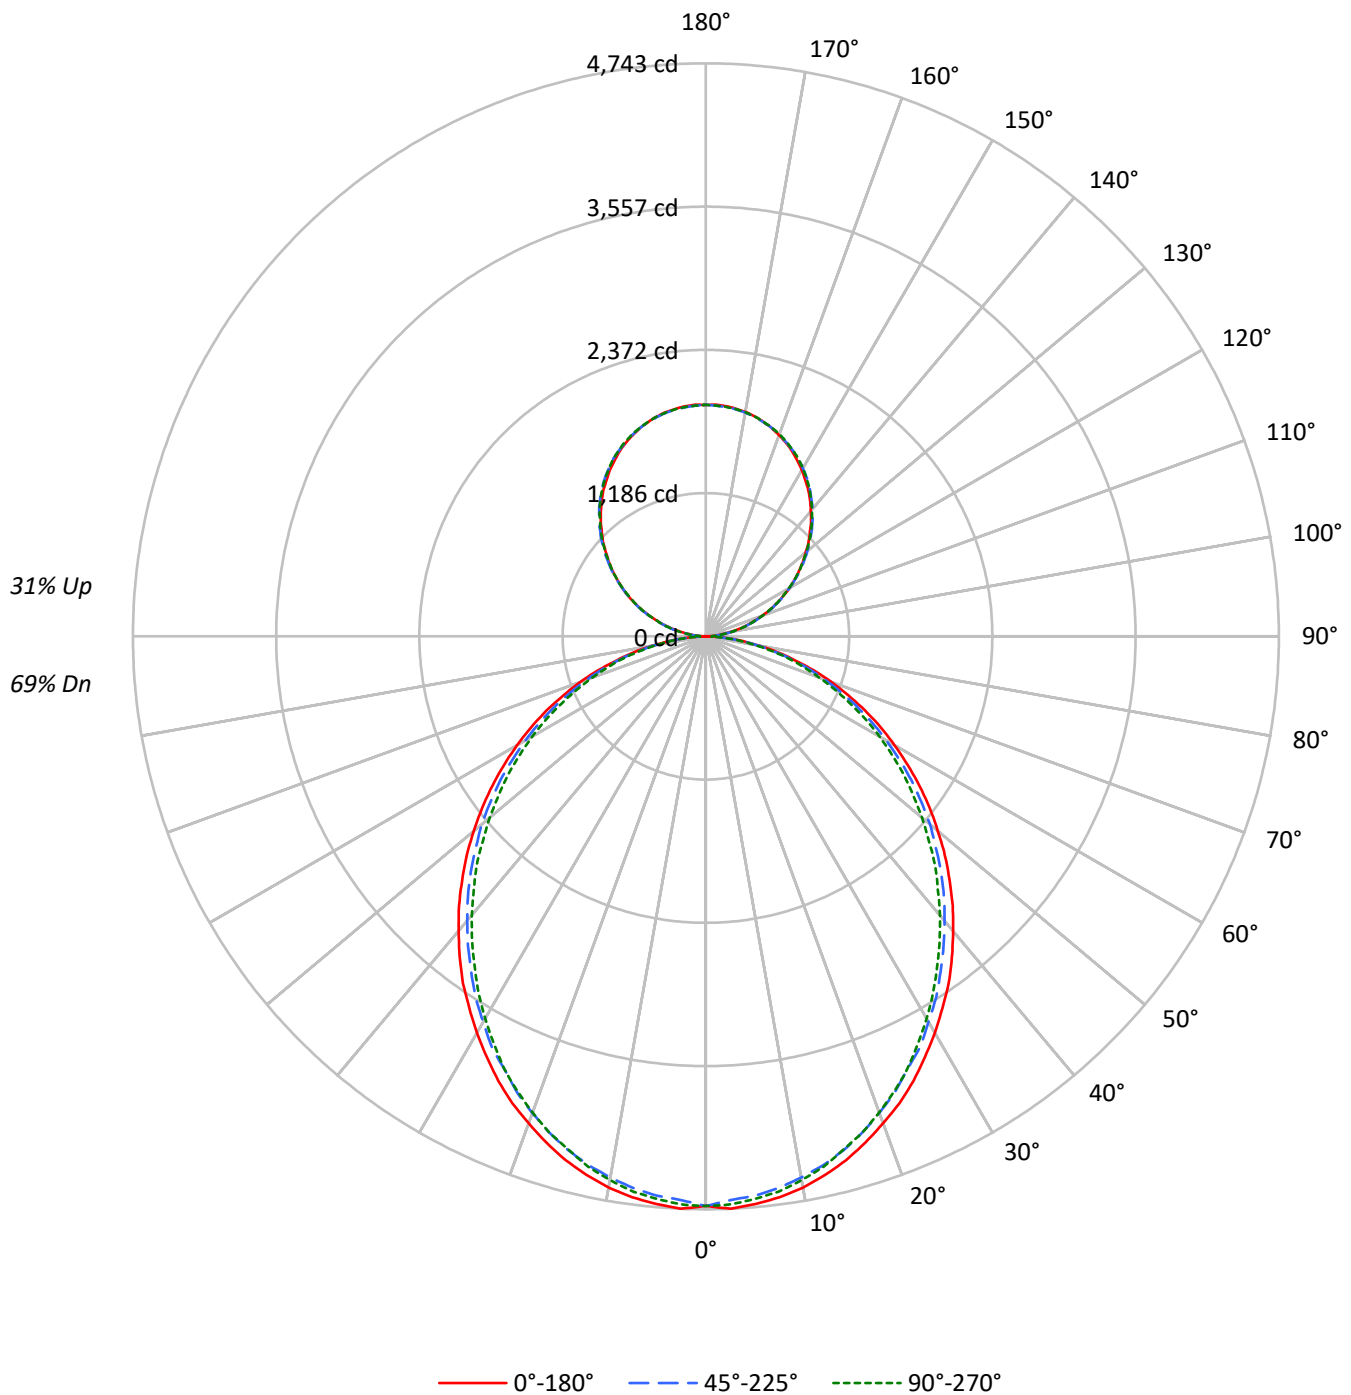

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3746	3746	3746
5°	3752	3694	3719
10°	3722	3644	3668
15°	3667	3584	3589
20°	3593	3501	3509
25°	3520	3401	3415
30°	3427	3308	3297
35°	3340	3199	3172
40°	3233	3088	3052
45°	3125	2977	2930
50°	3008	2861	2789
55°	2885	2726	2659
60°	2747	2567	2510
65°	2596	2401	2334
70°	2403	2200	2145
75°	2136	1958	1971
80°	1815	1651	1637
85°	1313	1120	1085

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3125 cd/sqm

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	443.8	2.6
10°-20°	1248.7	7.2
20°-30°	1835.1	10.6
30°-40°	2131.4	12.3
40°-50°	2128.7	12.3
50°-60°	1856.2	10.7
60°-70°	1372.1	7.9
70°-80°	776.3	4.5
80°-90°	210.3	1.2
90°-100°	118.6	0.7
100°-110°	376.8	2.2
110°-120°	644.8	3.7
120°-130°	848.0	4.9
130°-140°	951.8	5.5
140°-150°	933.4	5.4
150°-160°	783.0	4.5
160°-170°	519.2	3.0
170°-180°	181.5	1.0
0°-30°	3527.6	20.3
0°-40°	5659.0	32.6
0°-60°	9643.8	55.6
0°-90°	12002.6	69.1
90°-120°	1140.1	6.6
90°-150°	3873.3	22.3
90°-180°	5357.0	30.9
0°-180°	17359.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4715	4715	4715	4715	4715	
5°	4715	4698	4648	4684	4675	448
15°	4489	4462	4403	4421	4398	1264
25°	4062	4026	3950	3958	3950	1869
35°	3505	3460	3387	3360	3337	2189
45°	2852	2820	2752	2703	2684	2201
55°	2158	2131	2077	2022	2000	1930
65°	1456	1428	1383	1342	1320	1439
75°	762	753	730	703	712	813
85°	186	181	177	163	159	207
90°	2	21	57	53	55	17
95°	84	100	103	103	100	94
105°	348	352	356	359	359	367
115°	647	656	653	652	647	640
125°	941	956	951	946	944	841
135°	1217	1235	1239	1237	1232	941
145°	1478	1489	1499	1500	1494	923
155°	1690	1694	1700	1708	1702	778
165°	1838	1836	1836	1848	1840	519
175°	1913	1908	1905	1916	1906	182
180°	1916	1916	1916	1916	1916	

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4715.4	4715.4	4715.4	4715.4	4715.4
2.5°	4742.7	4720.1	4670.1	4715.4	4706.7
5°	4715.4	4697.5	4647.5	4683.6	4674.9
7.5°	4683.6	4656.6	4606.6	4643.2	4634.1
10°	4634.1	4602.3	4547.9	4584.0	4570.6
12.5°	4565.7	4538.7	4484.4	4507.0	4497.8
15°	4488.8	4461.8	4402.6	4420.9	4398.3
17.5°	4393.5	4366.6	4307.4	4330.0	4307.4
20°	4289.1	4262.1	4198.7	4212.1	4194.4
22.5°	4185.2	4144.3	4085.1	4085.1	4076.0
25°	4062.5	4026.4	3949.5	3958.2	3949.5
27.5°	3926.4	3894.6	3836.0	3822.4	3799.9
30°	3790.7	3754.2	3686.3	3672.9	3654.6
32.5°	3645.4	3618.6	3545.8	3518.5	3500.2
35°	3504.9	3459.8	3387.1	3359.7	3337.1
37.5°	3346.2	3305.4	3232.7	3201.0	3178.3
40°	3183.2	3146.6	3073.9	3033.5	3015.3
42.5°	3024.4	2987.9	2915.7	2870.0	2843.1
45°	2852.2	2820.5	2752.1	2702.6	2684.3
47.5°	2684.3	2652.5	2579.9	2529.9	2503.0
50°	2507.3	2484.7	2421.2	2357.6	2335.0
52.5°	2335.0	2303.3	2244.6	2194.5	2162.8
55°	2158.5	2131.1	2076.7	2022.4	1999.7
57.5°	1981.5	1958.8	1899.7	1845.3	1827.0
60°	1804.4	1786.7	1723.1	1673.1	1659.6
62.5°	1632.2	1600.4	1555.3	1510.1	1491.8
65°	1455.7	1428.3	1383.0	1342.1	1319.6
67.5°	1274.3	1251.2	1210.8	1179.1	1160.8
70°	1106.4	1088.1	1047.2	1015.5	997.7
72.5°	934.2	915.9	893.3	861.6	848.1
75°	761.5	752.9	729.7	702.9	712.0
77.5°	607.5	589.3	580.2	566.6	553.2
80°	453.6	448.8	439.7	426.3	417.1
82.5°	308.3	308.3	304.1	285.8	285.8
85°	185.7	181.4	177.0	163.1	158.8
87.5°	81.8	72.6	63.5	50.0	45.2
90°	1.7	20.8	56.7	53.1	54.8
92.5°	35.9	48.6	50.3	52.0	52.0
95°	84.3	100.5	103.4	103.4	100.5
97.5°	140.4	155.4	161.8	161.8	161.8
100°	205.1	218.3	223.0	223.0	221.3
102.5°	273.3	283.1	289.4	291.1	289.4
105°	347.8	352.4	355.9	358.8	358.8
107.5°	421.7	428.7	428.7	429.8	421.7
110°	493.4	502.6	502.6	502.6	498.0

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	570.8	580.6	578.9	574.2	570.8
115°	647.0	656.3	653.4	651.7	647.0
117.5°	722.8	735.5	727.3	722.8	718.1
120°	799.0	811.7	799.0	799.0	793.8
122.5°	868.3	884.4	876.4	871.8	868.3
125°	941.1	955.5	950.9	945.7	944.0
127.5°	1012.2	1030.1	1023.7	1016.8	1012.2
130°	1078.6	1099.4	1096.5	1093.1	1086.7
132.5°	1153.2	1169.3	1170.4	1162.4	1157.7
135°	1217.3	1235.2	1238.6	1236.9	1232.2
137.5°	1288.9	1303.3	1306.3	1305.0	1298.2
140°	1351.9	1366.3	1374.4	1374.4	1368.1
142.5°	1416.5	1431.0	1435.6	1437.3	1431.0
145°	1477.8	1489.3	1498.6	1500.4	1494.0
147.5°	1532.7	1547.1	1554.1	1556.9	1550.5
150°	1589.3	1599.1	1605.5	1610.6	1605.5
152.5°	1639.5	1649.4	1657.5	1663.9	1657.5
155°	1689.8	1694.5	1699.6	1707.8	1702.5
157.5°	1733.1	1736.7	1739.5	1751.1	1743.0
160°	1771.9	1775.3	1777.1	1786.9	1780.0
162.5°	1807.7	1807.7	1809.4	1820.4	1812.3
165°	1838.3	1836.5	1836.5	1848.2	1840.1
167.5°	1866.0	1860.9	1860.9	1872.4	1864.3
170°	1886.8	1882.2	1880.5	1892.0	1882.2
172.5°	1901.3	1896.6	1894.9	1906.4	1896.6
175°	1912.8	1908.2	1904.7	1916.3	1906.4
177.5°	1919.1	1914.6	1911.1	1920.9	1911.1
180°	1916.3	1916.3	1916.3	1916.3	1916.3

TEST NUMBER: P910294

CATALOG NUMBER: DFN2DIP-TR4F0-120D060US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.46	14.52	14.23	15.32	16.29	13.03	14.09	13.80	14.89	15.86
	3H	15.13	16.09	15.92	16.89	17.89	14.66	15.62	15.45	16.42	17.42
	4H	15.73	16.63	16.53	17.45	18.46	15.26	16.16	16.06	16.97	17.98
	6H	16.14	16.97	16.96	17.79	18.82	15.66	16.50	16.48	17.32	18.34
	8H	16.25	17.04	17.08	17.88	18.91	15.78	16.57	16.60	17.41	18.43
	12H	16.30	17.06	17.14	17.90	18.95	15.82	16.58	16.66	17.42	18.47
4H	2H	13.94	14.85	14.75	15.66	16.67	13.60	14.50	14.41	15.32	16.33
	3H	15.83	16.58	16.65	17.43	18.46	15.43	16.19	16.26	17.04	18.06
	4H	16.55	17.24	17.38	18.08	19.14	16.14	16.83	16.98	17.68	18.73
	6H	17.08	17.67	17.93	18.54	19.60	16.67	17.26	17.52	18.13	19.19
	8H	17.23	17.79	18.08	18.65	19.72	16.82	17.37	17.67	18.24	19.31
	12H	17.31	17.81	18.19	18.70	19.78	16.89	17.39	17.77	18.28	19.35
8H	4H	16.76	17.32	17.62	18.18	19.25	16.40	16.96	17.26	17.82	18.89
	6H	17.40	17.86	18.28	18.77	19.84	17.04	17.50	17.92	18.41	19.48
	8H	17.63	18.03	18.52	18.94	20.02	17.26	17.67	18.15	18.57	19.65
	12H	17.77	18.13	18.66	19.02	20.16	17.38	17.74	18.28	18.64	19.78
12H	4H	16.76	17.26	17.63	18.14	19.22	16.41	16.91	17.28	17.79	18.87
	6H	17.43	17.84	18.33	18.74	19.83	17.08	17.49	17.97	18.39	19.48
	8H	17.69	18.05	18.58	18.94	20.08	17.33	17.69	18.22	18.58	19.72

END OF REPORT