

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P982686

Luminaire Tested: S122IW-B1240UB50-4F0-XX-W2A-1

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P982686
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-8)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S122IW-B1240UB50-4F0-XX-W2A-1
Description: Define 2 Indirect Wall Mount with 5000K BioUP LEDs {m-DER=1.015} {m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4137.0 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 42.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

Luminous Intensity Polar Plot

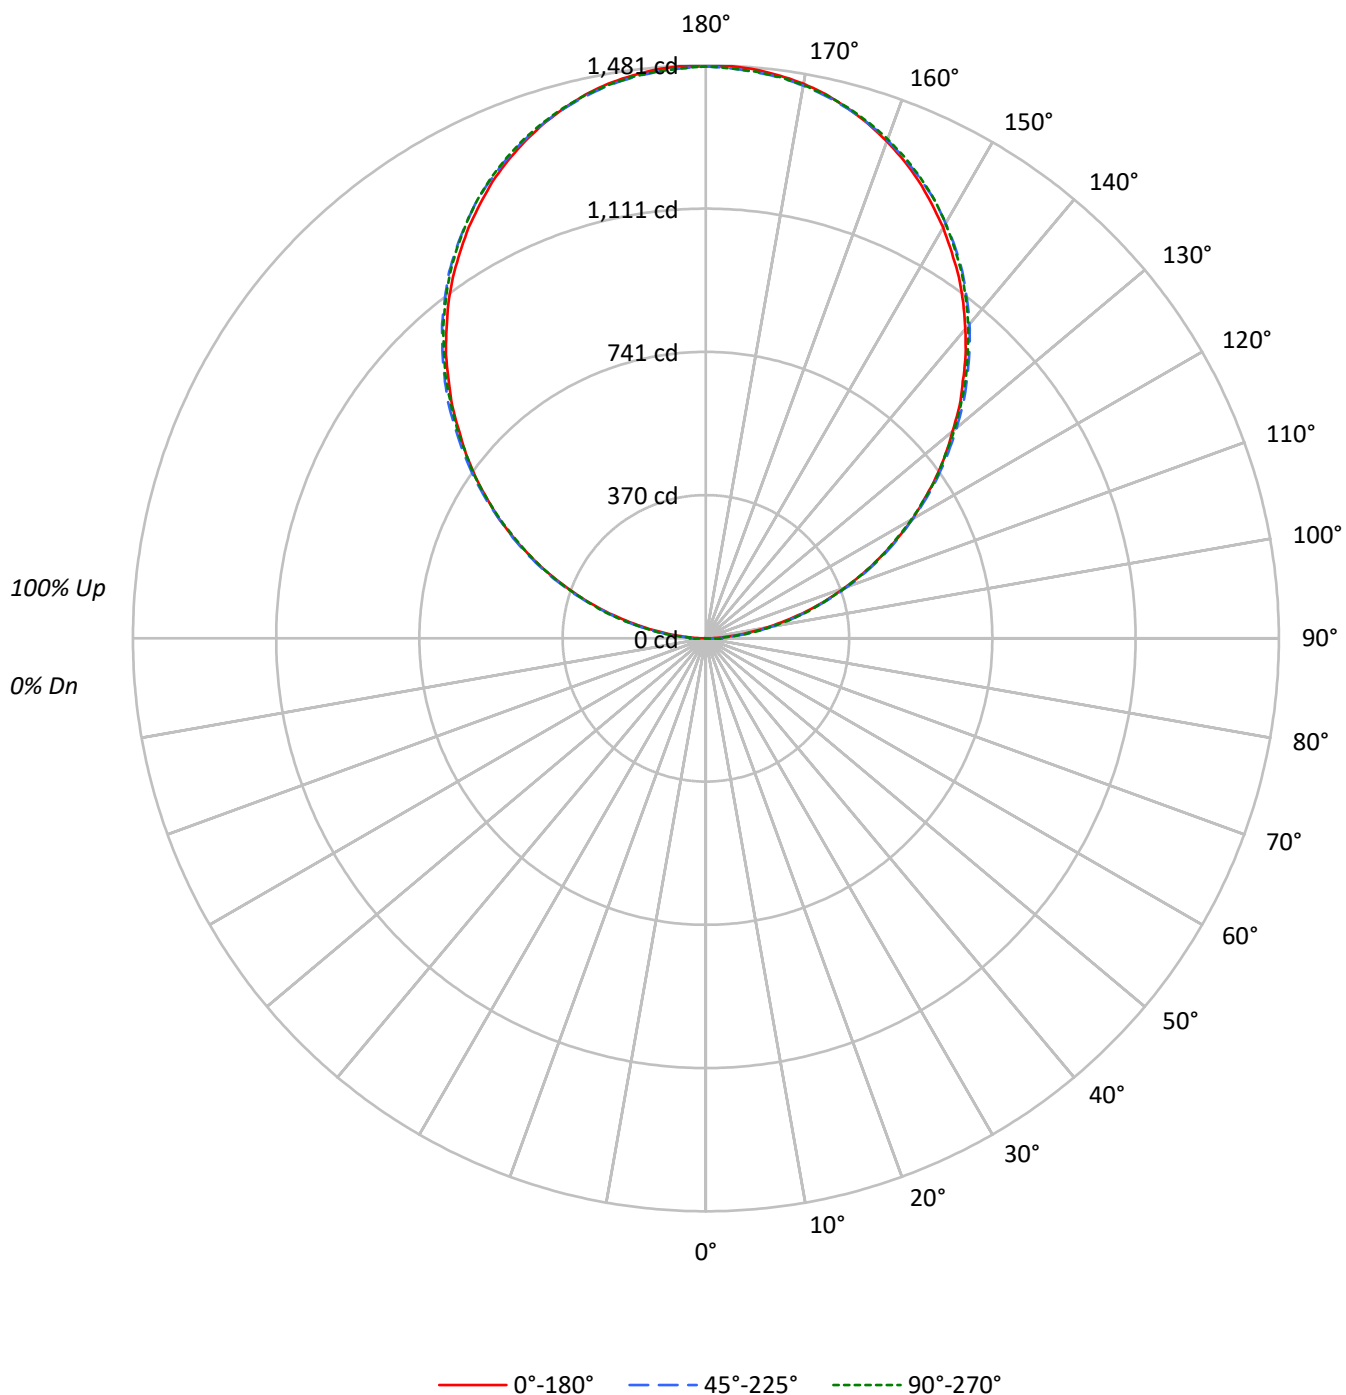

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	4.2	0.1
90°-100°	91.4	2.2
100°-110°	290.7	7.0
110°-120°	497.4	12.0
120°-130°	654.2	15.8
130°-140°	734.3	17.7
140°-150°	720.1	17.4
150°-160°	604.0	14.6
160°-170°	400.6	9.7
170°-180°	140.0	3.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	4.2	0.1
90°-120°	879.5	21.3
90°-150°	2988.1	72.2
90°-180°	4133.0	99.9
0°-180°	4137.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	1	16	44	41	42	4
95°	65	77	80	80	77	72
105°	268	272	274	277	277	283
115°	499	506	504	503	499	494
125°	726	737	734	730	728	649
135°	939	953	956	954	950	726
145°	1140	1149	1156	1158	1153	712
155°	1304	1307	1311	1317	1314	600
165°	1418	1417	1417	1426	1420	400
175°	1476	1472	1470	1478	1471	140
180°	1478	1478	1478	1478	1478	

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	1.2	16.2	43.7	41.2	42.4
92.5°	27.4	37.4	38.7	39.9	39.9
95°	64.9	77.3	79.8	79.8	77.3
97.5°	108.5	119.8	124.7	124.7	124.7
100°	158.4	168.4	172.1	172.1	170.9
102.5°	210.8	218.3	223.3	224.5	223.3
105°	268.2	271.9	274.4	276.9	276.9
107.5°	325.6	330.6	330.6	331.8	325.6
110°	380.5	388.0	388.0	388.0	384.2

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	440.3	447.8	446.6	442.8	440.3
115°	499.0	506.5	504.0	502.7	499.0
117.5°	557.6	567.6	561.3	557.6	553.9
120°	616.2	626.2	616.2	616.2	612.5
122.5°	669.9	682.3	676.1	672.4	669.9
125°	726.0	737.2	733.5	729.7	728.5
127.5°	780.9	794.6	789.6	784.6	780.9
130°	832.0	848.3	845.8	843.3	838.3
132.5°	889.4	901.9	903.1	896.9	893.2
135°	939.3	953.0	955.5	954.3	950.5
137.5°	994.2	1005.4	1007.9	1006.7	1001.7
140°	1042.9	1054.1	1060.3	1060.3	1055.3
142.5°	1092.8	1104.0	1107.7	1109.0	1104.0
145°	1140.2	1148.9	1156.4	1157.6	1152.6
147.5°	1182.6	1193.8	1198.8	1201.3	1196.3
150°	1226.2	1233.7	1238.7	1242.4	1238.7
152.5°	1264.9	1272.4	1278.6	1283.6	1278.6
155°	1303.6	1307.3	1311.1	1317.3	1313.5
157.5°	1337.2	1339.7	1342.2	1351.0	1344.7
160°	1367.2	1369.7	1370.9	1378.4	1373.4
162.5°	1394.6	1394.6	1395.9	1404.6	1398.4
165°	1418.3	1417.1	1417.1	1425.8	1419.6
167.5°	1439.5	1435.8	1435.8	1444.5	1438.3
170°	1455.8	1452.0	1450.8	1459.5	1452.0
172.5°	1467.0	1463.2	1462.0	1470.7	1463.2
175°	1475.7	1472.0	1469.5	1478.2	1470.7
177.5°	1480.7	1477.0	1474.5	1482.0	1474.5
180°	1478.2	1478.2	1478.2	1478.2	1478.2

TEST NUMBER: P982686

CATALOG NUMBER: S122IW-B1240UB50-4F0-XX-W2A-1

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT