

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P982726

Luminaire Tested: S122IW-B435UB50-4F0-XX-W2A-1

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P982726
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-8)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S122IW-B435UB50-4F0-XX-W2A-1
Description: Define 2 Indirect Wall Mount with 5000K BioUP LEDs {m-DER=1.015} {m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1461.0 lumens
Efficiency: N/A
Efficacy: 110.7 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 13.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

Luminous Intensity Polar Plot

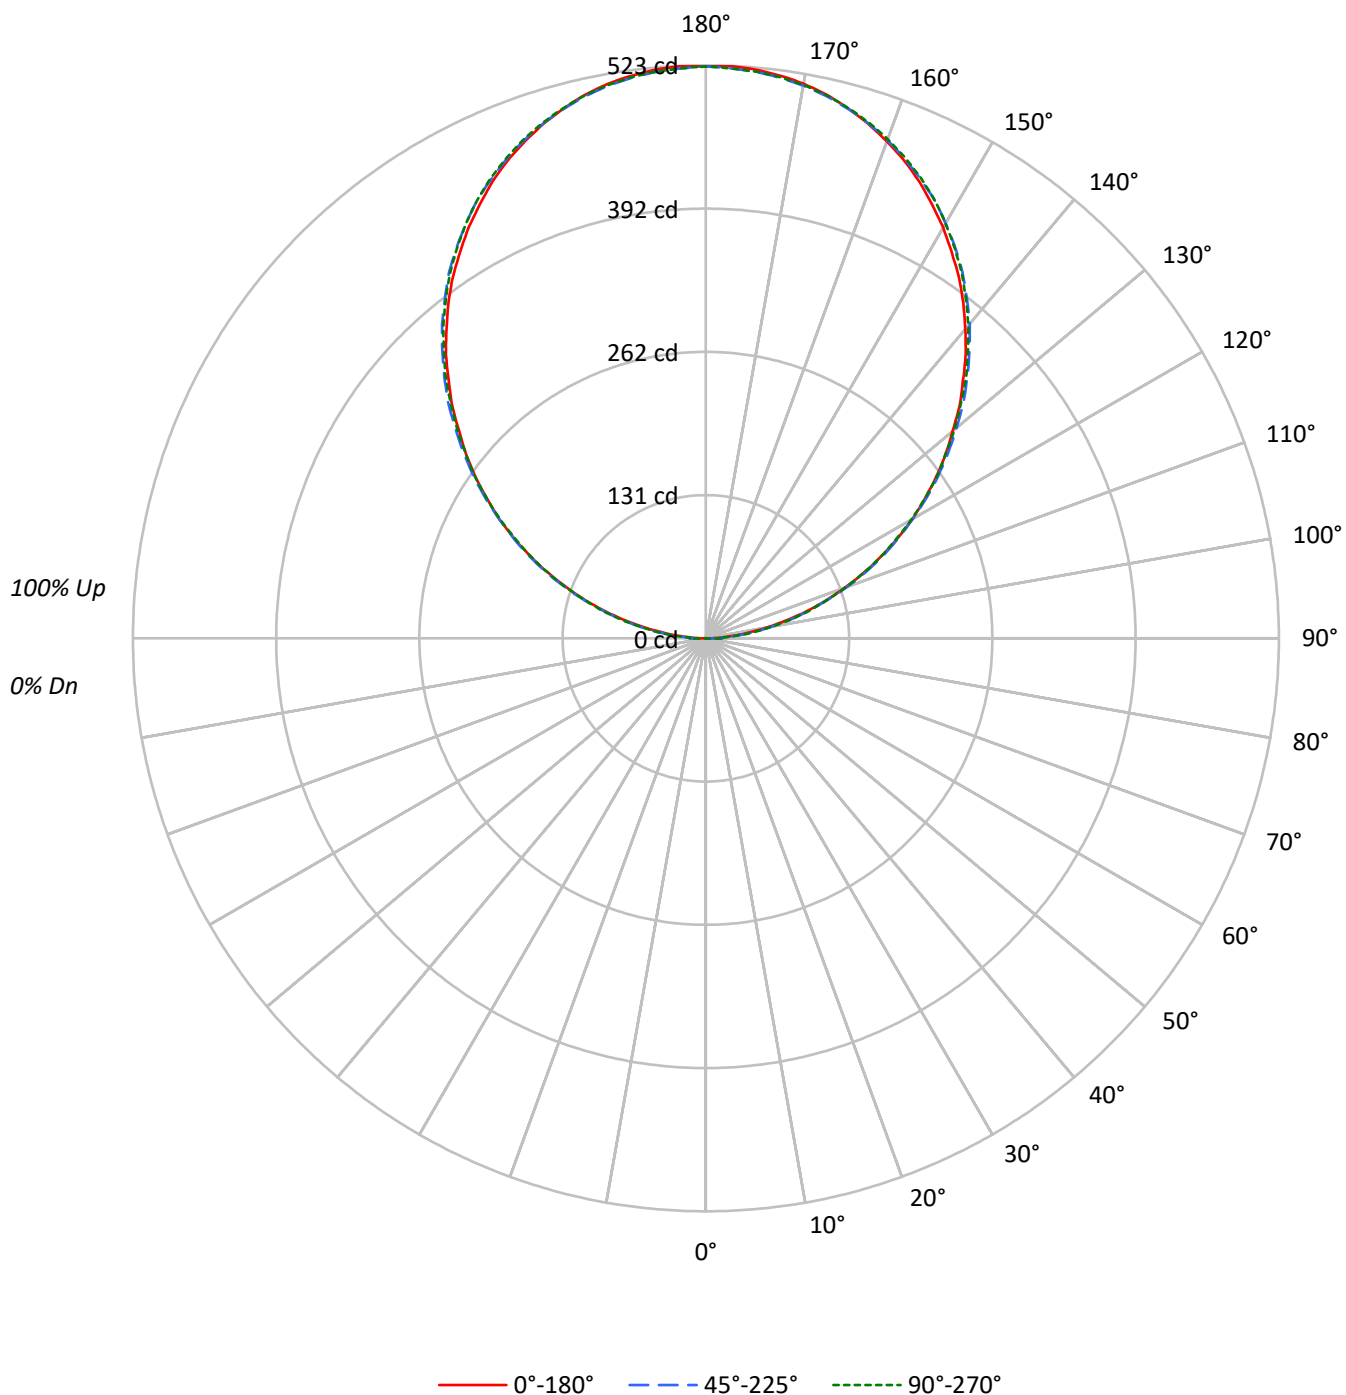

TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	1.5	0.1
90°-100°	32.3	2.2
100°-110°	102.7	7.0
110°-120°	175.7	12.0
120°-130°	231.0	15.8
130°-140°	259.3	17.7
140°-150°	254.3	17.4
150°-160°	213.3	14.6
160°-170°	141.5	9.7
170°-180°	49.4	3.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	1.5	0.1
90°-120°	310.6	21.3
90°-150°	1055.3	72.2
90°-180°	1460.0	99.9
0°-180°	1461.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	6	15	14	15	1
95°	23	27	28	28	27	26
105°	95	96	97	98	98	100
115°	176	179	178	178	176	174
125°	256	260	259	258	257	229
135°	332	337	338	337	336	256
145°	403	406	408	409	407	252
155°	460	462	463	465	464	212
165°	501	500	500	504	501	141
175°	521	520	519	522	519	50
180°	522	522	522	522	522	

TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.4	5.7	15.4	14.5	15.0
92.5°	9.7	13.2	13.7	14.1	14.1
95°	22.9	27.3	28.2	28.2	27.3
97.5°	38.3	42.3	44.1	44.1	44.1
100°	55.9	59.5	60.8	60.8	60.4
102.5°	74.5	77.1	78.9	79.3	78.9
105°	94.7	96.0	96.9	97.8	97.8
107.5°	115.0	116.7	116.7	117.2	115.0
110°	134.4	137.0	137.0	137.0	135.7

TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	155.5	158.2	157.7	156.4	155.5
115°	176.2	178.9	178.0	177.5	176.2
117.5°	196.9	200.4	198.2	196.9	195.6
120°	217.6	221.1	217.6	217.6	216.3
122.5°	236.6	241.0	238.8	237.4	236.6
125°	256.4	260.4	259.0	257.7	257.3
127.5°	275.8	280.6	278.9	277.1	275.8
130°	293.8	299.6	298.7	297.8	296.0
132.5°	314.1	318.5	318.9	316.7	315.4
135°	331.7	336.6	337.5	337.0	335.7
137.5°	351.1	355.1	356.0	355.5	353.8
140°	368.3	372.3	374.5	374.5	372.7
142.5°	385.9	389.9	391.2	391.6	389.9
145°	402.7	405.7	408.4	408.8	407.1
147.5°	417.6	421.6	423.4	424.2	422.5
150°	433.0	435.7	437.5	438.8	437.5
152.5°	446.7	449.3	451.6	453.3	451.6
155°	460.4	461.7	463.0	465.2	463.9
157.5°	472.3	473.1	474.0	477.1	474.9
160°	482.8	483.7	484.2	486.8	485.0
162.5°	492.5	492.5	493.0	496.0	493.8
165°	500.9	500.4	500.4	503.5	501.3
167.5°	508.4	507.1	507.1	510.1	507.9
170°	514.1	512.8	512.3	515.4	512.8
172.5°	518.1	516.7	516.3	519.4	516.7
175°	521.2	519.8	519.0	522.0	519.4
177.5°	522.9	521.6	520.7	523.4	520.7
180°	522.0	522.0	522.0	522.0	522.0



TEST NUMBER: P982726

CATALOG NUMBER: S122IW-B435UB50-4F0-XX-W2A-1

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT