

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1031475

Luminaire Tested: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P1031475
REPORT IS A COMBINATION OF REPORTS P991017 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123DIW-B1165D1535UB30-4F0-XX-W2A-F
Description: Define 3 Direct/Indirect Wall Mount with 3000K BioUP LEDs {m-DER=0.589} {m-EER=0.647}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10997.0 lumens
Efficiency: N/A
Efficacy: 96.9 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.18 / 1.3
Luminous Opening: Rectangular w/ Sides (W: 0.25' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 113.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1031475

CATALOG NUMBER: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

Luminous Intensity Polar Plot

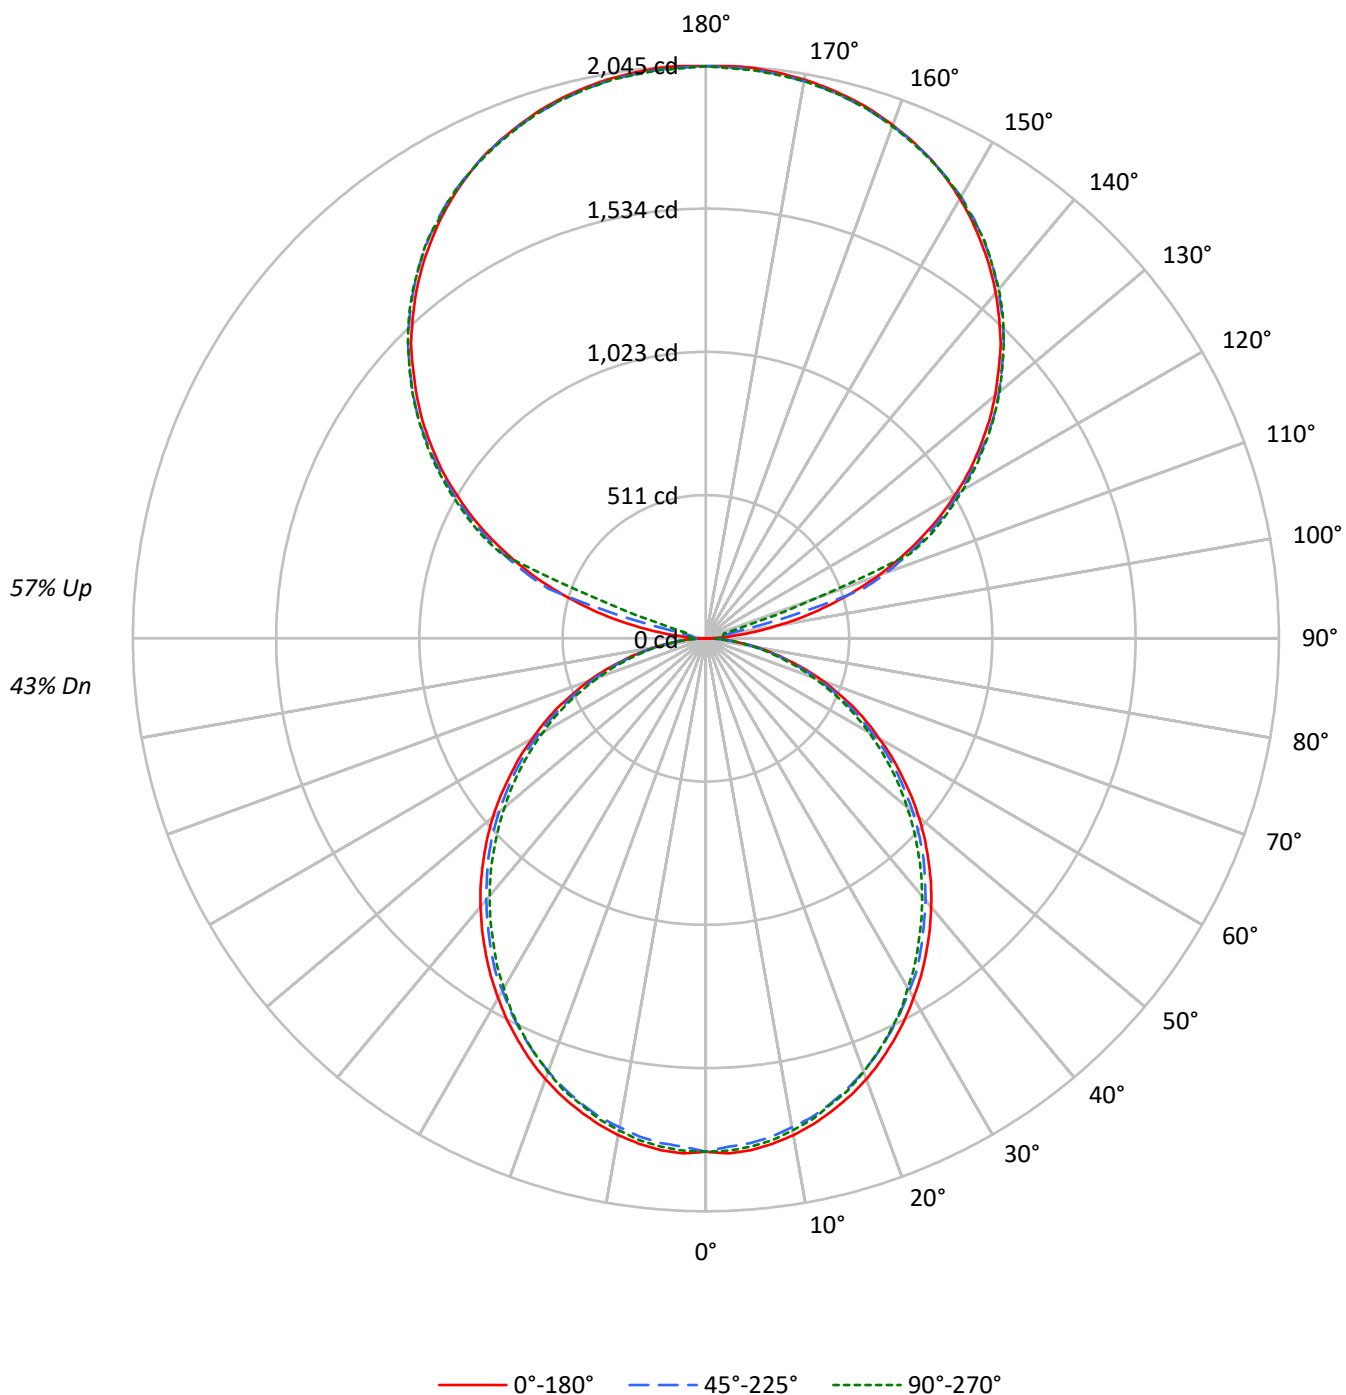

TEST NUMBER: P1031475

CATALOG NUMBER: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	54	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	55	47	41	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	32	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	25	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	19719	19719	19719
5°	19769	19039	19011
10°	19593	18395	18206
15°	19321	17724	17330
20°	19008	16981	16460
25°	18604	16196	15531
30°	18162	15383	14554
35°	17699	14553	13583
40°	17214	13682	12629
45°	16681	12833	11630
50°	16138	11887	10629
55°	15441	10901	9615
60°	14725	9813	8534
65°	14052	8636	7407
70°	13081	7331	6093
75°	11686	5806	4730
80°	10092	4080	3345
85°	7867	2194	1676

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 16681 cd/sqm

TEST NUMBER: P1031475

CATALOG NUMBER: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	1.6
10°-20°	487.7	4.4
20°-30°	720.3	6.5
30°-40°	841.2	7.6
40°-50°	845.7	7.7
50°-60°	742.9	6.8
60°-70°	553.3	5.0
70°-80°	314.9	2.9
80°-90°	93.6	0.9
90°-100°	72.0	0.7
100°-110°	348.1	3.2
110°-120°	853.1	7.8
120°-130°	1083.0	9.8
130°-140°	1156.9	10.5
140°-150°	1081.9	9.8
150°-160°	872.6	7.9
160°-170°	563.2	5.1
170°-180°	194.1	1.8
0°-30°	1380.7	12.6
0°-40°	2221.8	20.2
0°-60°	3810.4	34.6
0°-90°	4772.1	43.4
90°-120°	1273.3	11.6
90°-150°	4595.1	41.8
90°-180°	6225.0	56.6
0°-180°	10997.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1832	1832	1832	1832	1832	
5°	1834	1826	1808	1824	1821	174
15°	1745	1739	1719	1731	1722	492
25°	1585	1575	1555	1556	1552	730
35°	1370	1361	1341	1331	1323	857
45°	1123	1117	1096	1078	1070	867
55°	852	851	830	813	805	763
65°	581	573	558	545	540	573
75°	307	301	296	288	284	328
85°	82	79	79	76	76	88
90°	2	17	36	42	46	11
95°	92	30	47	58	58	111
105°	452	469	332	64	67	479
115°	848	857	871	886	892	837
125°	1195	1208	1214	1217	1220	1068
135°	1488	1497	1503	1508	1503	1146
145°	1717	1728	1731	1734	1734	1075
155°	1892	1889	1890	1898	1889	872
165°	1995	1990	1989	2001	1990	564
175°	2042	2034	2036	2046	2034	194
180°	2042	2042	2042	2042	2042	

TEST NUMBER: P1031475

CATALOG NUMBER: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1832.0	1832.0	1832.0	1832.0	1832.0
2.5°	1839.9	1833.6	1816.3	1832.0	1830.5
5°	1833.6	1825.7	1808.4	1824.2	1821.0
7.5°	1819.4	1811.6	1794.2	1808.4	1806.8
10°	1800.5	1792.7	1772.2	1786.4	1783.2
12.5°	1775.3	1769.0	1750.1	1759.6	1758.0
15°	1745.4	1739.1	1718.6	1731.2	1721.8
17.5°	1712.3	1704.4	1684.0	1693.4	1690.3
20°	1674.5	1665.1	1644.6	1650.9	1646.2
22.5°	1632.0	1622.5	1602.1	1606.8	1600.5
25°	1584.7	1575.3	1554.8	1556.4	1551.6
27.5°	1535.9	1526.4	1504.4	1506.0	1501.2
30°	1482.3	1474.5	1452.4	1452.4	1441.4
32.5°	1428.8	1417.7	1402.0	1391.0	1386.2
35°	1370.5	1361.0	1340.6	1331.1	1323.2
37.5°	1312.2	1299.6	1279.1	1268.1	1263.4
40°	1250.8	1241.3	1219.3	1206.7	1200.4
42.5°	1189.3	1178.3	1156.3	1143.6	1137.3
45°	1123.2	1116.9	1096.4	1077.5	1069.6
47.5°	1058.6	1049.1	1030.2	1011.3	1005.0
50°	992.4	984.5	964.1	946.7	937.3
52.5°	923.1	918.4	896.3	882.2	872.7
55°	852.2	850.6	830.2	812.8	805.0
57.5°	786.1	779.8	764.0	748.3	738.8
60°	713.6	712.0	693.1	678.9	671.1
62.5°	649.0	644.3	625.4	611.2	606.5
65°	581.3	573.4	557.6	545.0	540.3
67.5°	508.8	502.5	489.9	478.9	472.6
70°	444.2	434.8	425.3	414.3	406.4
72.5°	376.5	370.2	359.2	349.7	346.6
75°	307.2	300.9	296.2	288.3	283.5
77.5°	245.7	242.6	236.3	230.0	230.0
80°	185.9	181.2	178.0	176.4	176.4
82.5°	127.6	127.6	127.6	124.4	122.9
85°	81.9	78.8	78.8	75.6	75.6
87.5°	41.0	36.2	34.7	33.1	33.1
90°	1.5	16.7	36.4	42.5	45.5
92.5°	34.9	25.8	39.4	50.1	51.6
95°	92.5	30.3	47.0	57.6	57.6
97.5°	168.4	125.9	48.5	60.7	62.2
100°	256.4	286.7	50.1	62.2	63.7
102.5°	356.5	376.2	112.3	62.2	65.2
105°	452.1	468.8	332.2	63.7	66.7
107.5°	553.7	567.4	590.1	356.5	157.8
110°	655.4	667.5	684.2	634.1	417.2

TEST NUMBER: P1031475

CATALOG NUMBER: S123DIW-B1165D1535UB30-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	752.4	763.1	779.7	793.4	790.4
115°	848.0	857.1	870.8	885.9	892.0
117.5°	942.1	952.7	960.3	972.4	973.9
120°	1028.5	1042.2	1046.7	1058.9	1058.9
122.5°	1116.5	1127.1	1133.2	1140.8	1142.3
125°	1195.4	1207.5	1213.6	1216.6	1219.7
127.5°	1274.3	1286.4	1294.0	1298.6	1295.5
130°	1347.1	1359.2	1365.3	1371.4	1368.3
132.5°	1416.9	1429.0	1433.6	1439.6	1435.1
135°	1488.2	1497.3	1503.4	1507.9	1503.4
137.5°	1548.9	1561.0	1564.0	1571.6	1568.6
140°	1609.6	1618.7	1623.2	1629.3	1626.2
142.5°	1665.7	1674.8	1679.3	1683.9	1679.3
145°	1717.3	1727.9	1730.9	1734.0	1734.0
147.5°	1767.3	1774.9	1777.9	1781.0	1773.4
150°	1812.8	1817.4	1820.4	1823.5	1818.9
152.5°	1853.8	1855.3	1856.8	1862.9	1855.3
155°	1891.7	1888.7	1890.2	1897.8	1888.7
157.5°	1922.1	1922.1	1920.5	1929.6	1917.5
160°	1949.4	1947.9	1946.3	1955.4	1944.8
162.5°	1975.2	1970.6	1969.1	1979.7	1970.6
165°	1994.9	1990.3	1988.8	2000.9	1990.3
167.5°	2011.6	2005.5	2005.5	2017.6	2005.5
170°	2025.2	2019.2	2019.2	2031.3	2019.2
172.5°	2034.3	2026.7	2028.3	2040.4	2026.7
175°	2041.9	2034.3	2035.8	2046.5	2034.3
177.5°	2044.9	2037.4	2038.9	2051.0	2035.8
180°	2041.9	2041.9	2041.9	2041.9	2041.9

(END OF REPORT)