

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1032230

Luminaire Tested: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1032230
REPORT IS A COMBINATION OF REPORTS P994288 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123RDIW-B340D1535UB50-4F0-XX-W2A-F
Description: Define 3 Regressed Direct/Indirect Wall Mount with 5000K BioUP LEDs {m-DER=1.015}
{m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7204.0 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.07 / 1.22
Luminous Opening: Rectangular w/ Sides (W: 0.25' x L: 4' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 65.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1032230

CATALOG NUMBER: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

Luminous Intensity Polar Plot

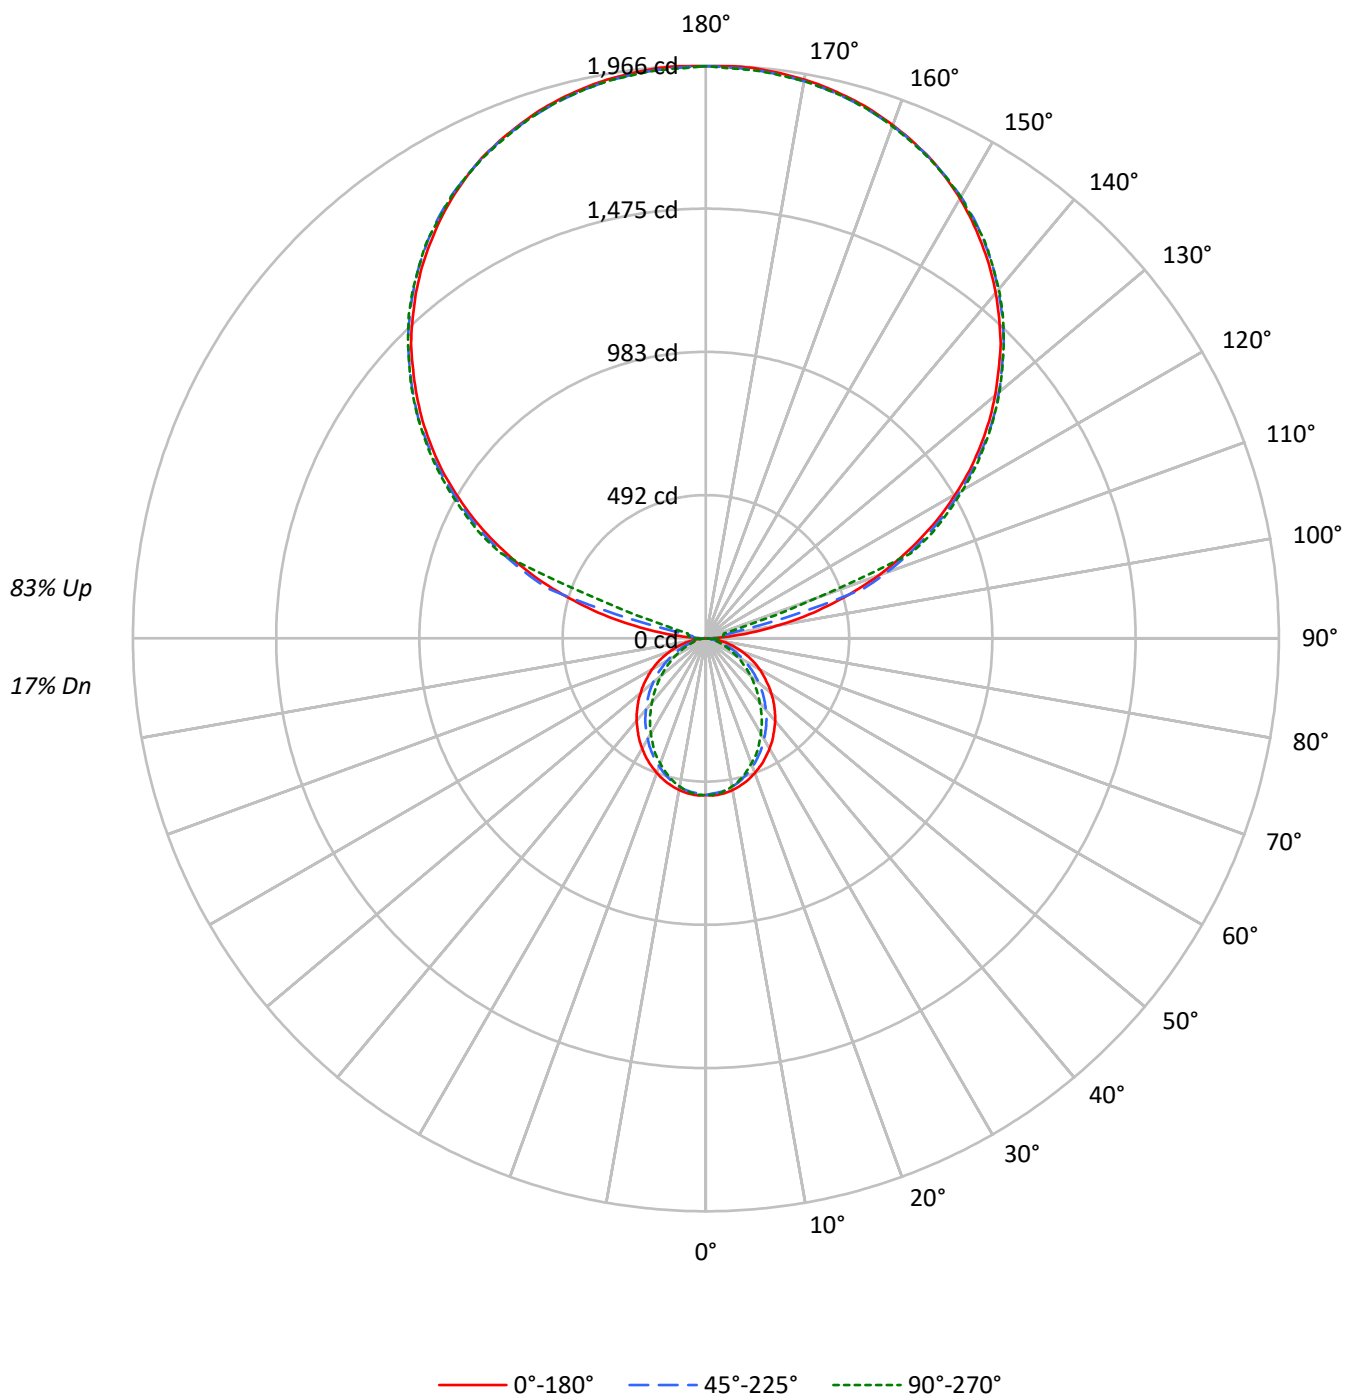

TEST NUMBER: P1032230

CATALOG NUMBER: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	99	99	99	99	87	87	87	87	65	65	65	45	45	45	26	26	26
1	90	86	83	79	79	76	73	70	57	55	53	39	38	37	23	22	22
2	82	75	70	65	72	67	62	58	50	47	44	34	33	31	20	19	19
3	75	66	60	54	66	59	53	48	44	40	37	31	28	26	18	17	16
4	69	59	51	46	60	52	46	41	39	35	32	27	25	23	16	15	14
5	63	52	44	39	55	46	40	35	35	30	27	24	22	19	14	13	12
6	58	46	39	33	51	41	35	30	31	27	23	22	19	17	13	12	11
7	53	42	34	29	47	37	31	26	28	24	20	20	17	15	12	10	9
8	49	38	30	25	43	34	27	23	26	21	18	18	15	13	11	9	8
9	46	34	27	22	40	30	24	20	23	19	16	17	14	12	10	9	7
10	43	31	24	20	37	28	22	18	21	17	14	15	12	10	9	8	7

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5789	5789	5789
5°	5798	5584	5569
10°	5752	5374	5268
15°	5678	5114	4939
20°	5580	4832	4571
25°	5479	4539	4222
30°	5349	4227	3810
35°	5216	3921	3434
40°	5091	3588	3019
45°	4929	3262	2647
50°	4752	2915	2260
55°	4568	2543	1906
60°	4393	2162	1548
65°	4165	1770	1208
70°	3878	1338	864
75°	3469	906	684
80°	2959	630	480
85°	2219	340	250

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4929 cd/sqm

TEST NUMBER: P1032230

CATALOG NUMBER: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	50.6	0.7
10°-20°	140.6	2.0
20°-30°	202.5	2.8
30°-40°	228.0	3.2
40°-50°	218.1	3.0
50°-60°	178.6	2.5
60°-70°	120.4	1.7
70°-80°	60.4	0.8
80°-90°	19.7	0.3
90°-100°	69.2	1.0
100°-110°	334.7	4.6
110°-120°	820.2	11.4
120°-130°	1041.3	14.5
130°-140°	1112.4	15.4
140°-150°	1040.2	14.4
150°-160°	839.0	11.6
160°-170°	541.5	7.5
170°-180°	186.6	2.6
0°-30°	393.7	5.5
0°-40°	621.7	8.6
0°-60°	1018.4	14.1
0°-90°	1218.9	16.9
90°-120°	1224.2	17.0
90°-150°	4418.0	61.3
90°-180°	5985.0	83.1
0°-180°	7204.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	538	538	538	538	538	
5°	538	536	530	534	533	51
15°	513	508	496	494	491	145
25°	467	456	436	427	422	215
35°	404	388	361	342	334	253
45°	332	312	279	254	243	256
55°	252	231	194	168	160	226
65°	172	148	114	93	88	171
75°	91	70	46	42	41	97
85°	23	14	12	11	11	25
90°	2	16	35	41	44	6
95°	89	29	45	55	55	106
105°	435	451	319	61	64	461
115°	815	824	837	852	858	805
125°	1149	1161	1167	1170	1173	1027
135°	1431	1440	1445	1450	1445	1102
145°	1651	1661	1664	1667	1667	1034
155°	1819	1816	1817	1825	1816	838
165°	1918	1914	1912	1924	1914	542
175°	1963	1956	1957	1968	1956	187
180°	1963	1963	1963	1963	1963	

TEST NUMBER: P1032230

CATALOG NUMBER: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	537.8	537.8	537.8	537.8	537.8
2.5°	540.0	538.2	533.0	537.8	536.9
5°	537.8	535.6	530.4	534.3	533.4
7.5°	533.9	531.7	525.2	527.8	526.5
10°	528.6	525.6	517.7	518.2	516.0
12.5°	521.2	517.7	507.7	507.3	504.7
15°	512.9	508.1	495.9	493.8	490.7
17.5°	502.9	497.7	482.4	478.1	473.7
20°	491.6	484.6	468.0	462.3	457.1
22.5°	478.9	470.6	452.8	445.3	440.5
25°	466.7	455.8	435.7	426.6	421.8
27.5°	451.9	440.1	418.3	406.1	398.7
30°	436.6	423.5	399.1	384.3	377.3
32.5°	421.3	406.1	379.9	363.3	355.9
35°	403.9	388.2	361.2	342.4	334.5
37.5°	386.5	369.4	341.1	320.2	310.6
40°	369.9	350.7	319.7	297.0	287.0
42.5°	351.1	331.9	299.7	274.4	265.6
45°	331.9	312.3	278.7	253.9	243.4
47.5°	313.2	291.4	258.2	231.2	222.0
50°	292.2	271.7	236.4	209.4	199.3
52.5°	273.5	250.8	215.9	187.6	178.8
55°	252.1	230.7	193.7	168.4	159.6
57.5°	232.9	209.8	172.3	148.3	140.9
60°	212.9	188.9	152.7	129.1	121.7
62.5°	192.8	168.8	132.6	110.8	102.9
65°	172.3	148.3	114.3	92.9	88.1
67.5°	151.8	127.4	94.2	78.1	72.8
70°	131.7	108.2	77.6	62.4	57.6
72.5°	111.7	88.5	61.5	49.7	48.4
75°	91.2	70.2	46.2	41.9	41.0
77.5°	72.4	53.2	36.2	33.6	32.7
80°	54.5	36.6	27.5	26.2	25.3
82.5°	37.5	22.7	19.6	18.3	18.3
85°	23.1	13.5	12.2	11.3	11.3
87.5°	10.5	5.7	5.7	5.2	4.8
90°	1.5	16.0	35.0	40.8	43.8
92.5°	33.5	24.8	37.9	48.1	49.6
95°	89.0	29.2	45.2	55.4	55.4
97.5°	161.9	121.1	46.7	58.3	59.8
100°	246.5	275.7	48.1	59.8	61.3
102.5°	342.8	361.7	107.9	59.8	62.7
105°	434.7	450.7	319.4	61.3	64.2
107.5°	532.4	545.5	567.4	342.8	151.7
110°	630.1	641.8	657.8	609.7	401.1

TEST NUMBER: P1032230

CATALOG NUMBER: S123RDIW-B340D1535UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	723.4	733.7	749.7	762.8	759.9
115°	815.3	824.1	837.2	851.8	857.6
117.5°	905.8	916.0	923.3	934.9	936.4
120°	988.9	1002.0	1006.4	1018.1	1018.1
122.5°	1073.5	1083.7	1089.5	1096.8	1098.3
125°	1149.4	1161.0	1166.9	1169.8	1172.7
127.5°	1225.2	1236.9	1244.2	1248.5	1245.6
130°	1295.2	1306.9	1312.7	1318.5	1315.6
132.5°	1362.3	1374.0	1378.3	1384.2	1379.8
135°	1430.9	1439.6	1445.4	1449.8	1445.4
137.5°	1489.2	1500.9	1503.8	1511.1	1508.2
140°	1547.5	1556.3	1560.7	1566.5	1563.6
142.5°	1601.5	1610.3	1614.6	1619.0	1614.6
145°	1651.1	1661.3	1664.2	1667.1	1667.1
147.5°	1699.2	1706.5	1709.4	1712.4	1705.1
150°	1743.0	1747.4	1750.3	1753.2	1748.8
152.5°	1782.4	1783.8	1785.3	1791.1	1783.8
155°	1818.8	1815.9	1817.4	1824.7	1815.9
157.5°	1848.0	1848.0	1846.5	1855.3	1843.6
160°	1874.3	1872.8	1871.3	1880.1	1869.9
162.5°	1899.1	1894.7	1893.2	1903.4	1894.7
165°	1918.0	1913.6	1912.2	1923.9	1913.6
167.5°	1934.1	1928.2	1928.2	1939.9	1928.2
170°	1947.2	1941.4	1941.4	1953.0	1941.4
172.5°	1955.9	1948.6	1950.1	1961.8	1948.6
175°	1963.2	1955.9	1957.4	1967.6	1955.9
177.5°	1966.1	1958.9	1960.3	1972.0	1957.4
180°	1963.2	1963.2	1963.2	1963.2	1963.2

(END OF REPORT)