

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1032422

Luminaire Tested: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

Issue Date: 5/6/2025

Test Information

Test Method: LM-79-2019
Report Number: P1032422
REPORT IS A COMBINATION OF REPORTS P994728 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/6/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123RDIW-B775D1535UB50-4F0-XX-W2A-F
Description: Define 3 Regressed Direct/Indirect Wall Mount with 5000K BioUP LEDs {m-DER=1.015}
{m-EER=1.115}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8808.0 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.07 / 1.22
Luminous Opening: Rectangular w/ Sides (W: 0.25' x L: 4' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 88.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1032422

CATALOG NUMBER: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

Luminous Intensity Polar Plot

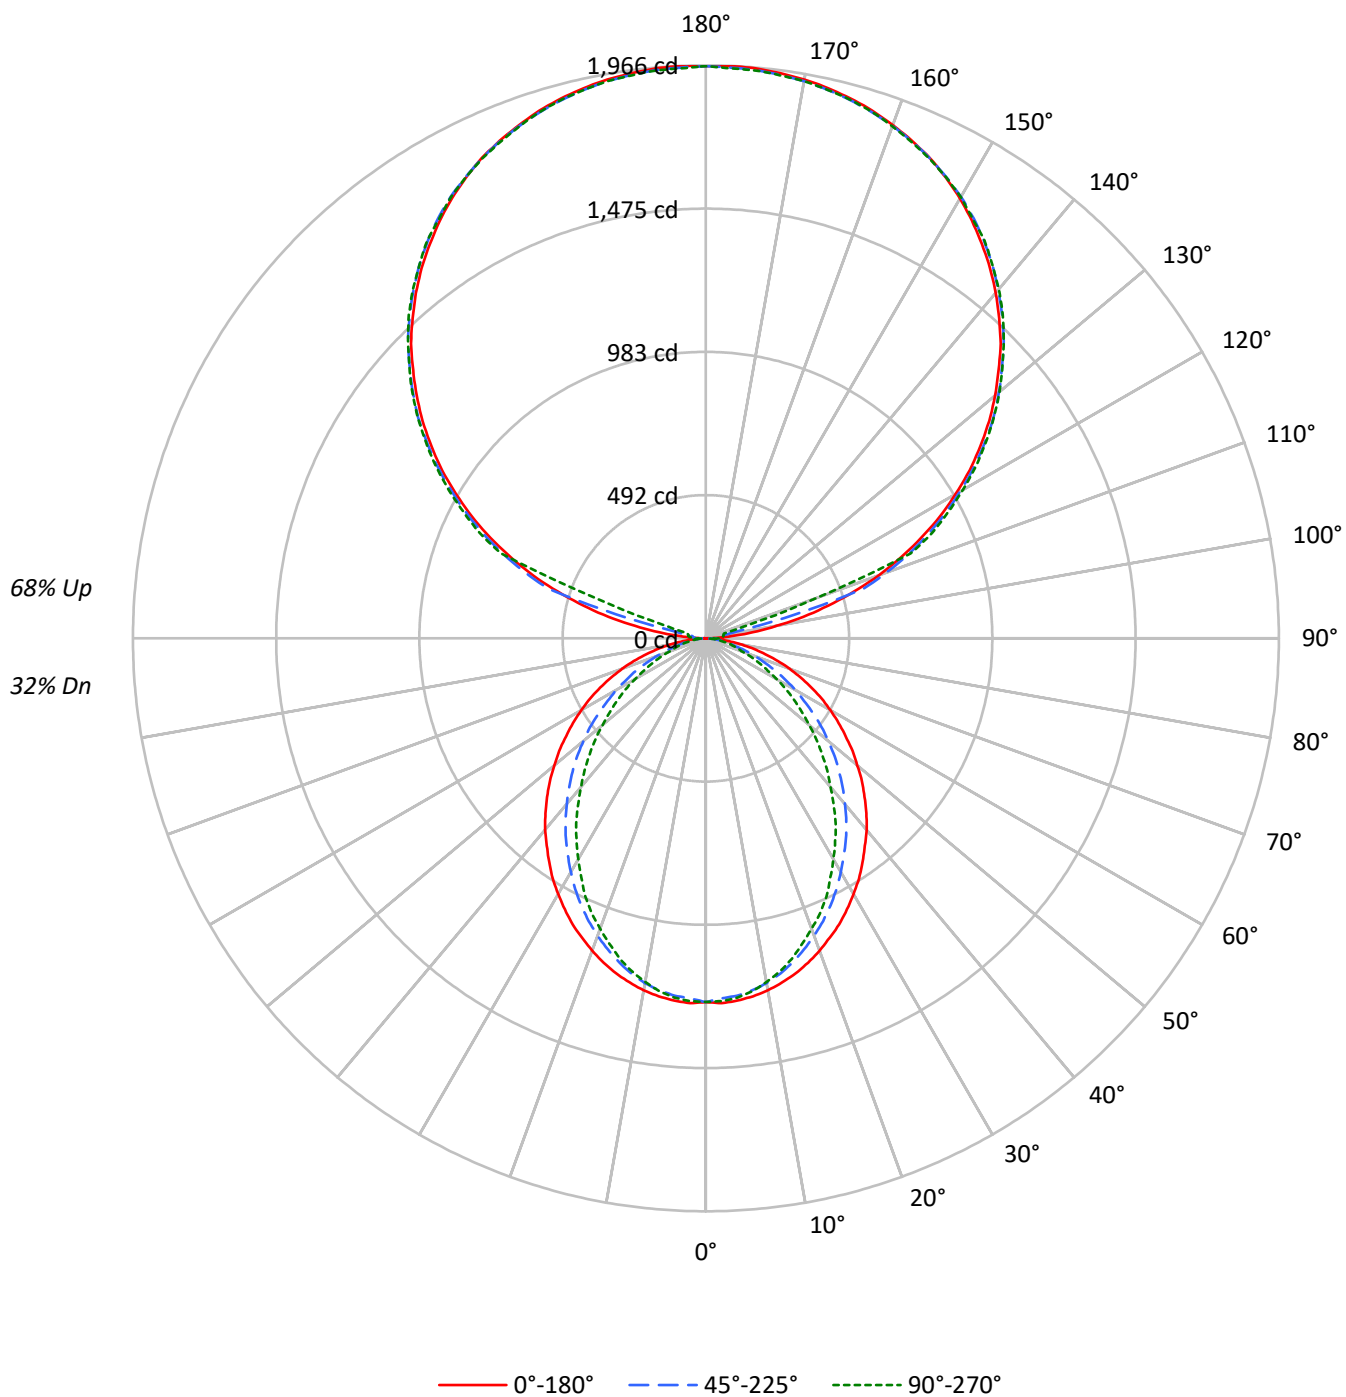

TEST NUMBER: P1032422

CATALOG NUMBER: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	84	81	78	75	64	62	60	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	53	50	44	41	39	31	30	29
3	78	69	62	57	70	63	57	52	50	46	43	39	36	33	28	26	25
4	72	61	54	48	64	56	49	44	45	40	36	34	31	29	25	23	21
5	66	55	47	41	59	50	43	38	40	35	31	31	28	25	23	20	19
6	60	49	41	36	54	44	38	33	36	31	27	28	25	22	21	18	17
7	56	44	36	31	50	40	33	29	33	28	24	25	22	19	19	17	15
8	52	40	33	27	47	36	30	25	30	25	21	23	20	17	17	15	13
9	48	36	29	24	43	33	27	23	27	22	19	21	18	15	16	14	12
10	45	33	26	22	40	30	24	20	25	20	17	20	16	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	13431	13431	13431
5°	13453	12956	12921
10°	13347	12468	12223
15°	13174	11866	11459
20°	12946	11212	10605
25°	12712	10531	9795
30°	12412	9808	8839
35°	12102	9096	7968
40°	11811	8324	7005
45°	11437	7570	6140
50°	11025	6763	5245
55°	10598	5900	4424
60°	10191	5015	3590
65°	9662	4106	2802
70°	9000	3105	2003
75°	8045	2103	1587
80°	6868	1462	1113
85°	5149	788	583

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 11437 cd/sqm

TEST NUMBER: P1032422

CATALOG NUMBER: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	117.3	1.3
10°-20°	326.3	3.7
20°-30°	469.8	5.3
30°-40°	529.1	6.0
40°-50°	506.1	5.7
50°-60°	414.3	4.7
60°-70°	279.3	3.2
70°-80°	140.1	1.6
80°-90°	40.5	0.5
90°-100°	69.2	0.8
100°-110°	334.7	3.8
110°-120°	820.2	9.3
120°-130°	1041.3	11.8
130°-140°	1112.4	12.6
140°-150°	1040.2	11.8
150°-160°	839.0	9.5
160°-170°	541.5	6.1
170°-180°	186.6	2.1
0°-30°	913.4	10.4
0°-40°	1442.6	16.4
0°-60°	2363.0	26.8
0°-90°	2822.9	32.0
90°-120°	1224.2	13.9
90°-150°	4418.0	50.2
90°-180°	5985.0	67.9
0°-180°	8808.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1248	1248	1248	1248	1248	
5°	1248	1243	1231	1240	1238	118
15°	1190	1179	1151	1146	1138	335
25°	1083	1058	1011	990	979	498
35°	937	901	838	794	776	587
45°	770	725	647	589	565	594
55°	585	535	449	391	370	525
65°	400	344	265	216	204	396
75°	212	163	107	97	95	225
85°	54	31	28	26	26	59
90°	2	16	35	41	44	8
95°	89	29	45	55	55	106
105°	435	451	319	61	64	461
115°	815	824	837	852	858	805
125°	1149	1161	1167	1170	1173	1027
135°	1431	1440	1445	1450	1445	1102
145°	1651	1661	1664	1667	1667	1034
155°	1819	1816	1817	1825	1816	838
165°	1918	1914	1912	1924	1914	542
175°	1963	1956	1957	1968	1956	187
180°	1963	1963	1963	1963	1963	

TEST NUMBER: P1032422

CATALOG NUMBER: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1247.8	1247.8	1247.8	1247.8	1247.8
2.5°	1252.9	1248.8	1236.7	1247.8	1245.8
5°	1247.8	1242.7	1230.6	1239.7	1237.7
7.5°	1238.7	1233.6	1218.5	1224.5	1221.5
10°	1226.5	1219.5	1201.2	1202.3	1197.2
12.5°	1209.3	1201.2	1178.0	1177.0	1170.9
15°	1190.1	1179.0	1150.6	1145.6	1138.5
17.5°	1166.8	1154.7	1119.3	1109.2	1099.0
20°	1140.5	1124.3	1085.9	1072.7	1060.6
22.5°	1111.2	1092.0	1050.5	1033.3	1022.1
25°	1082.8	1057.5	1011.0	989.7	978.6
27.5°	1048.4	1021.1	970.5	942.2	925.0
30°	1013.0	982.7	926.0	891.6	875.4
32.5°	977.6	942.2	881.5	843.0	825.8
35°	937.1	900.7	837.9	794.4	776.2
37.5°	896.6	857.2	791.4	742.8	720.5
40°	858.2	813.7	741.8	689.2	665.9
42.5°	814.7	770.1	695.2	636.5	616.3
45°	770.1	724.6	646.7	589.0	564.7
47.5°	726.6	676.0	599.1	536.4	515.1
50°	678.0	630.5	548.5	485.8	462.5
52.5°	634.5	581.9	500.9	435.2	414.9
55°	584.9	535.3	449.3	390.6	370.4
57.5°	540.4	486.8	399.7	344.1	326.9
60°	493.9	438.2	354.2	299.6	282.3
62.5°	447.3	391.6	307.6	257.0	238.8
65°	399.7	344.1	265.1	215.6	204.4
67.5°	352.2	295.5	218.6	181.1	169.0
70°	305.6	251.0	180.1	144.7	133.6
72.5°	259.1	205.4	142.7	115.4	112.3
75°	211.5	162.9	107.3	97.2	95.1
77.5°	168.0	123.5	84.0	77.9	75.9
80°	126.5	85.0	63.8	60.7	58.7
82.5°	87.0	52.6	45.5	42.5	42.5
85°	53.6	31.4	28.3	26.3	26.3
87.5°	24.3	13.2	13.2	12.1	11.1
90°	1.5	16.0	35.0	40.8	43.8
92.5°	33.5	24.8	37.9	48.1	49.6
95°	89.0	29.2	45.2	55.4	55.4
97.5°	161.9	121.1	46.7	58.3	59.8
100°	246.5	275.7	48.1	59.8	61.3
102.5°	342.8	361.7	107.9	59.8	62.7
105°	434.7	450.7	319.4	61.3	64.2
107.5°	532.4	545.5	567.4	342.8	151.7
110°	630.1	641.8	657.8	609.7	401.1

TEST NUMBER: P1032422

CATALOG NUMBER: S123RDIW-B775D1535UB50-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	723.4	733.7	749.7	762.8	759.9
115°	815.3	824.1	837.2	851.8	857.6
117.5°	905.8	916.0	923.3	934.9	936.4
120°	988.9	1002.0	1006.4	1018.1	1018.1
122.5°	1073.5	1083.7	1089.5	1096.8	1098.3
125°	1149.4	1161.0	1166.9	1169.8	1172.7
127.5°	1225.2	1236.9	1244.2	1248.5	1245.6
130°	1295.2	1306.9	1312.7	1318.5	1315.6
132.5°	1362.3	1374.0	1378.3	1384.2	1379.8
135°	1430.9	1439.6	1445.4	1449.8	1445.4
137.5°	1489.2	1500.9	1503.8	1511.1	1508.2
140°	1547.5	1556.3	1560.7	1566.5	1563.6
142.5°	1601.5	1610.3	1614.6	1619.0	1614.6
145°	1651.1	1661.3	1664.2	1667.1	1667.1
147.5°	1699.2	1706.5	1709.4	1712.4	1705.1
150°	1743.0	1747.4	1750.3	1753.2	1748.8
152.5°	1782.4	1783.8	1785.3	1791.1	1783.8
155°	1818.8	1815.9	1817.4	1824.7	1815.9
157.5°	1848.0	1848.0	1846.5	1855.3	1843.6
160°	1874.3	1872.8	1871.3	1880.1	1869.9
162.5°	1899.1	1894.7	1893.2	1903.4	1894.7
165°	1918.0	1913.6	1912.2	1923.9	1913.6
167.5°	1934.1	1928.2	1928.2	1939.9	1928.2
170°	1947.2	1941.4	1941.4	1953.0	1941.4
172.5°	1955.9	1948.6	1950.1	1961.8	1948.6
175°	1963.2	1955.9	1957.4	1967.6	1955.9
177.5°	1966.1	1958.9	1960.3	1972.0	1957.4
180°	1963.2	1963.2	1963.2	1963.2	1963.2

(END OF REPORT)