

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P982934

Luminaire Tested: S123IW-B1030UB40-4F0-XX-W2A-1

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P982934
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-9)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123IW-B1030UB40-4F0-XX-W2A-1
Description: Define 3 Indirect Wall Mount with 4000K BioUP LEDs {m-DER=0.865} {m-EER=0.951}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3606.0 lumens
Efficiency: N/A
Efficacy: 114.5 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.25' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 31.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

Luminous Intensity Polar Plot

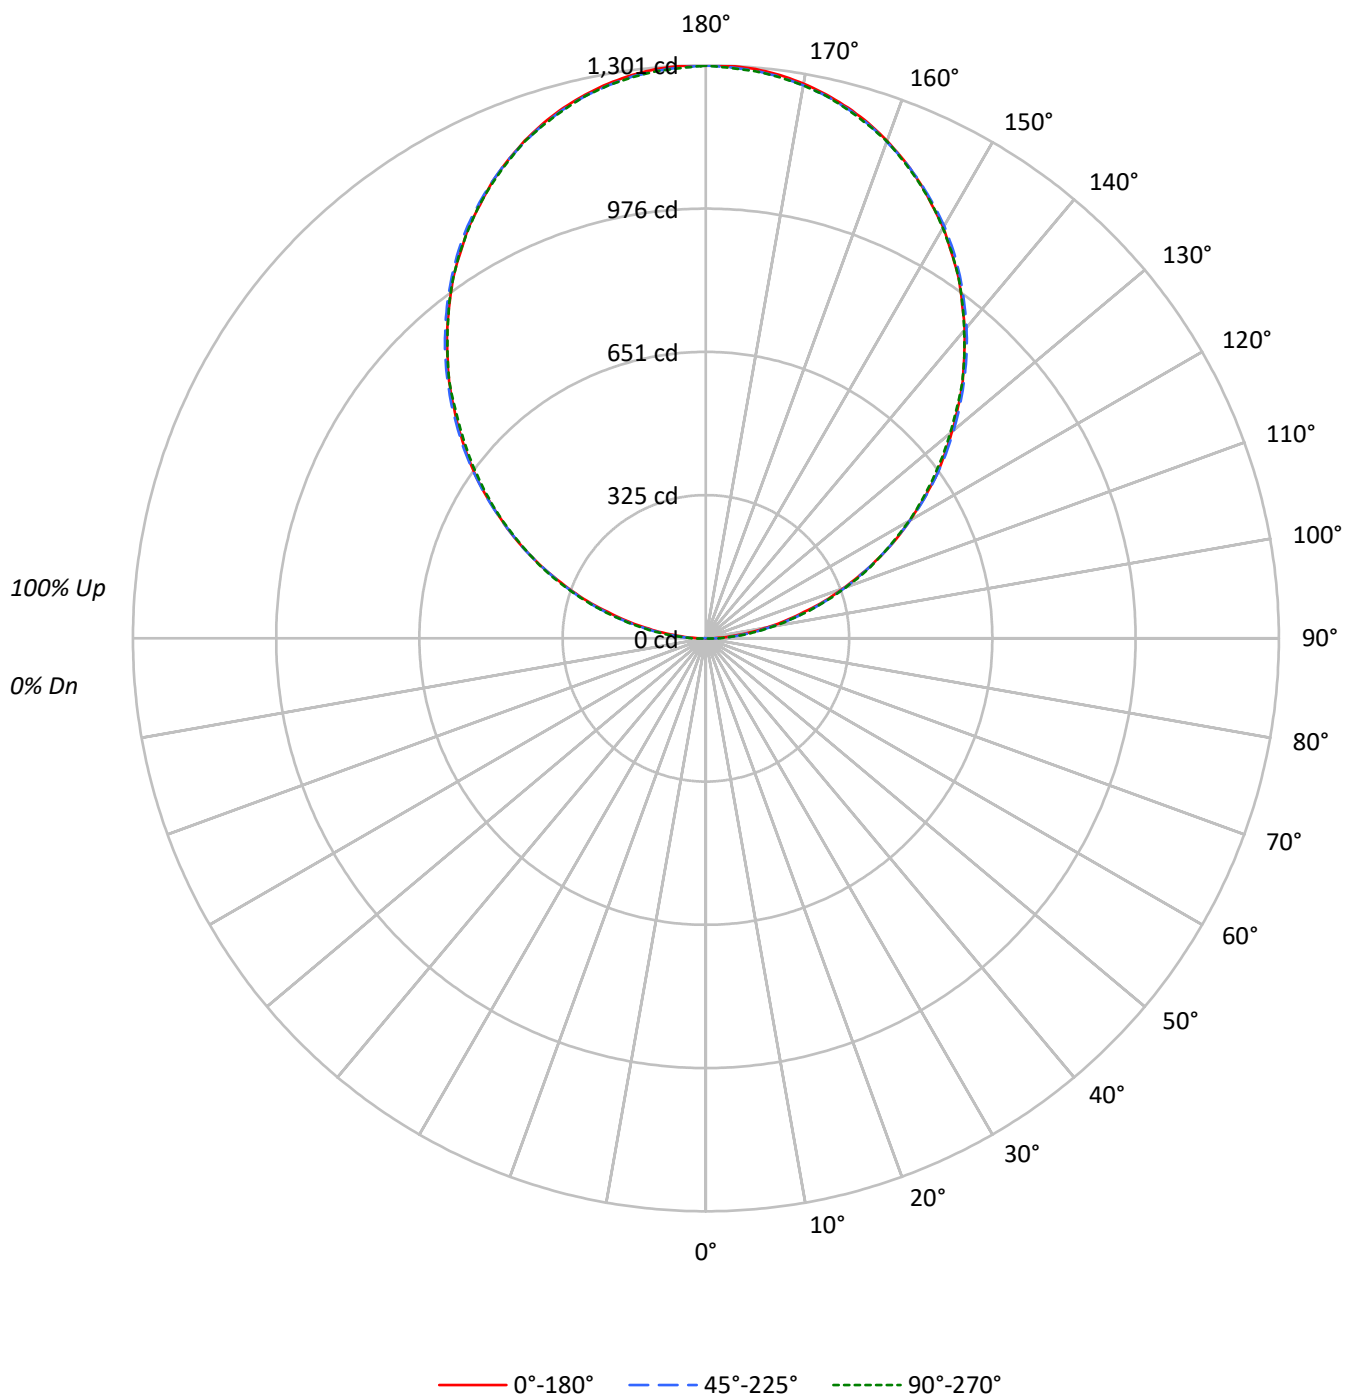



TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	2.7	0.1
90°-100°	83.7	2.3
100°-110°	253.4	7.0
110°-120°	431.3	12.0
120°-130°	567.5	15.7
130°-140°	637.8	17.7
140°-150°	627.1	17.4
150°-160°	527.9	14.6
160°-170°	351.5	9.7
170°-180°	123.1	3.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	2.7	0.1
90°-120°	768.4	21.3
90°-150°	2600.8	72.1
90°-180°	3603.0	99.9
0°-180°	3606.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	1	11	24	29	31	4
95°	60	67	76	80	80	66
105°	230	232	241	241	243	246
115°	434	437	435	436	435	430
125°	635	638	636	632	628	567
135°	824	830	830	825	823	635
145°	1000	1002	1005	1004	1000	625
155°	1145	1145	1146	1150	1143	527
165°	1247	1244	1244	1250	1243	352
175°	1297	1293	1293	1299	1292	123
180°	1300	1300	1300	1300	1300	

TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	1.0	11.2	24.5	28.6	30.6
92.5°	30.6	36.8	42.9	46.0	43.9
95°	60.3	67.4	75.6	79.7	79.7
97.5°	99.1	104.2	110.3	115.4	114.4
100°	138.9	145.1	150.2	153.2	155.3
102.5°	184.9	188.0	195.1	198.2	197.2
105°	229.8	231.9	241.1	241.1	243.1
107.5°	283.0	284.0	288.1	291.1	290.1
110°	332.0	334.0	336.1	340.2	338.1

TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	383.1	384.1	384.1	389.2	389.2
115°	434.2	437.2	435.2	436.2	435.2
117.5°	486.3	487.3	485.2	485.2	482.2
120°	534.3	540.4	535.3	534.3	532.2
122.5°	584.3	588.4	586.4	583.3	580.2
125°	635.4	638.5	636.4	632.3	628.3
127.5°	682.4	688.5	686.5	680.3	676.3
130°	729.4	737.6	734.5	730.4	723.3
132.5°	776.4	784.5	782.5	777.4	772.3
135°	824.4	830.5	829.5	825.4	823.4
137.5°	868.3	873.4	876.5	871.4	868.3
140°	914.3	919.4	920.4	919.4	912.2
142.5°	956.2	961.3	963.3	962.3	957.2
145°	1000.1	1002.1	1005.2	1004.2	1000.1
147.5°	1037.9	1042.0	1045.0	1045.0	1038.9
150°	1077.7	1079.8	1081.8	1081.8	1075.7
152.5°	1110.4	1113.5	1114.5	1116.6	1111.4
155°	1145.2	1145.2	1146.2	1150.3	1143.1
157.5°	1174.8	1173.8	1174.8	1178.9	1172.7
160°	1202.4	1200.3	1200.3	1205.4	1201.3
162.5°	1226.9	1223.8	1224.8	1229.9	1222.8
165°	1247.3	1244.2	1244.2	1250.4	1243.2
167.5°	1264.7	1260.6	1261.6	1267.7	1261.6
170°	1279.0	1274.9	1274.9	1282.0	1274.9
172.5°	1290.2	1286.1	1286.1	1292.3	1285.1
175°	1297.4	1293.3	1293.3	1299.4	1292.3
177.5°	1301.4	1297.4	1297.4	1303.5	1296.3
180°	1300.4	1300.4	1300.4	1300.4	1300.4



TEST NUMBER: P982934

CATALOG NUMBER: S123IW-B1030UB40-4F0-XX-W2A-1

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT