

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P983012

Luminaire Tested: S123IW-B755UB35-4F0-XX-W2A-1

Issue Date: 5/2/2025

Test Information

Test Method: LM-79-2019
Report Number: P983012
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1807-864-9)
Test Lab: INNOVATION CENTER
Issue Date: 5/2/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S123IW-B755UB35-4F0-XX-W2A-1
Description: Define 3 Indirect Wall Mount with 3500K BioUP LEDs {m-DER=0.721} {m-EER=0.792}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2677.0 lumens
Efficiency: N/A
Efficacy: 115.4 lumens/watt
Spacing Criteria (0/90/45): - / - / -
Luminous Opening: Rectangular (W 0.25' x L: 4' x H: 0')
CIE Type: Indirect

Input Watts (W): 23.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

Luminous Intensity Polar Plot

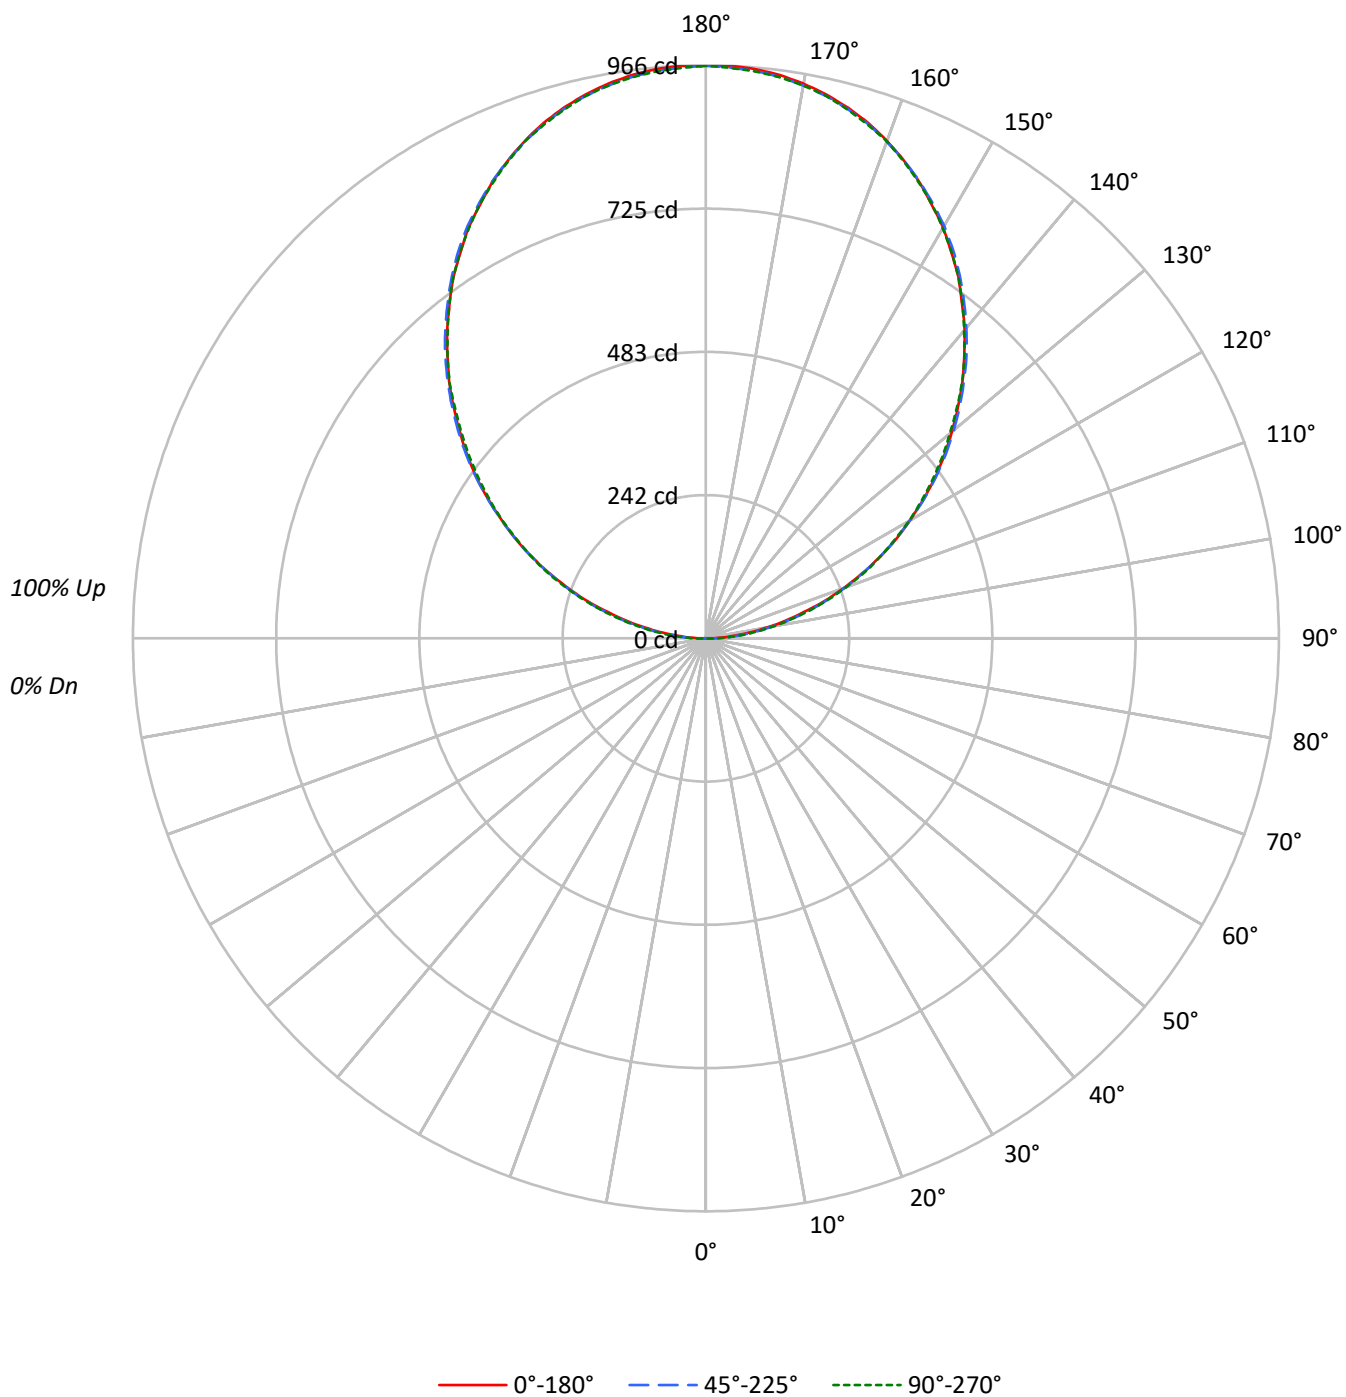

TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	95	95	95	95	81	81	81	81	56	56	56	32	32	32	10	10	10
1	87	83	79	76	74	71	68	65	48	47	45	28	27	26	9	9	8
2	79	72	66	62	67	62	57	53	42	40	37	24	23	22	8	7	7
3	72	63	56	51	61	54	49	44	37	34	31	21	20	18	7	6	6
4	65	56	48	43	56	48	42	37	33	29	26	19	17	16	6	6	5
5	60	49	42	36	51	42	36	32	29	25	22	17	15	13	5	5	4
6	55	44	36	31	47	38	32	27	26	22	19	15	13	11	5	4	4
7	50	39	32	27	43	34	28	23	23	19	17	14	11	10	4	4	3
8	47	35	28	23	40	30	24	20	21	17	14	12	10	9	4	3	3
9	43	32	25	20	37	27	22	18	19	15	13	11	9	8	4	3	3
10	40	29	22	18	34	25	19	16	17	14	11	10	8	7	3	3	2

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	0	0	0
5°	0	0	0
10°	0	0	0
15°	0	0	0
20°	0	0	0
25°	0	0	0
30°	0	0	0
35°	0	0	0
40°	0	0	0
45°	0	0	0
50°	0	0	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 0°
Luminance: 0 cd/sqm

TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	0.0	0.0
10°-20°	0.0	0.0
20°-30°	0.0	0.0
30°-40°	0.0	0.0
40°-50°	0.0	0.0
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	2.0	0.1
90°-100°	62.2	2.3
100°-110°	188.1	7.0
110°-120°	320.2	12.0
120°-130°	421.3	15.7
130°-140°	473.5	17.7
140°-150°	465.5	17.4
150°-160°	391.9	14.6
160°-170°	260.9	9.7
170°-180°	91.4	3.4
0°-30°	0.0	0.0
0°-40°	0.0	0.0
0°-60°	0.0	0.0
0°-90°	2.0	0.1
90°-120°	570.5	21.3
90°-150°	1930.7	72.1
90°-180°	2675.0	99.9
0°-180°	2677.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	0	0	0	0	0	
5°	0	0	0	0	0	0
15°	0	0	0	0	0	0
25°	0	0	0	0	0	0
35°	0	0	0	0	0	0
45°	0	0	0	0	0	0
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	1	8	18	21	23	3
95°	45	50	56	59	59	49
105°	171	172	179	179	180	183
115°	322	325	323	324	323	319
125°	472	474	472	469	466	421
135°	612	617	616	613	611	472
145°	742	744	746	746	742	464
155°	850	850	851	854	849	391
165°	926	924	924	928	923	261
175°	963	960	960	965	959	92
180°	965	965	965	965	965	

TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	0.0	0.0	0.0	0.0	0.0
2.5°	0.0	0.0	0.0	0.0	0.0
5°	0.0	0.0	0.0	0.0	0.0
7.5°	0.0	0.0	0.0	0.0	0.0
10°	0.0	0.0	0.0	0.0	0.0
12.5°	0.0	0.0	0.0	0.0	0.0
15°	0.0	0.0	0.0	0.0	0.0
17.5°	0.0	0.0	0.0	0.0	0.0
20°	0.0	0.0	0.0	0.0	0.0
22.5°	0.0	0.0	0.0	0.0	0.0
25°	0.0	0.0	0.0	0.0	0.0
27.5°	0.0	0.0	0.0	0.0	0.0
30°	0.0	0.0	0.0	0.0	0.0
32.5°	0.0	0.0	0.0	0.0	0.0
35°	0.0	0.0	0.0	0.0	0.0
37.5°	0.0	0.0	0.0	0.0	0.0
40°	0.0	0.0	0.0	0.0	0.0
42.5°	0.0	0.0	0.0	0.0	0.0
45°	0.0	0.0	0.0	0.0	0.0
47.5°	0.0	0.0	0.0	0.0	0.0
50°	0.0	0.0	0.0	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.8	8.3	18.2	21.2	22.8
92.5°	22.8	27.3	31.9	34.1	32.6
95°	44.7	50.1	56.1	59.2	59.2
97.5°	73.6	77.4	81.9	85.7	84.9
100°	103.1	107.7	111.5	113.8	115.3
102.5°	137.3	139.5	144.8	147.1	146.4
105°	170.6	172.1	179.0	179.0	180.5
107.5°	210.1	210.8	213.9	216.1	215.4
110°	246.5	248.0	249.5	252.5	251.0

TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	284.4	285.1	285.1	288.9	288.9
115°	322.3	324.6	323.1	323.8	323.1
117.5°	361.0	361.7	360.2	360.2	358.0
120°	396.6	401.2	397.4	396.6	395.1
122.5°	433.8	436.8	435.3	433.0	430.8
125°	471.7	474.0	472.5	469.4	466.4
127.5°	506.6	511.1	509.6	505.1	502.0
130°	541.5	547.5	545.3	542.2	536.9
132.5°	576.4	582.4	580.9	577.1	573.3
135°	612.0	616.6	615.8	612.8	611.2
137.5°	644.6	648.4	650.7	646.9	644.6
140°	678.7	682.5	683.3	682.5	677.2
142.5°	709.8	713.6	715.1	714.4	710.6
145°	742.4	744.0	746.2	745.5	742.4
147.5°	770.5	773.5	775.8	775.8	771.3
150°	800.1	801.6	803.1	803.1	798.6
152.5°	824.3	826.6	827.4	828.9	825.1
155°	850.1	850.1	850.9	853.9	848.6
157.5°	872.1	871.4	872.1	875.2	870.6
160°	892.6	891.1	891.1	894.9	891.8
162.5°	910.8	908.5	909.3	913.1	907.8
165°	926.0	923.7	923.7	928.2	922.9
167.5°	938.9	935.8	936.6	941.1	936.6
170°	949.5	946.4	946.4	951.8	946.4
172.5°	957.8	954.8	954.8	959.3	954.0
175°	963.1	960.1	960.1	964.6	959.3
177.5°	966.2	963.1	963.1	967.7	962.4
180°	965.4	965.4	965.4	965.4	965.4



TEST NUMBER: P983012

CATALOG NUMBER: S123IW-B755UB35-4F0-XX-W2A-1

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

END OF REPORT