

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P1033972

Luminaire Tested: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

Issue Date: 5/7/2025

Test Information

Test Method: LM-79-2019
Report Number: P1033972
REPORT IS A COMBINATION OF REPORTS P1000156 AND P1007351
Test Lab: INNOVATION CENTER
Issue Date: 5/7/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F
Description: Define 4 Regressed Direct/Indirect Wall Mount with 3500K BioUP LEDs {m-DER=0.721}
{m-EER=0.792}
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11212.0 lumens
Efficiency: N/A
Efficacy: 98.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.09 / 1.24
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 4' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 113.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1033972

CATALOG NUMBER: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

Luminous Intensity Polar Plot

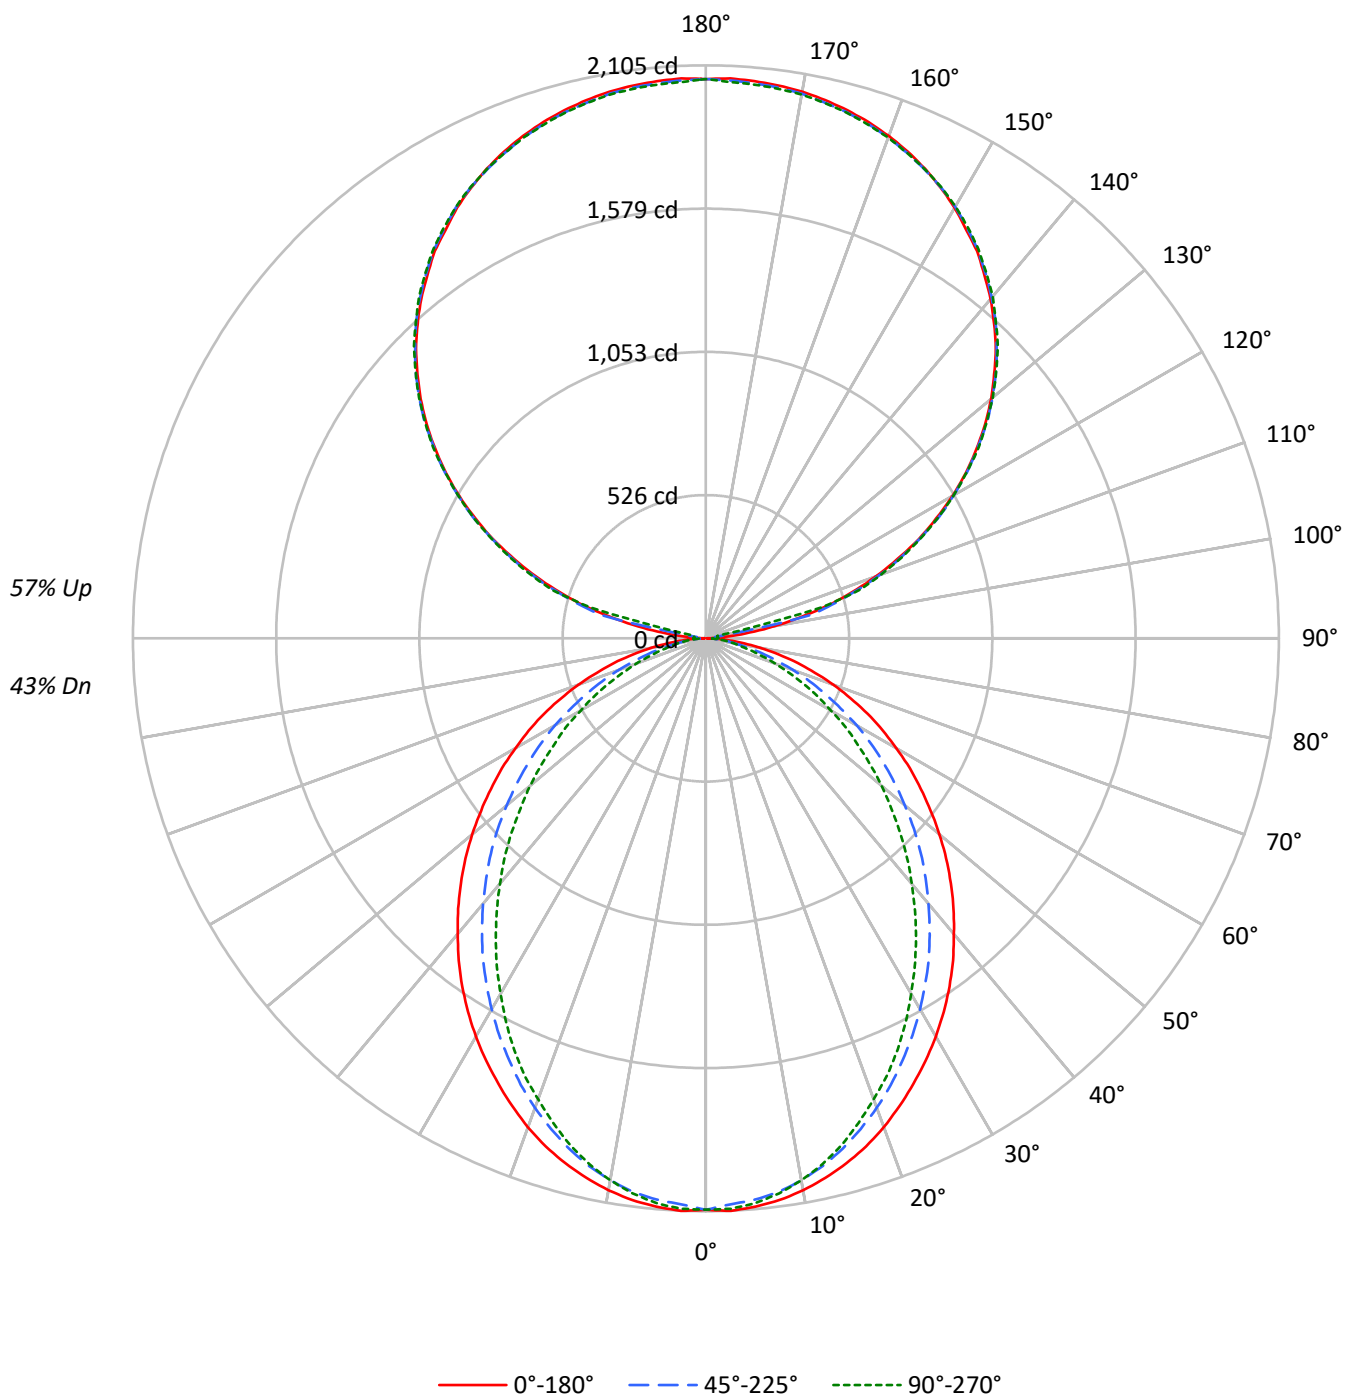

TEST NUMBER: P1033972

CATALOG NUMBER: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	96	96	96	96	80	80	80	64	64	64	50	50	50
1	97	92	89	85	88	85	81	79	70	68	66	57	55	54	45	44	43
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	80	71	64	58	73	65	59	54	55	50	46	44	41	39	35	33	31
4	74	63	55	50	67	58	51	46	49	44	40	40	36	33	32	29	27
5	68	56	48	43	62	52	45	40	44	38	34	36	32	29	28	26	24
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	26	23	21
7	58	46	38	32	53	42	35	30	36	30	26	29	25	22	24	21	19
8	53	41	34	29	49	38	32	27	32	27	23	27	23	20	22	19	17
9	50	38	30	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	17116	17116	17116
5°	17118	16608	16610
10°	16973	16084	15893
15°	16740	15431	15046
20°	16434	14687	14082
25°	16052	13885	13139
30°	15679	13066	12082
35°	15268	12236	11047
40°	14780	11342	9985
45°	14321	10456	8933
50°	13800	9489	7864
55°	13237	8496	6762
60°	12612	7443	5673
65°	12008	6234	4624
70°	11150	4961	3534
75°	10052	3611	2471
80°	8394	2217	1777
85°	6316	1276	977

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 14321 cd/sqm

TEST NUMBER: P1033972

CATALOG NUMBER: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	197.4	1.8
10°-20°	550.3	4.9
20°-30°	794.5	7.1
30°-40°	900.5	8.0
40°-50°	869.4	7.8
50°-60°	722.8	6.4
60°-70°	498.9	4.4
70°-80°	252.1	2.2
80°-90°	68.3	0.6
90°-100°	68.2	0.6
100°-110°	449.2	4.0
110°-120°	857.7	7.6
120°-130°	1088.8	9.7
130°-140°	1164.8	10.4
140°-150°	1089.2	9.7
150°-160°	878.3	7.8
160°-170°	566.4	5.1
170°-180°	195.2	1.7
0°-30°	1542.2	13.8
0°-40°	2442.7	21.8
0°-60°	4035.0	36.0
0°-90°	4854.2	43.3
90°-120°	1375.0	12.3
90°-150°	4717.8	42.1
90°-180°	6358.0	56.7
0°-180°	11212.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2099	2099	2099	2099	2099	
5°	2096	2089	2070	2086	2083	199
15°	1996	1982	1942	1938	1927	563
25°	1805	1776	1710	1683	1667	832
35°	1561	1509	1429	1374	1345	975
45°	1273	1213	1117	1038	1009	982
55°	964	900	796	712	682	863
65°	656	587	484	415	395	648
75°	349	289	214	177	167	368
85°	87	55	50	47	47	95
90°	5	22	34	43	46	9
95°	84	32	34	43	45	104
105°	463	472	480	493	438	484
115°	864	868	867	870	870	850
125°	1214	1220	1217	1222	1223	1084
135°	1506	1504	1511	1514	1517	1160
145°	1736	1741	1741	1743	1746	1085
155°	1904	1906	1901	1907	1902	878
165°	2008	2001	2001	2013	1999	568
175°	2055	2045	2047	2061	2042	196
180°	2055	2055	2055	2055	2055	

TEST NUMBER: P1033972

CATALOG NUMBER: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2099.0	2099.0	2099.0	2099.0	2099.0
2.5°	2105.4	2099.0	2081.3	2099.0	2097.4
5°	2095.8	2089.4	2070.1	2086.2	2082.9
7.5°	2081.3	2074.9	2050.8	2062.1	2057.2
10°	2058.8	2050.8	2021.9	2028.3	2021.9
12.5°	2029.9	2020.3	1984.9	1988.1	1978.5
15°	1996.2	1981.7	1941.5	1938.3	1927.0
17.5°	1957.6	1936.7	1890.1	1882.0	1866.0
20°	1911.0	1890.1	1835.4	1822.6	1801.7
22.5°	1859.5	1835.4	1776.0	1755.1	1739.0
25°	1804.9	1776.0	1710.1	1682.7	1666.7
27.5°	1748.6	1713.3	1644.2	1612.0	1589.5
30°	1689.2	1649.0	1573.5	1533.3	1507.6
32.5°	1626.5	1579.9	1501.1	1452.9	1428.8
35°	1560.6	1509.2	1428.8	1374.2	1345.2
37.5°	1491.5	1438.5	1350.1	1290.6	1261.7
40°	1417.6	1364.5	1272.9	1205.4	1176.5
42.5°	1346.8	1290.6	1194.2	1125.0	1094.5
45°	1272.9	1213.4	1117.0	1038.3	1009.3
47.5°	1197.4	1136.3	1036.7	954.7	922.5
50°	1120.2	1057.5	954.7	874.3	843.8
52.5°	1041.5	980.4	874.3	792.4	760.2
55°	964.3	900.0	795.6	712.0	681.5
57.5°	888.8	821.3	718.4	633.2	610.7
60°	806.8	742.5	639.7	556.1	530.4
62.5°	732.9	665.4	559.3	483.8	464.5
65°	655.7	586.6	483.8	414.7	395.4
67.5°	575.4	509.5	413.1	352.0	329.5
70°	499.8	432.3	340.7	287.7	271.6
72.5°	419.5	360.0	274.8	231.4	217.0
75°	348.8	289.3	213.8	176.8	167.1
77.5°	274.8	223.4	159.1	133.4	130.2
80°	204.1	157.5	109.3	104.5	102.9
82.5°	143.0	101.3	78.8	75.5	73.9
85°	86.8	54.6	49.8	46.6	46.6
87.5°	37.0	24.1	22.5	20.9	22.5
90°	4.6	21.5	33.8	43.0	46.1
92.5°	23.1	20.0	32.3	41.5	41.5
95°	84.5	32.3	33.8	43.0	44.6
97.5°	161.4	195.2	33.8	41.5	43.0
100°	252.0	279.7	67.6	41.5	43.0
102.5°	353.5	371.9	390.3	44.6	44.6
105°	462.6	471.8	479.5	493.3	438.0
107.5°	562.4	567.1	577.8	585.5	591.6
110°	663.9	668.5	677.7	680.8	685.4

TEST NUMBER: P1033972

CATALOG NUMBER: S124RDIW-B1195D1560UB35-4F0-XX-W2A-F

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	762.2	771.4	774.5	773.0	779.1
115°	863.7	868.3	866.7	869.8	869.8
117.5°	954.3	960.5	965.1	963.5	963.5
120°	1046.5	1052.7	1051.1	1054.2	1051.1
122.5°	1132.6	1135.7	1138.7	1140.3	1137.2
125°	1214.0	1220.2	1217.1	1221.7	1223.3
127.5°	1292.4	1293.9	1301.6	1300.1	1298.6
130°	1367.7	1369.2	1373.9	1375.4	1375.4
132.5°	1436.9	1439.9	1446.1	1447.6	1446.1
135°	1506.0	1504.5	1510.6	1513.7	1516.8
137.5°	1567.5	1567.5	1575.2	1578.2	1576.7
140°	1627.4	1630.5	1633.6	1638.2	1639.7
142.5°	1681.2	1687.3	1688.9	1692.0	1692.0
145°	1736.5	1741.1	1741.1	1742.7	1745.7
147.5°	1779.6	1788.8	1787.2	1788.8	1790.3
150°	1827.2	1833.3	1831.8	1831.8	1833.3
152.5°	1867.1	1871.8	1868.7	1871.8	1870.2
155°	1904.0	1905.6	1901.0	1907.1	1902.5
157.5°	1936.3	1936.3	1930.2	1937.8	1930.2
160°	1964.0	1959.4	1957.8	1967.0	1957.8
162.5°	1988.6	1982.4	1980.9	1990.1	1979.3
165°	2008.5	2000.8	2000.8	2013.1	1999.3
167.5°	2025.4	2017.8	2016.2	2030.0	2014.7
170°	2039.3	2030.0	2031.6	2043.9	2028.5
172.5°	2048.5	2039.3	2040.8	2053.1	2036.2
175°	2054.6	2045.4	2046.9	2060.8	2042.3
177.5°	2059.2	2048.5	2051.6	2063.9	2045.4
180°	2054.6	2054.6	2054.6	2054.6	2054.6

(END OF REPORT)