

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223062

Luminaire Tested: **LSSQWM2B20NFL258050D010 2LBDC\*MMS**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P223062  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B20NFL258050D010 2LBDC\*MMS  
Description: 2000 Lumen, 2inch Portfolio LED Cylinder  
NARROW FLOOD OPTIC  
CAST ROUND TRIM WITH MATTE METALLIC SILVER  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1921.1 lumens  
Efficiency: N/A  
Efficacy: 91.9 lumens/watt  
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 20.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P223062

CATALOG NUMBER: LSSQWM2B20NFL258050D010 2LBDC\*MMS

### Luminous Intensity Polar Plot

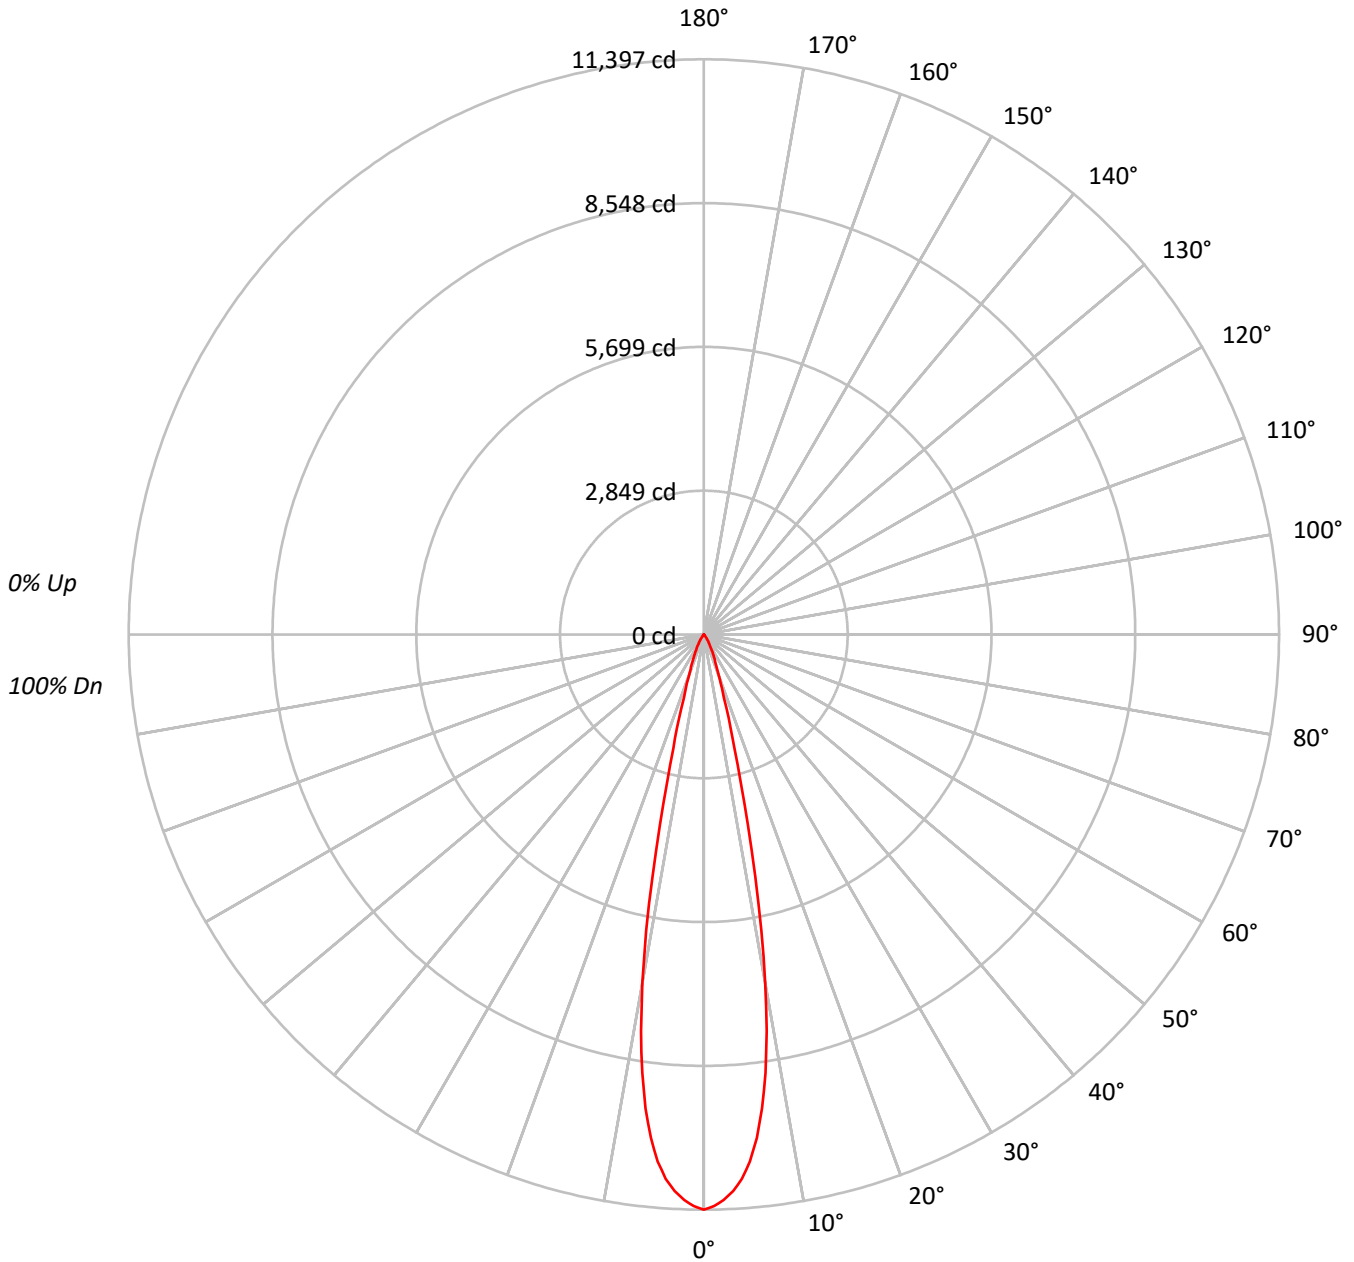



TEST NUMBER: P223062

CATALOG NUMBER: LSSQWM2B20NFL258050D010 2LBDC\*MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	4414660
5°	4076136
10°	2759032
15°	938644
20°	344768
25°	182794
30°	93926
35°	43834
40°	14360
45°	7231
50°	3435
55°	1283
60°	1472
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223062

CATALOG NUMBER: LSSQWM2B20NFL258050D010 2LBDC\*MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	891.7	46.4
10°-20°	749.8	39.0
20°-30°	205.8	10.7
30°-40°	60.0	3.1
40°-50°	11.1	0.6
50°-60°	2.5	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1847.3	96.2
0°-40°	1907.3	99.3
0°-60°	1920.9	100.0
0°-90°	1921.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1921.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	11397	
5°	10483	892
15°	2341	750
25°	428	206
35°	93	60
45°	13	11
55°	2	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223062

CATALOG NUMBER: LSSQWM2B20NFL258050D010 2LBDC\*MMS

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	11397.2
1°	11330.9
2°	11213.6
3°	11045.2
4°	10814.3
5°	10483.2
6°	10030.9
7°	9465.2
8°	8774.5
9°	7958.9
10°	7014.7
11°	5979.6
12°	4902.9
13°	3875.4
14°	2999.3
15°	2340.7
17.5°	1320.8
20°	836.4
22.5°	596.1
25°	427.7
27.5°	302.8
30°	210.0
32.5°	147.6
35°	92.7
37.5°	37.8
40°	28.4
42.5°	20.8
45°	13.2
47.5°	7.6
50°	5.7
52.5°	3.8
55°	1.9
57.5°	1.9
60°	1.9
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223062

CATALOG NUMBER: LSSQWM2B20NFL258050D010 2LBDC\*MMS

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)