

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQ2B05WFL559024D010 2LBDLC\*MMS**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14811)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQ2B05WFL559024D010 2LBDLC\*MMS  
Description: 500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
LENSED CAST ROUND TRIM WITH MATTE METALLIC SILVER  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 467.9 lumens  
Efficiency: N/A  
Efficacy: 64.1 lumens/watt  
Spacing Criteria (0/90/45): 0.79 / 0.79 / 0.83  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B05WFL559024D010 2LBDLC\*MMS

### Luminous Intensity Polar Plot

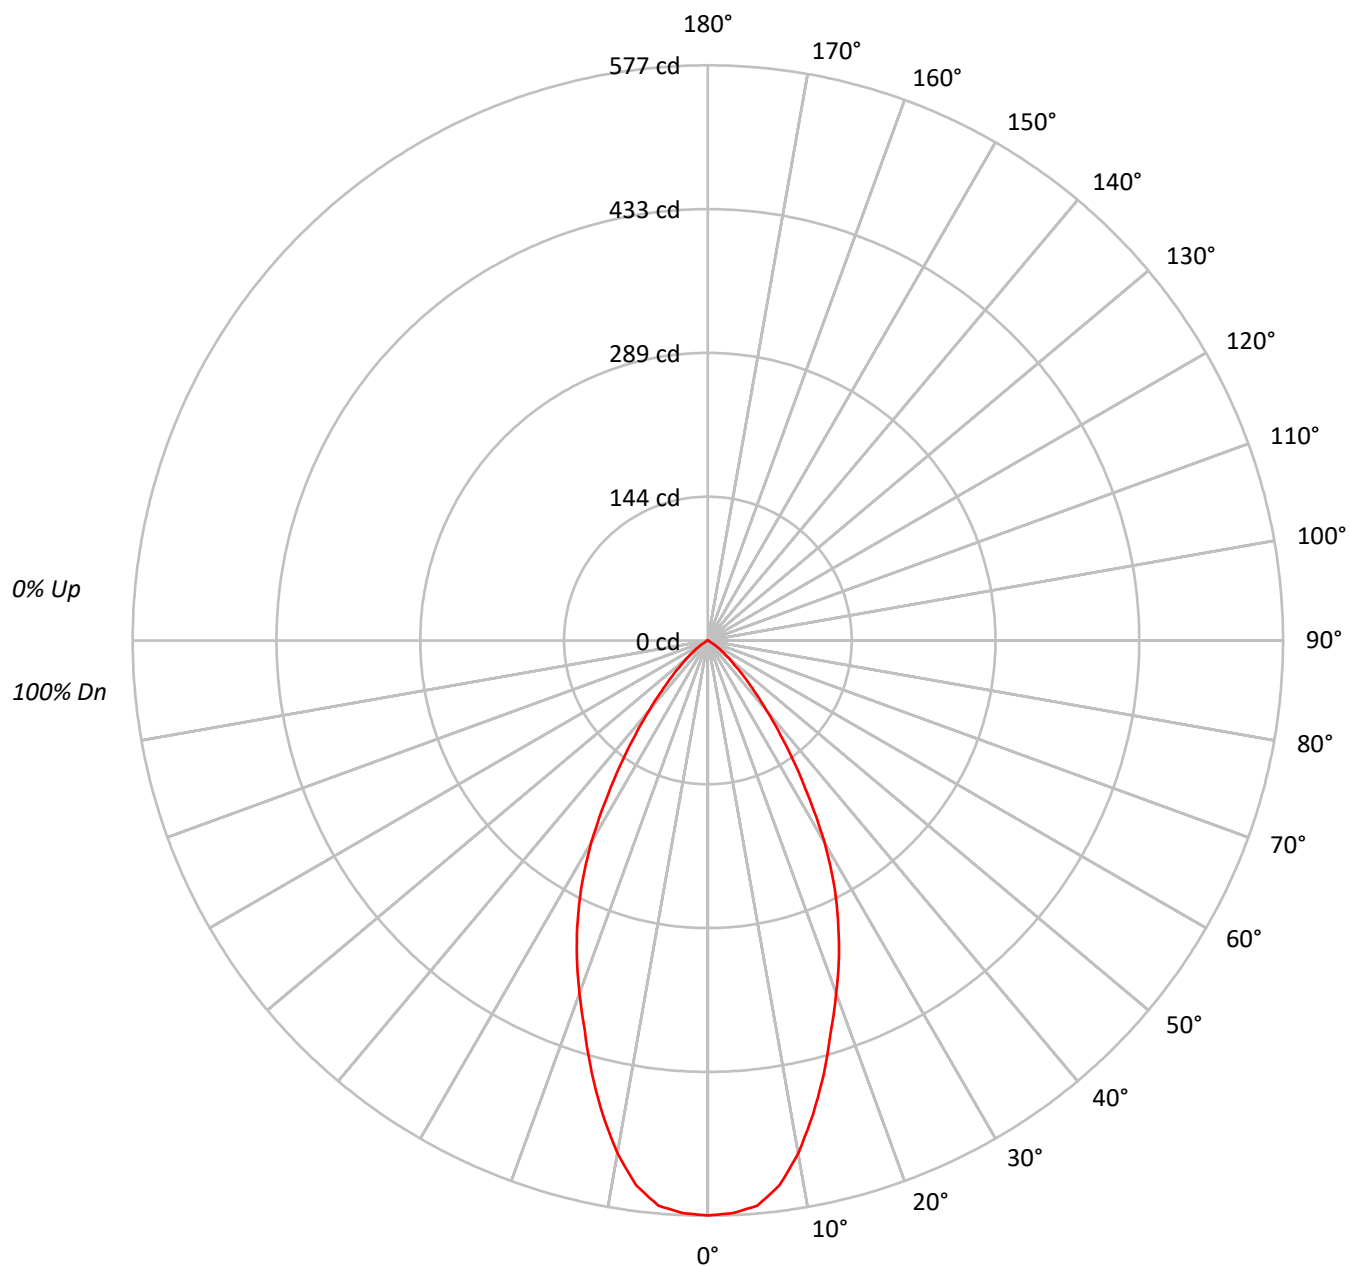



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B05WFL559024D010 2LBDLC\*MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |  |     |     |     |     |  |     |     |     |  |  |     |     |     |  |  |     |
|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|--|-----|-----|-----|--|--|-----|-----|-----|--|--|-----|
| RF  | 20  |     |     |     |  | 20  |     |     |     |  | 20  |     |     |  |  | 20  |     |     |  |  | 20  |
| RC  | 80  |     |     |     |  | 70  |     |     |     |  | 50  |     |     |  |  | 30  |     |     |  |  | 10  |
| RW  | 70  | 50  | 30  | 10  |  | 70  | 50  | 30  | 10  |  | 50  | 30  | 10  |  |  | 50  | 30  | 10  |  |  | 50  |
| RCR |     |     |     |     |  |     |     |     |     |  |     |     |     |  |  |     |     |     |  |  |     |
| 0   | 119 | 119 | 119 | 119 |  | 116 | 116 | 116 | 116 |  | 111 | 111 | 111 |  |  | 106 | 106 | 106 |  |  | 102 |
| 1   | 113 | 111 | 108 | 106 |  | 111 | 108 | 106 | 104 |  | 104 | 103 | 101 |  |  | 101 | 99  | 98  |  |  | 97  |
| 2   | 108 | 103 | 99  | 95  |  | 106 | 101 | 97  | 94  |  | 98  | 95  | 92  |  |  | 95  | 92  | 90  |  |  | 92  |
| 3   | 102 | 96  | 91  | 87  |  | 100 | 94  | 90  | 86  |  | 92  | 88  | 84  |  |  | 89  | 86  | 83  |  |  | 87  |
| 4   | 97  | 89  | 84  | 79  |  | 95  | 88  | 83  | 79  |  | 86  | 81  | 78  |  |  | 84  | 80  | 77  |  |  | 82  |
| 5   | 92  | 83  | 77  | 73  |  | 90  | 82  | 77  | 73  |  | 81  | 76  | 72  |  |  | 79  | 75  | 71  |  |  | 77  |
| 6   | 87  | 78  | 72  | 68  |  | 86  | 77  | 72  | 67  |  | 76  | 71  | 67  |  |  | 74  | 70  | 66  |  |  | 73  |
| 7   | 83  | 73  | 67  | 63  |  | 81  | 73  | 67  | 63  |  | 71  | 66  | 62  |  |  | 70  | 65  | 62  |  |  | 69  |
| 8   | 79  | 69  | 63  | 59  |  | 77  | 68  | 63  | 59  |  | 67  | 62  | 58  |  |  | 66  | 62  | 58  |  |  | 65  |
| 9   | 75  | 65  | 59  | 55  |  | 74  | 65  | 59  | 55  |  | 64  | 58  | 55  |  |  | 63  | 58  | 55  |  |  | 62  |
| 10  | 71  | 62  | 56  | 52  |  | 70  | 61  | 55  | 52  |  | 60  | 55  | 51  |  |  | 59  | 55  | 51  |  |  | 59  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 223421 |
| 5°  | 221281 |
| 10° | 205392 |
| 15° | 180294 |
| 20° | 155154 |
| 25° | 132063 |
| 30° | 104571 |
| 35° | 72584  |
| 40° | 46115  |
| 45° | 27773  |
| 50° | 15848  |
| 55° | 8644   |
| 60° | 1007   |
| 65° | 0      |
| 70° | 0      |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B05WFL559024D010 2LBDLC\*MMS

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 52.8   | 11.3      |
| 10°-20°   | 125.2  | 26.7      |
| 20°-30°   | 140.5  | 30.0      |
| 30°-40°   | 96.8   | 20.7      |
| 40°-50°   | 40.9   | 8.7       |
| 50°-60°   | 11.5   | 2.5       |
| 60°-70°   | 0.3    | 0.1       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 318.4  | 68.0      |
| 0°-40°    | 415.2  | 88.7      |
| 0°-60°    | 467.6  | 99.9      |
| 0°-90°    | 467.9  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 467.9  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 577 |      |
| 5°  | 569 | 53   |
| 15° | 450 | 125  |
| 25° | 309 | 140  |
| 35° | 154 | 97   |
| 45° | 51  | 41   |
| 55° | 13  | 12   |
| 65° | 0   | 0    |
| 75° | 0   | 0    |
| 85° | 0   | 0    |
| 90° | 0   |      |



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B05WFL559024D010 2LBDLC\*MMS

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 576.8 |
| 2.5°  | 574.9 |
| 5°    | 569.1 |
| 7.5°  | 551.1 |
| 10°   | 522.2 |
| 12.5° | 486.9 |
| 15°   | 449.6 |
| 17.5° | 410.5 |
| 20°   | 376.4 |
| 22.5° | 343.6 |
| 25°   | 309.0 |
| 27.5° | 273.0 |
| 30°   | 233.8 |
| 32.5° | 191.4 |
| 35°   | 153.5 |
| 37.5° | 120.1 |
| 40°   | 91.2  |
| 42.5° | 68.7  |
| 45°   | 50.7  |
| 47.5° | 36.6  |
| 50°   | 26.3  |
| 52.5° | 19.3  |
| 55°   | 12.8  |
| 57.5° | 6.4   |
| 60°   | 1.3   |
| 62.5° | 0.6   |
| 65°   | 0.0   |
| 67.5° | 0.0   |
| 70°   | 0.0   |
| 72.5° | 0.0   |
| 75°   | 0.0   |
| 77.5° | 0.0   |
| 80°   | 0.0   |
| 82.5° | 0.0   |
| 85°   | 0.0   |
| 87.5° | 0.0   |
| 90°   | 0.0   |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)