

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264222

Luminaire Tested: **LD2B20D010 EU2B2010SP159024 2LBSQC\*MW**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P264222  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)  
Test Lab: INNOVATION CENTER(G2)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW  
Description: 2000 Lumen, 2inch Portfolio LED Downlight  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1137.0 lumens  
Efficiency: N/A  
Efficacy: 54.4 lumens/watt  
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 20.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P264222

CATALOG NUMBER: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW

### Luminous Intensity Polar Plot

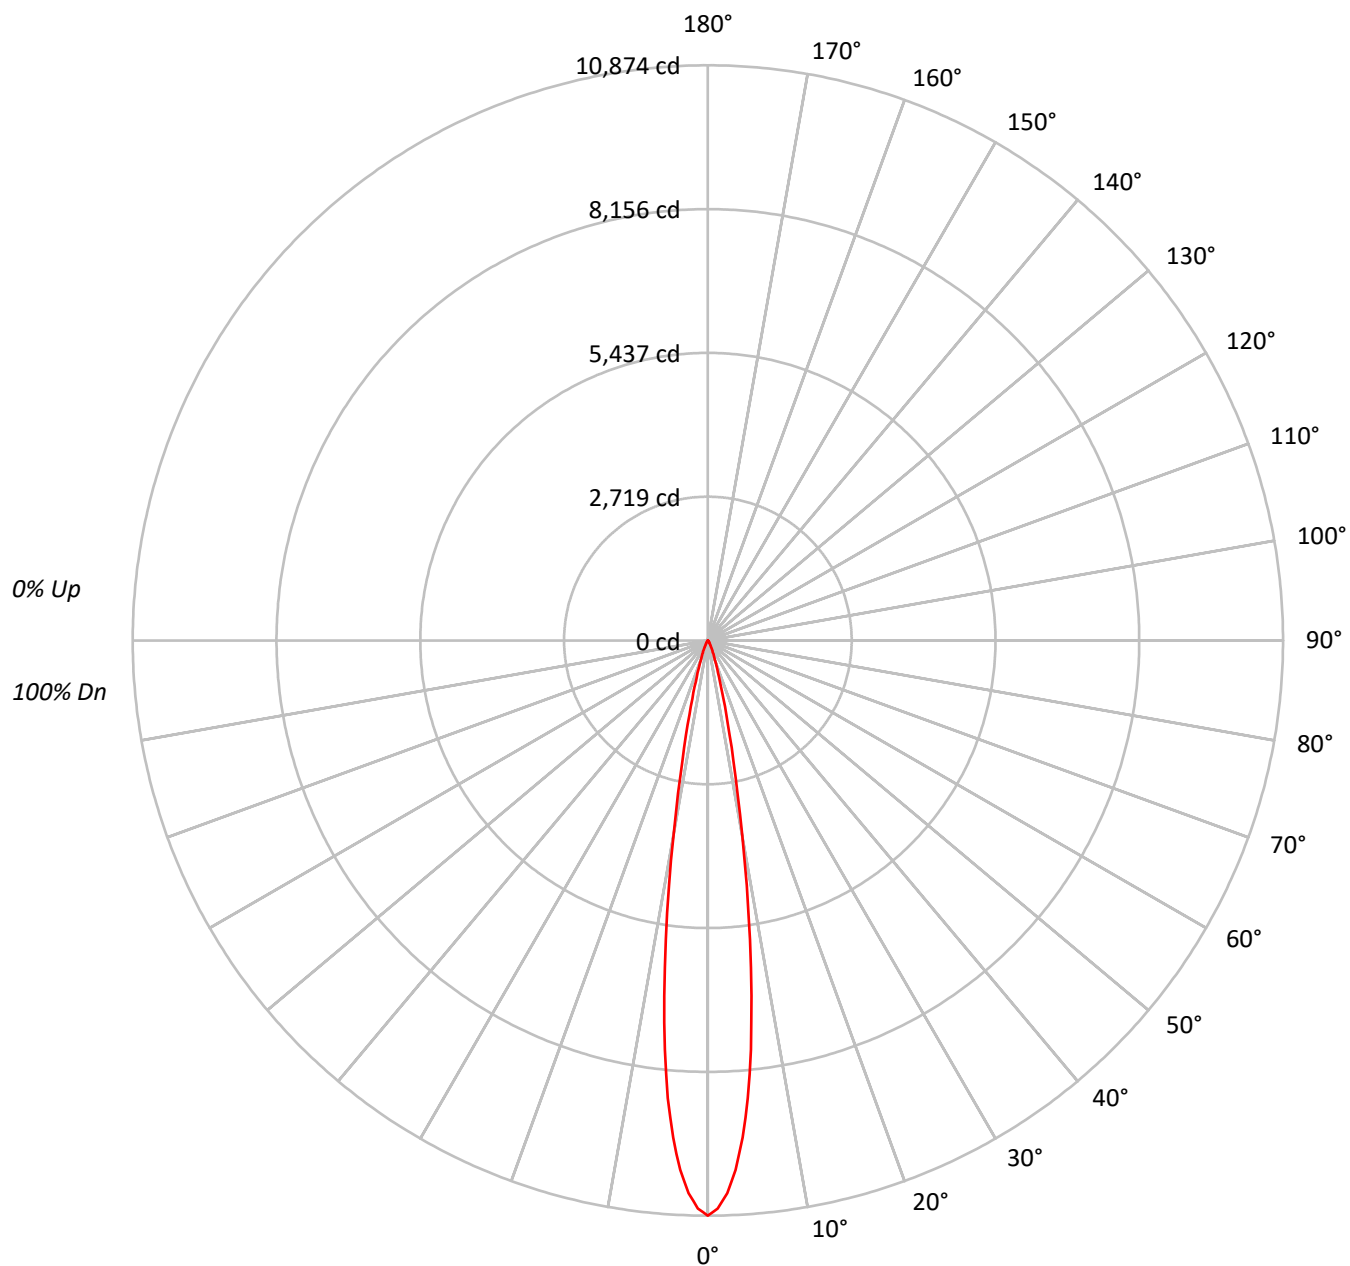



TEST NUMBER: P264222

CATALOG NUMBER: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |  |     |     |     |     |  |     |     |     |  |  |     |     |     |  |  |     |
|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|--|-----|-----|-----|--|--|-----|-----|-----|--|--|-----|
| RF  | 20  |     |     |     |  | 20  |     |     |     |  | 20  |     |     |  |  | 20  |     |     |  |  | 20  |
| RC  | 80  |     |     |     |  | 70  |     |     |     |  | 50  |     |     |  |  | 30  |     |     |  |  | 10  |
| RW  | 70  | 50  | 30  | 10  |  | 70  | 50  | 30  | 10  |  | 50  | 30  | 10  |  |  | 50  | 30  | 10  |  |  | 0   |
| RCR |     |     |     |     |  |     |     |     |     |  |     |     |     |  |  |     |     |     |  |  |     |
| 0   | 119 | 119 | 119 | 119 |  | 116 | 116 | 116 | 116 |  | 111 | 111 | 111 |  |  | 106 | 106 | 106 |  |  | 100 |
| 1   | 116 | 114 | 112 | 111 |  | 113 | 112 | 110 | 109 |  | 108 | 107 | 106 |  |  | 104 | 103 | 102 |  |  | 98  |
| 2   | 113 | 109 | 107 | 105 |  | 111 | 108 | 106 | 104 |  | 105 | 103 | 101 |  |  | 102 | 101 | 99  |  |  | 96  |
| 3   | 110 | 106 | 103 | 100 |  | 108 | 105 | 102 | 100 |  | 102 | 100 | 98  |  |  | 100 | 98  | 97  |  |  | 94  |
| 4   | 107 | 103 | 99  | 97  |  | 106 | 102 | 99  | 96  |  | 100 | 97  | 95  |  |  | 98  | 96  | 94  |  |  | 92  |
| 5   | 105 | 100 | 97  | 94  |  | 104 | 99  | 96  | 94  |  | 98  | 95  | 93  |  |  | 96  | 94  | 92  |  |  | 90  |
| 6   | 103 | 98  | 94  | 92  |  | 102 | 97  | 94  | 91  |  | 96  | 93  | 91  |  |  | 95  | 92  | 90  |  |  | 89  |
| 7   | 101 | 95  | 92  | 90  |  | 100 | 95  | 92  | 89  |  | 94  | 91  | 89  |  |  | 93  | 90  | 89  |  |  | 87  |
| 8   | 99  | 93  | 90  | 88  |  | 98  | 93  | 90  | 88  |  | 92  | 89  | 87  |  |  | 91  | 89  | 87  |  |  | 86  |
| 9   | 97  | 92  | 88  | 86  |  | 96  | 91  | 88  | 86  |  | 91  | 88  | 86  |  |  | 90  | 87  | 86  |  |  | 85  |
| 10  | 95  | 90  | 87  | 85  |  | 95  | 90  | 87  | 85  |  | 89  | 86  | 85  |  |  | 89  | 86  | 84  |  |  | 83  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 5365063 |
| 5°  | 4300373 |
| 10° | 1876944 |
| 15° | 581660  |
| 20° | 202765  |
| 25° | 89548   |
| 30° | 40562   |
| 35° | 21080   |
| 40° | 12044   |
| 45° | 5721    |
| 50° | 3607    |
| 55° | 1978    |
| 60° | 1184    |
| 65° | 1401    |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |



TEST NUMBER: P264222

CATALOG NUMBER: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 659.4  | 58.0      |
| 10°-20°   | 361.1  | 31.8      |
| 20°-30°   | 82.3   | 7.2       |
| 30°-40°   | 23.7   | 2.1       |
| 40°-50°   | 7.3    | 0.6       |
| 50°-60°   | 2.2    | 0.2       |
| 60°-70°   | 1.0    | 0.1       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1102.8 | 97.0      |
| 0°-40°    | 1126.5 | 99.1      |
| 0°-60°    | 1136.0 | 99.9      |
| 0°-90°    | 1137.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1137.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 10874 |      |
| 5°  | 8683  | 659  |
| 15° | 1139  | 361  |
| 25° | 164   | 82   |
| 35° | 35    | 24   |
| 45° | 8     | 7    |
| 55° | 2     | 2    |
| 65° | 1     | 1    |
| 75° | 0     | 0    |
| 85° | 0     | 0    |
| 90° | 0     |      |



TEST NUMBER: P264222

CATALOG NUMBER: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW

**CANDELA DISTRIBUTION (FULL):**

|       | 0°      |
|-------|---------|
| 0°    | 10874.5 |
| 1°    | 10739.1 |
| 2°    | 10457.9 |
| 3°    | 10021.6 |
| 4°    | 9421.8  |
| 5°    | 8683.3  |
| 6°    | 7777.8  |
| 7°    | 6766.2  |
| 8°    | 5710.3  |
| 9°    | 4688.2  |
| 10°   | 3746.6  |
| 11°   | 2949.6  |
| 12°   | 2321.9  |
| 13°   | 1827.2  |
| 14°   | 1443.3  |
| 15°   | 1138.8  |
| 16°   | 898.4   |
| 17°   | 715.2   |
| 18°   | 575.2   |
| 19°   | 467.9   |
| 20°   | 386.2   |
| 22.5° | 249.7   |
| 25°   | 164.5   |
| 26°   | 138.8   |
| 27°   | 117.8   |
| 28°   | 99.2    |
| 29°   | 82.8    |
| 30°   | 71.2    |
| 32.5° | 49.0    |
| 35°   | 35.0    |
| 37.5° | 25.7    |
| 40°   | 18.7    |
| 42.5° | 12.8    |
| 45°   | 8.2     |
| 47.5° | 5.8     |
| 50°   | 4.7     |
| 52.5° | 3.5     |
| 55°   | 2.3     |
| 57.5° | 1.2     |
| 60°   | 1.2     |
| 62.5° | 1.2     |
| 65°   | 1.2     |
| 67.5° | 1.2     |



TEST NUMBER: P264222

CATALOG NUMBER: LD2B20D010 EU2B2010SP159024 2LBSQC\*MW

CANDELA DISTRIBUTION (continued):

|       | 0°  |
|-------|-----|
| 75°   | 0.0 |
| 77.5° | 0.0 |
| 80°   | 0.0 |
| 82.5° | 0.0 |
| 85°   | 0.0 |
| 87.5° | 0.0 |
| 90°   | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







|       |     |
|-------|-----|
| 70°   | 0.0 |
| 72.5° | 0.0 |



(END OF REPORT)