

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1307099

Luminaire Tested: LDSQA3D13R129024DE010 3LSQPHRLP1MW

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1307099
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LDSQA3D13R129024DE010 3LSQPHRLP1MW
Description: 3in Adjustable LED luminaire with, R12 optic, 2400K CCT AND, 90CRI , 3LSQPHRLP1MW TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 974.0 lumens
Efficiency: N/A
Efficacy: 62.8 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.22
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 15.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1307099

CATALOG NUMBER: LDSQA3D13R129024DE010 3LSQPHRLP1MW

Luminous Intensity Polar Plot

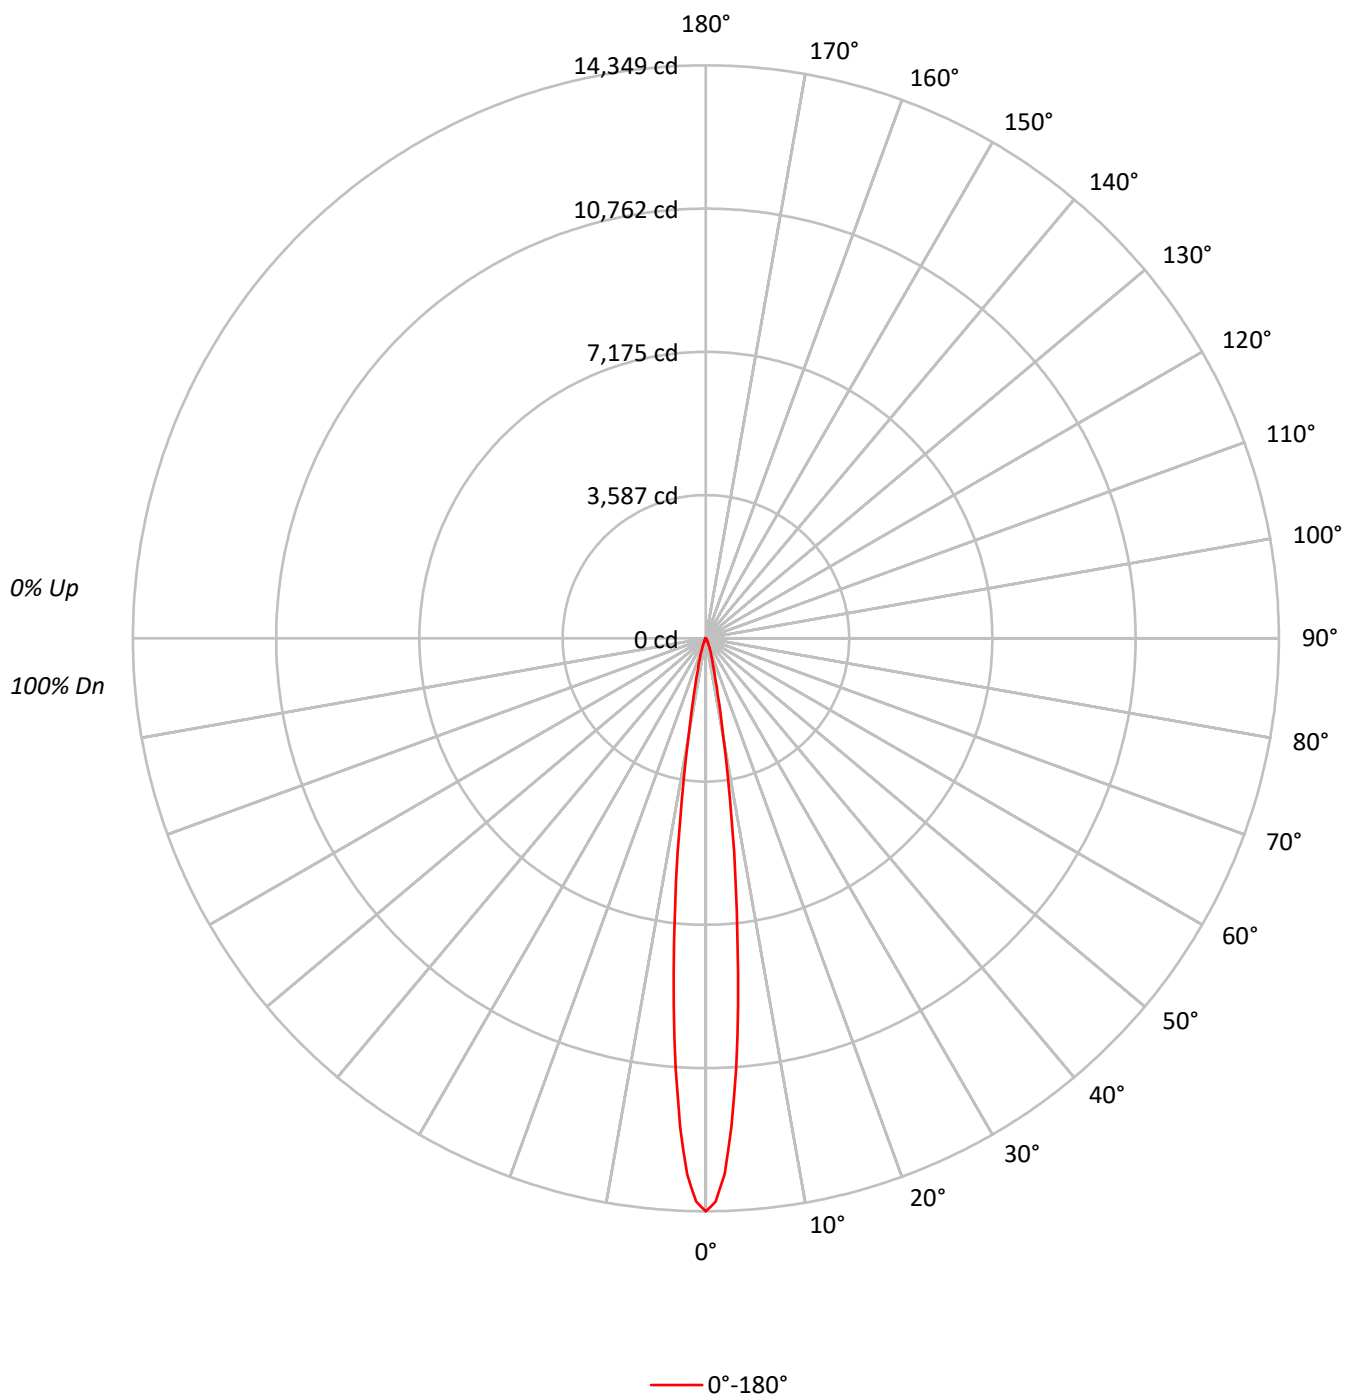

TEST NUMBER: P1307099

CATALOG NUMBER: LDSQA3D13R129024DE010 3LSQPHRLP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98	98	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97	97	97
3	110	107	104	102	109	105	103	101	103	101	99	101	99	98	99	98	96	95	95	95
4	108	104	101	98	107	103	100	98	101	99	97	99	97	96	98	96	95	94	94	94
5	106	102	98	96	105	101	98	96	99	97	95	98	96	94	97	95	93	92	92	92
6	104	99	96	94	103	99	96	94	98	95	93	96	94	93	95	93	92	91	91	91
7	102	98	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	90	90	90
8	101	96	93	91	100	95	93	90	95	92	90	94	92	90	93	91	90	89	89	89
9	99	94	91	89	98	94	91	89	93	91	89	93	90	89	92	90	88	88	88	88
10	98	93	90	88	97	93	90	88	92	90	88	91	89	88	91	89	87	87	87	87

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2471274
5°	1596759
10°	450524
15°	127376
20°	53260
25°	23582
30°	12031
35°	6370
40°	2720
45°	731
50°	804
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 50°

Luminance: 804 cd/sqm

TEST NUMBER: P1307099

CATALOG NUMBER: LDSQA3D13R129024DE010 3LSQPHRLP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	650.8	66.8
10°-20°	236.1	24.2
20°-30°	63.2	6.5
30°-40°	19.9	2.0
40°-50°	3.7	0.4
50°-60°	0.3	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	950.1	97.5
0°-40°	970.0	99.6
0°-60°	974.0	100.0
0°-90°	974.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	974.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14349	
5°	9236	651
15°	714	236
25°	124	63
35°	30	20
45°	3	4
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P1307099

CATALOG NUMBER: LDSQA3D13R129024DE010 3LSQPHRLP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	14349.3
1°	14107.2
2°	13426.0
3°	12260.5
4°	10813.5
5°	9236.2
6°	7592.4
7°	6121.2
8°	4710.5
9°	3505.6
10°	2576.2
11°	1898.1
12°	1428.9
13°	1108.0
14°	877.9
15°	714.4
17.5°	454.1
20°	290.6
22.5°	187.7
25°	124.1
27.5°	84.8
30°	60.5
32.5°	42.4
35°	30.3
37.5°	21.2
40°	12.1
42.5°	6.1
45°	3.0
47.5°	3.0
50°	3.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1307099

CATALOG NUMBER: LDSQA3D13R129024DE010 3LSQPHRLP1MW

CANDELA DISTRIBUTION (continued):



(END OF REPORT)