

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1306991

Luminaire Tested: LDSQA3D09R309024DE010 3LSQPHR1MW

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1306991
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2510-583-4)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LDSQA3D09R309024DE010 3LSQPHR1MW
Description: 3in Adjustable LED luminaire with, R30 optic, 2400K CCT AND, 90CRI , 3LSQPHR1MW TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 749.0 lumens
Efficiency: N/A
Efficacy: 67.5 lumens/watt
Spacing Criteria (0/90/45): 0.5 / 0.49 / 0.46
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 11.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1306991
CATALOG NUMBER: LDSQA3D09R309024DE010 3LSQPHR1MW

Luminous Intensity Polar Plot

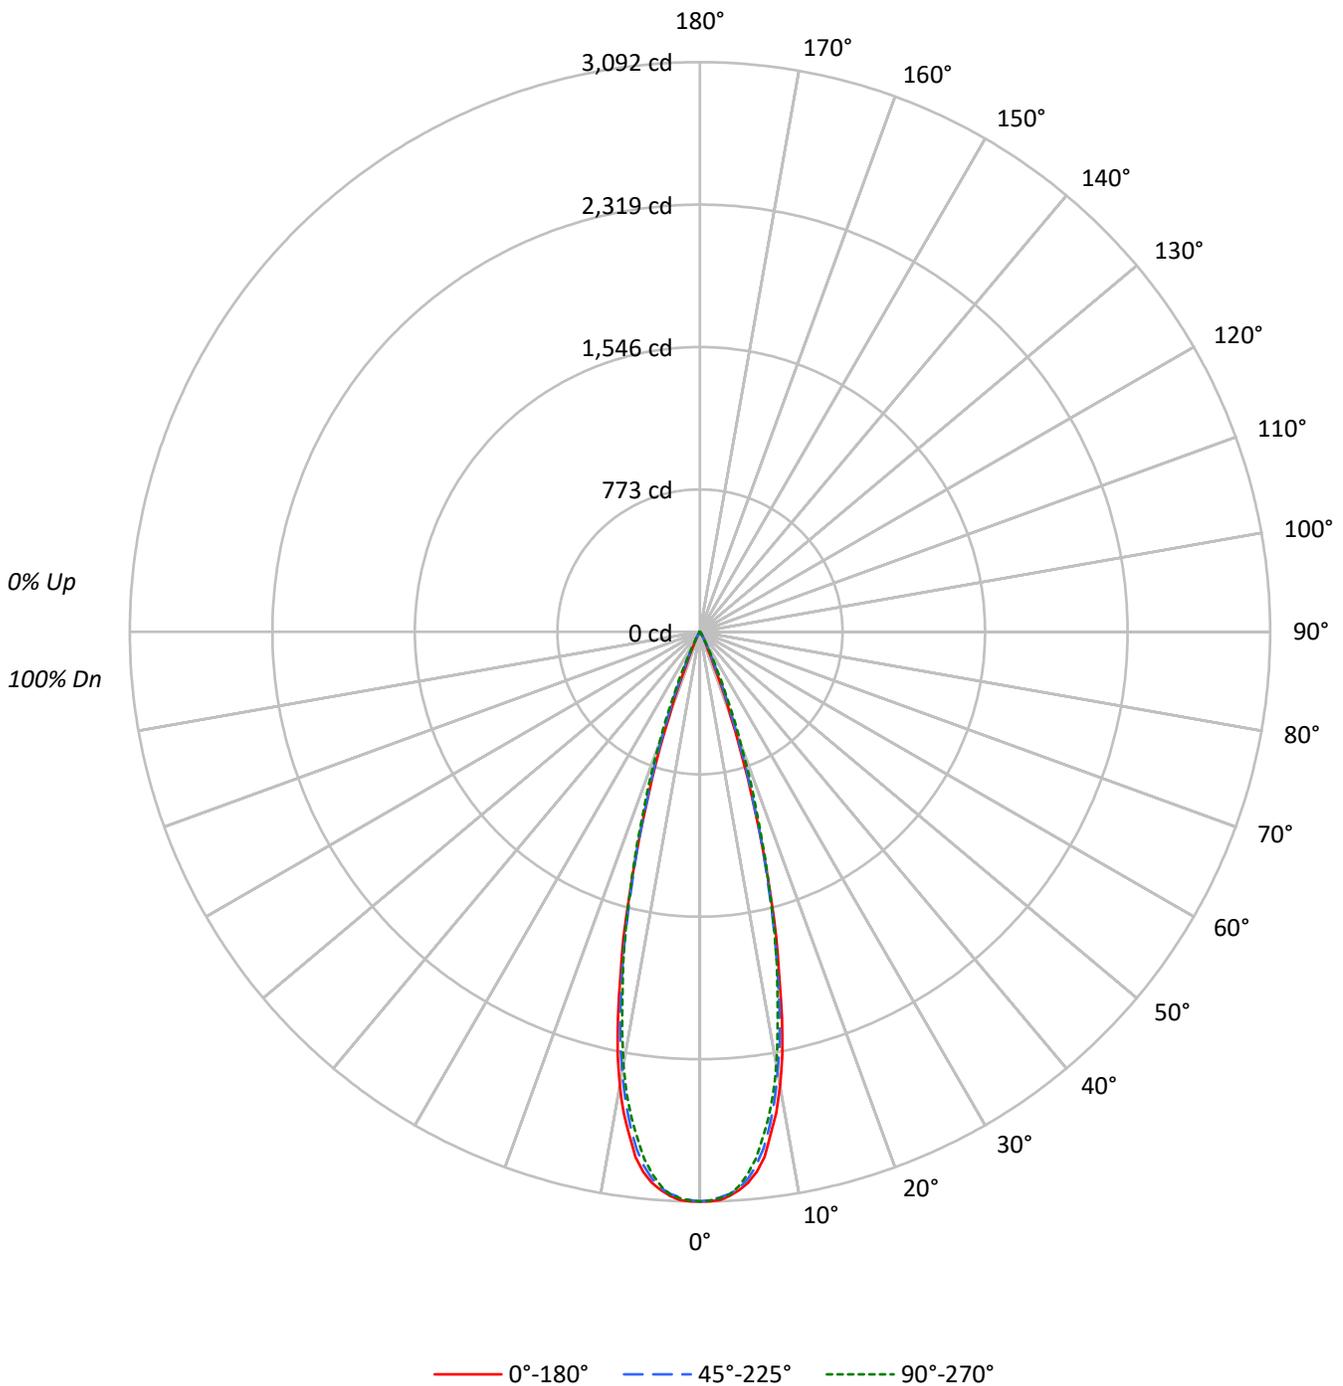



TEST NUMBER: P1306991

CATALOG NUMBER: LDSQA3D09R309024DE010 3LSQPHR1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	267.3	35.7
10°-20°	390.6	52.2
20°-30°	82.7	11.0
30°-40°	7.6	1.0
40°-50°	0.7	0.1
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	740.6	98.9
0°-40°	748.2	99.9
0°-60°	749.0	100.0
0°-90°	749.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	749.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3091	3091	3091	3091	3091	
5°	3000	2994	2979	2970	2955	271
15°	1479	1474	1438	1472	1464	390
25°	86	97	136	160	160	63
35°	8	10	10	12	10	6
45°	1	1	1	1	1	1
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P1306991

CATALOG NUMBER: LDSQA3D09R309024DE010 3LSQPHR1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3091.2	3091.2	3091.2	3091.2	3091.2
1°	3091.8	3088.6	3084.0	3090.5	3086.0
2°	3085.3	3077.6	3071.1	3077.6	3075.7
3°	3066.0	3059.5	3055.0	3058.2	3058.2
4°	3036.9	3029.8	3025.9	3026.6	3016.9
5°	3000.1	2994.3	2979.4	2970.4	2954.9
6°	2945.9	2931.7	2913.6	2898.7	2878.7
7°	2872.2	2850.3	2824.5	2798.6	2773.4
8°	2754.1	2743.7	2708.9	2691.4	2666.3
9°	2643.0	2617.8	2580.4	2552.0	2538.4
10°	2502.9	2465.4	2426.0	2403.4	2386.7
11°	2336.9	2298.8	2267.2	2234.3	2208.4
12°	2141.9	2109.6	2073.5	2051.5	2021.2
13°	1910.7	1906.2	1865.5	1858.4	1854.6
14°	1712.5	1694.4	1654.4	1665.4	1667.9
15°	1479.4	1474.2	1438.1	1471.6	1464.5
17.5°	926.6	928.6	951.2	1004.1	1020.9
20°	488.2	503.0	563.7	627.7	650.3
22.5°	197.6	230.5	292.5	335.8	364.8
25°	86.5	96.9	135.6	159.5	160.1
27.5°	49.1	49.7	65.2	67.8	69.1
30°	28.4	29.1	31.6	33.6	35.5
32.5°	15.5	16.8	17.4	20.0	20.0
35°	7.7	9.7	9.7	11.6	10.3
37.5°	4.5	5.2	5.8	5.8	5.2
40°	1.9	2.6	3.2	3.2	2.6
42.5°	0.6	1.3	1.3	1.3	1.9
45°	0.6	0.6	0.6	0.6	0.6
47.5°	0.6	0.6	0.0	0.6	0.6
50°	0.6	0.0	0.0	0.0	0.6
52.5°	0.6	0.0	0.0	0.0	0.6
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P1306991
CATALOG NUMBER: LDSQA3D09R309024DE010 3LSQPHR1MW

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)