

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1309345

Luminaire Tested: LDSQA3D17R129030DE010 3LSQPHRLD1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1309345  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LDSQA3D17R129030DE010 3LSQPHRLD1MW  
Description: 3in Adjustable LED luminaire with, R12 optic, 3000K CCT AND, 90CRI , 3LSQPHRLD1MW TRIM  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1386.0 lumens  
Efficiency: N/A  
Efficacy: 60.5 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.22  
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 22.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1309345  
CATALOG NUMBER: LDSQA3D17R129030DE010 3LSQPHRLD1MW

### Luminous Intensity Polar Plot

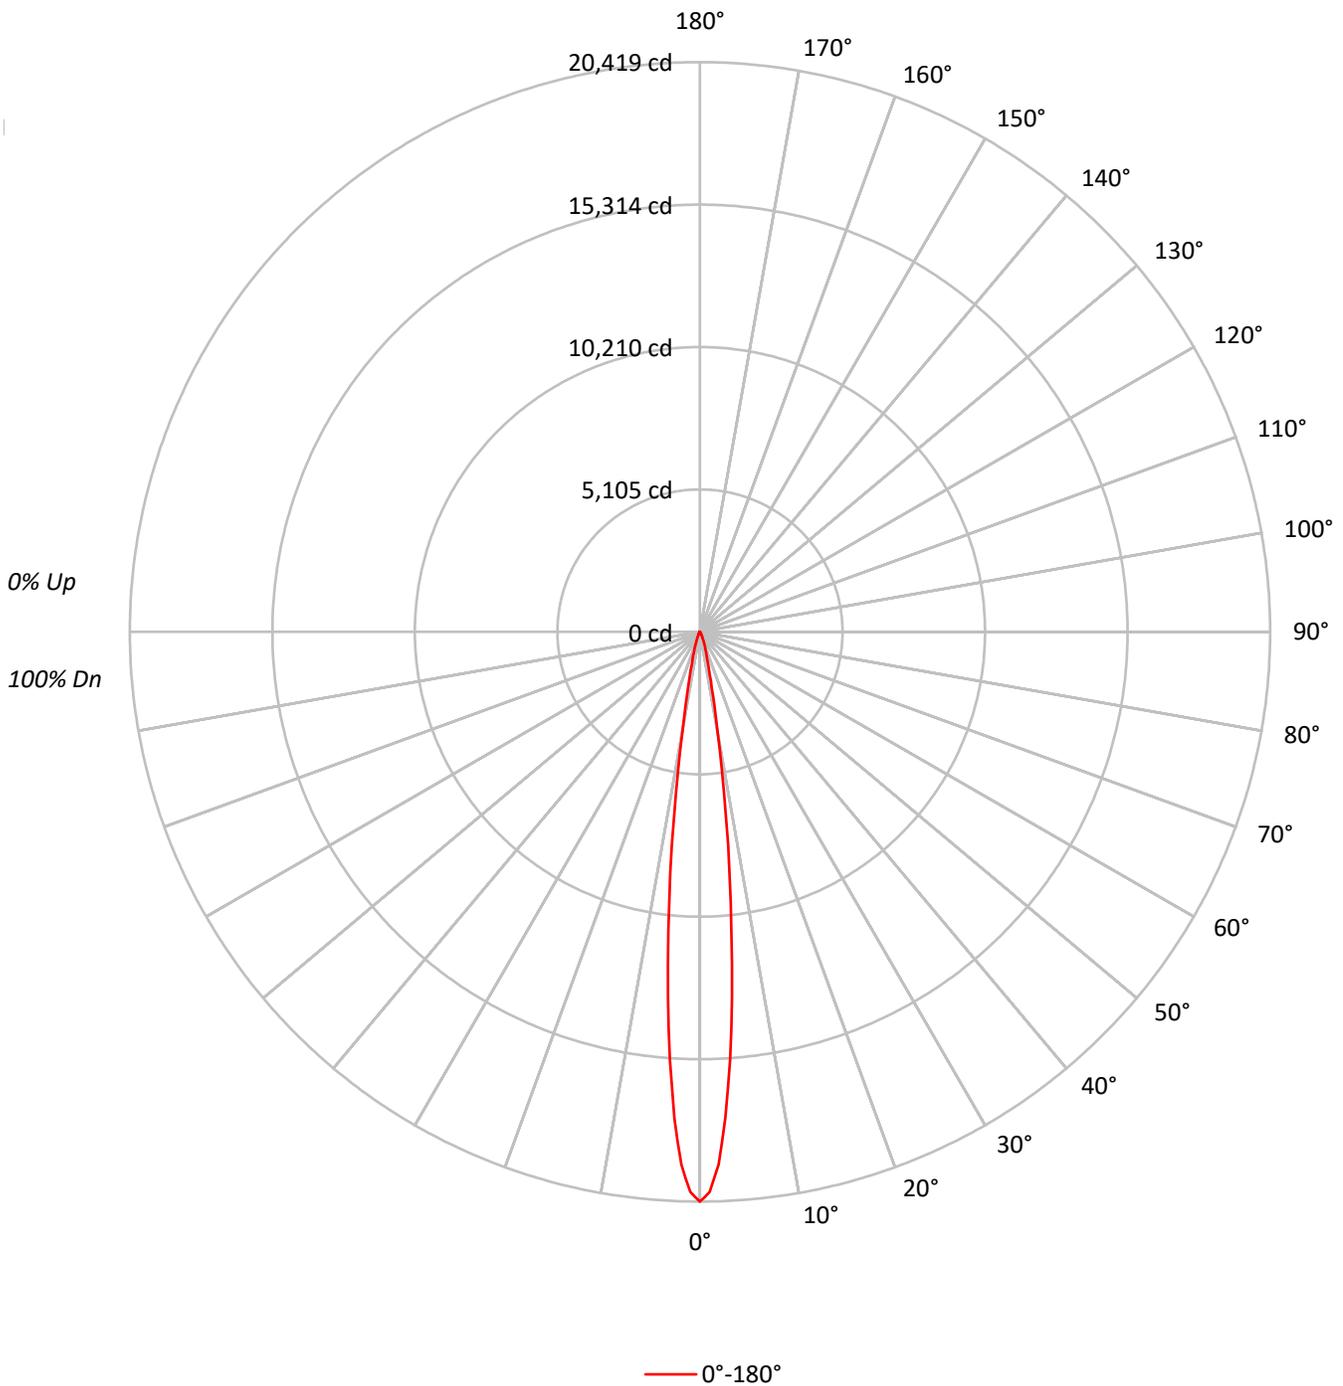



TEST NUMBER: P1309345

CATALOG NUMBER: LDSQA3D17R129030DE010 3LSQPHRLD1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97
3	110	107	104	102	109	105	103	101	103	101	99	101	99	98	99	98	96	95
4	108	104	101	98	107	103	100	98	101	99	97	99	97	96	98	96	95	94
5	106	102	98	96	105	101	98	96	99	97	95	98	96	94	97	95	93	92
6	104	99	96	94	103	99	96	94	98	95	93	96	94	93	95	93	92	91
7	102	98	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	90
8	101	96	93	91	100	95	93	90	95	92	90	94	92	90	93	91	90	89
9	99	94	91	89	98	94	91	89	93	91	89	93	90	89	92	90	88	88
10	98	93	90	88	97	93	90	88	92	90	88	91	89	88	91	89	87	87

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	3516631
5°	2272203
10°	641108
15°	181258
20°	75803
25°	33559
30°	17142
35°	9062
40°	3867
45°	1047
50°	1152
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 50°  
 Luminance: 1152 cd/sqm



TEST NUMBER: P1309345

CATALOG NUMBER: LDSQA3D17R129030DE010 3LSQPHRLD1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	926.0	66.8
10°-20°	336.0	24.2
20°-30°	90.0	6.5
30°-40°	28.3	2.0
40°-50°	5.3	0.4
50°-60°	0.5	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1352.0	97.5
0°-40°	1380.3	99.6
0°-60°	1386.0	100.0
0°-90°	1386.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1386.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	20419	
5°	13143	926
15°	1017	336
25°	177	90
35°	43	28
45°	4	5
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1309345

CATALOG NUMBER: LDSQA3D17R129030DE010 3LSQPHRLD1MW

**CANDELA DISTRIBUTION (FULL):**


0°	
0°	20419.1
1°	20074.4
2°	19105.2
3°	17446.7
4°	15387.5
5°	13143.2
6°	10804.0
7°	8710.4
8°	6703.0
9°	4988.5
10°	3666.0
11°	2701.0
12°	2033.3
13°	1576.7
14°	1249.3
15°	1016.6
17.5°	646.2
20°	413.6
22.5°	267.1
25°	176.6
27.5°	120.6
30°	86.2
32.5°	60.3
35°	43.1
37.5°	30.2
40°	17.2
42.5°	8.6
45°	4.3
47.5°	4.3
50°	4.3
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1309345

CATALOG NUMBER: LDSQA3D17R129030DE010 3LSQPHRLD1MW

CANDELA DISTRIBUTION (continued):



(END OF REPORT)