

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1309019

Luminaire Tested: LDSQA3D09R109030DE010 3LSQPHRL1MW

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1309019
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-19)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LDSQA3D09R109030DE010 3LSQPHRL1MW
Description: 3in Adjustable LED luminaire with, R10 optic, 3000K CCT AND, 90CRI , 3LSQPHRL1MW TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 743.0 lumens
Efficiency: N/A
Efficacy: 59.4 lumens/watt
Spacing Criteria (0/90/45): 0.18 / 0.18 / 0.18
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 12.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1309019
CATALOG NUMBER: LDSQA3D09R109030DE010 3LSQPHRL1MW

Luminous Intensity Polar Plot

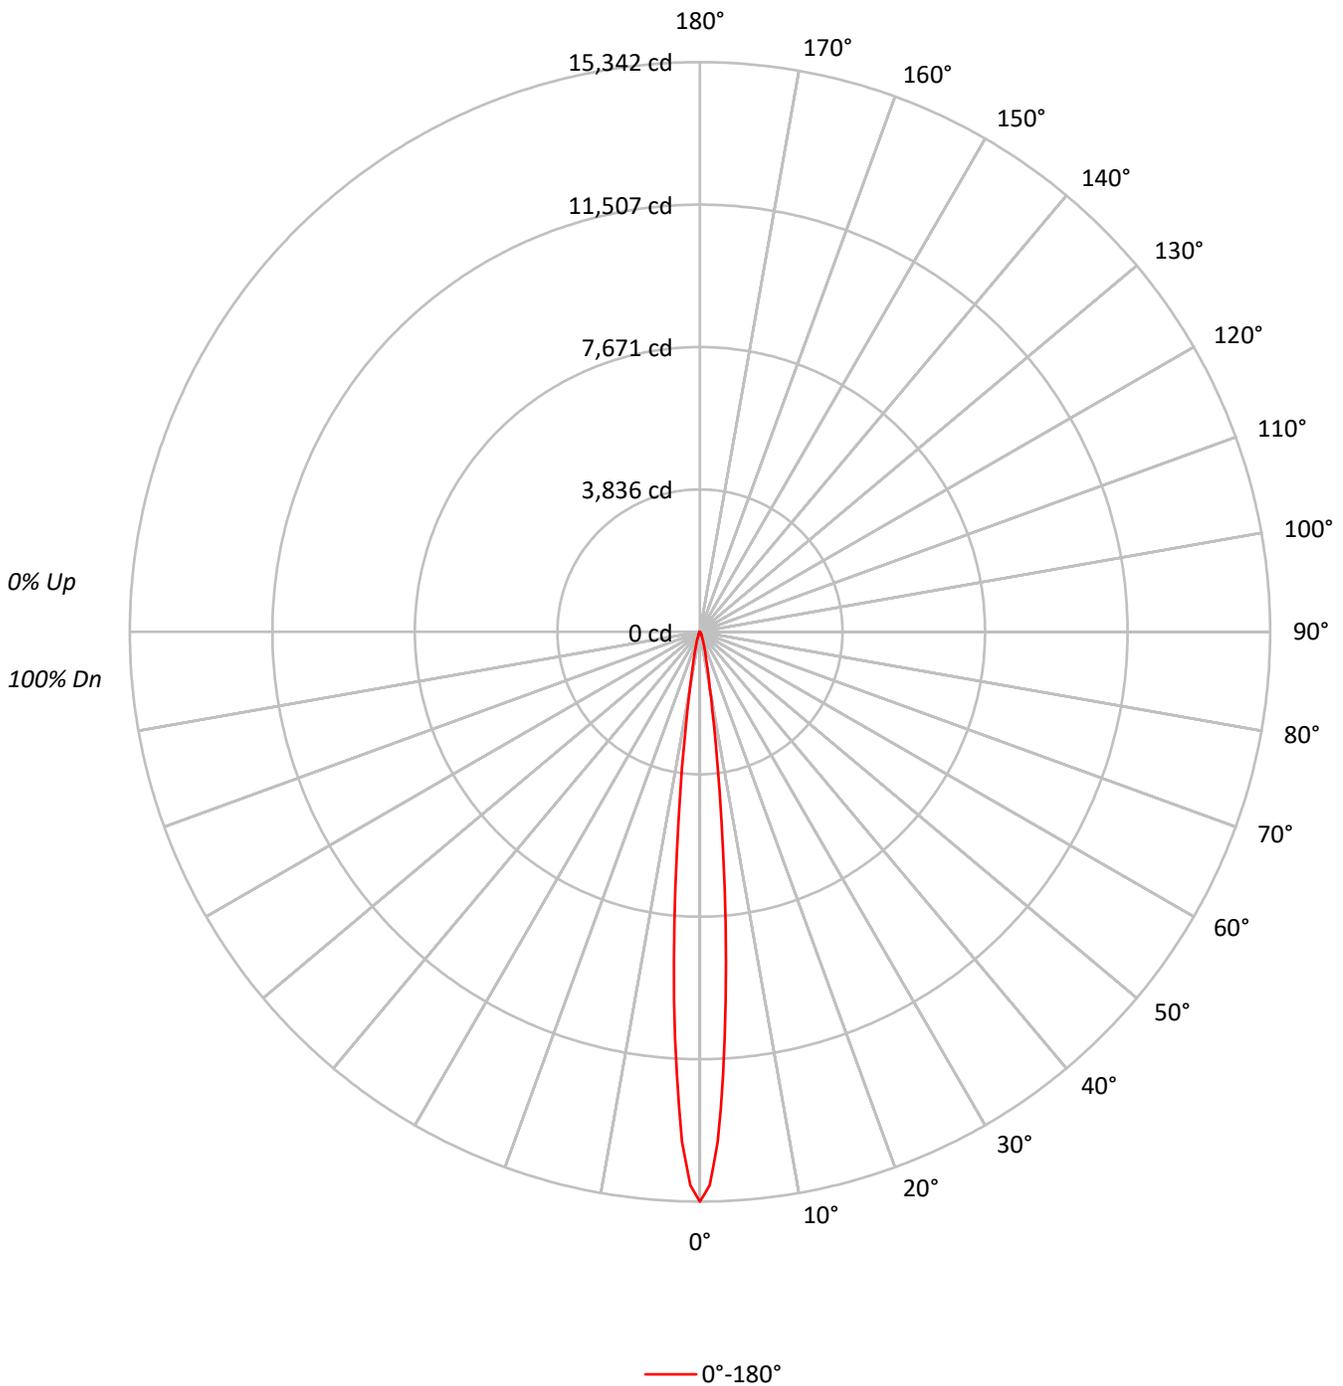



TEST NUMBER: P1309019
 CATALOG NUMBER: LDSQA3D09R109030DE010 3LSQPHRL1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	113	111	114	112	111	110	108	107	106	105	104	103	101	101	100	99	99	99	99
2	113	110	108	106	111	109	107	105	106	104	103	103	102	101	100	99	98	98	98	98	97
3	111	107	104	102	109	106	103	101	104	102	100	101	100	98	99	98	97	97	97	97	96
4	109	105	102	99	107	104	101	99	102	99	98	100	98	97	98	97	96	98	97	96	95
5	107	102	99	97	105	101	99	97	100	98	96	99	97	95	97	96	94	97	96	94	93
6	105	100	97	95	104	100	97	95	98	96	94	97	95	94	96	95	93	96	95	93	92
7	103	99	96	93	102	98	95	93	97	95	93	96	94	92	95	93	92	95	93	92	91
8	102	97	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	94	92	91	90
9	100	96	93	91	100	95	93	91	95	92	90	94	92	90	93	91	90	93	91	90	89
10	99	94	92	90	98	94	91	90	94	91	89	93	91	89	92	91	89	92	91	89	88

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2642205
5°	1364978
10°	268248
15°	84460
20°	36893
25°	16323
30°	8790
35°	4646
40°	1664
45°	609
50°	0
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 47.5°
 Luminance: 637 cd/sqm



TEST NUMBER: P1309019

CATALOG NUMBER: LDSQA3D09R109030DE010 3LSQPHRL1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	531.1	71.5
10°-20°	150.9	20.3
20°-30°	44.0	5.9
30°-40°	14.4	1.9
40°-50°	2.6	0.3
50°-60°	0.0	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	726.1	97.7
0°-40°	740.5	99.7
0°-60°	743.0	100.0
0°-90°	743.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	743.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15342	
5°	7896	531
15°	474	151
25°	86	44
35°	22	14
45°	2	3
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1309019
CATALOG NUMBER: LDSQA3D09R109030DE010 3LSQPHRL1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	15341.8
1°	14900.0
2°	13744.0
3°	11930.3
4°	9947.3
5°	7895.5
6°	5954.1
7°	4312.2
8°	3033.5
9°	2132.8
10°	1533.9
11°	1136.3
12°	873.7
13°	701.9
14°	571.9
15°	473.7
17.5°	314.1
20°	201.3
22.5°	127.6
25°	85.9
27.5°	61.4
30°	44.2
32.5°	31.9
35°	22.1
37.5°	14.7
40°	7.4
42.5°	4.9
45°	2.5
47.5°	2.5
50°	0.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1309019
CATALOG NUMBER: LDSQA3D09R109030DE010 3LSQPHRL1MW

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)