

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1309814

Luminaire Tested: LDSQA3D02R129035DE010 3LSQPHRLP1MW

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1309814
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LDSQA3D02R129035DE010 3LSQPHRLP1MW
Description: 3in Adjustable LED luminaire with, R12 optic, 3500K CCT AND, 90CRI , 3LSQPHRLP1MW TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 322.0 lumens
Efficiency: N/A
Efficacy: 87.0 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.22
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 3.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1309814

CATALOG NUMBER: LDSQA3D02R129035DE010 3LSQPHRLP1MW

Luminous Intensity Polar Plot

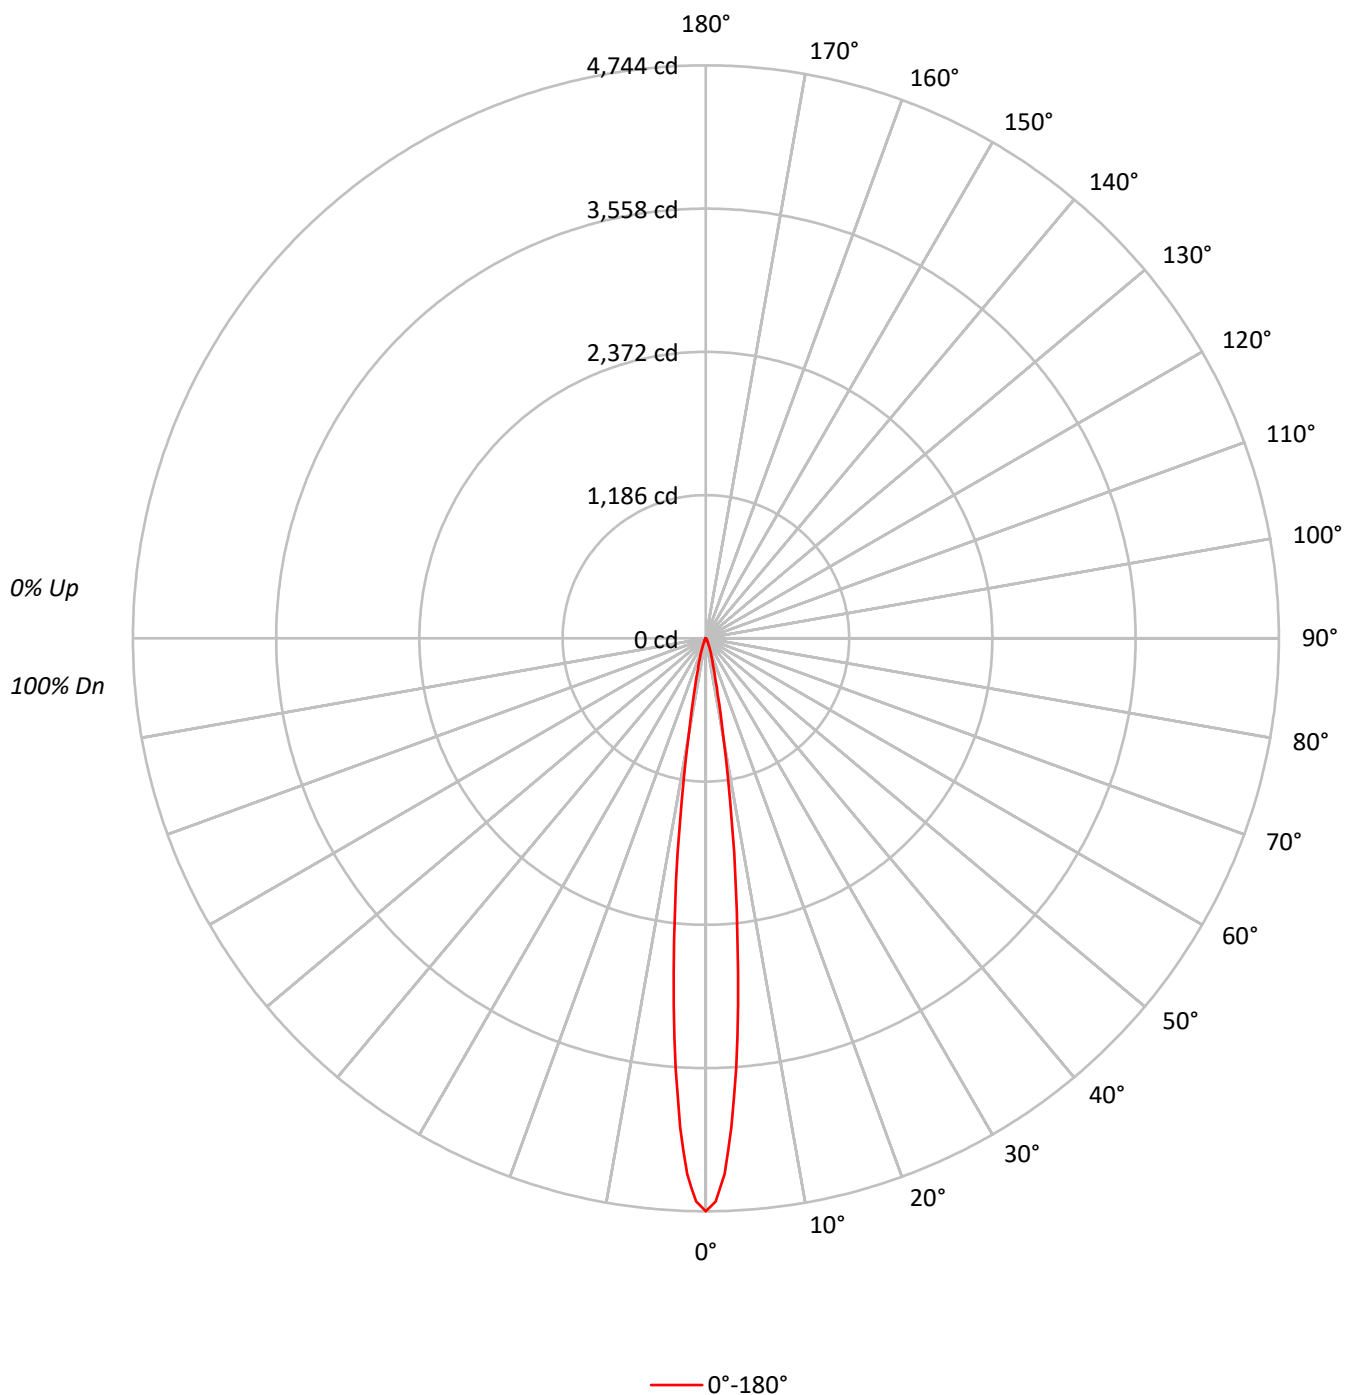

TEST NUMBER: P1309814

CATALOG NUMBER: LDSQA3D02R129035DE010 3LSQPHRLP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					0
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	116	114	113	111		114	112	111	109		108	107	106		104	104	103		101	101	100
2	113	110	108	106		111	108	106	104		105	104	102		103	101	100		100	99	98
3	110	107	104	102		109	105	103	101		103	101	99		101	99	98		99	98	96
4	108	104	101	98		107	103	100	98		101	99	97		99	97	96		98	96	95
5	106	102	98	96		105	101	98	96		99	97	95		98	96	94		97	95	93
6	104	99	96	94		103	99	96	94		98	95	93		96	94	93		95	93	92
7	102	98	94	92		101	97	94	92		96	93	92		95	93	91		94	92	91
8	101	96	93	91		100	95	93	90		95	92	90		94	92	90		93	91	90
9	99	94	91	89		98	94	91	89		93	91	89		93	90	89		92	90	88
10	98	93	90	88		97	93	90	88		92	90	88		91	89	88		91	89	87

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	816990
5°	527891
10°	148945
15°	42114
20°	17613
25°	7791
30°	3977
35°	2102
40°	899
45°	244
50°	268
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 50°

Luminance: 268 cd/sqm

TEST NUMBER: P1309814

CATALOG NUMBER: LDSQA3D02R129035DE010 3LSQPHRLP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	215.1	66.8
10°-20°	78.1	24.2
20°-30°	20.9	6.5
30°-40°	6.6	2.0
40°-50°	1.2	0.4
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	314.1	97.5
0°-40°	320.7	99.6
0°-60°	322.0	100.0
0°-90°	322.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	322.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4744	
5°	3054	215
15°	236	78
25°	41	21
35°	10	7
45°	1	1
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P1309814

CATALOG NUMBER: LDSQA3D02R129035DE010 3LSQPHRLP1MW

CANDELA DISTRIBUTION (FULL):


0°	
0°	4743.8
1°	4663.8
2°	4438.6
3°	4053.3
4°	3574.9
5°	3053.5
6°	2510.0
7°	2023.6
8°	1557.3
9°	1158.9
10°	851.7
11°	627.5
12°	472.4
13°	366.3
14°	290.2
15°	236.2
17.5°	150.1
20°	96.1
22.5°	62.1
25°	41.0
27.5°	28.0
30°	20.0
32.5°	14.0
35°	10.0
37.5°	7.0
40°	4.0
42.5°	2.0
45°	1.0
47.5°	1.0
50°	1.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1309814

CATALOG NUMBER: LDSQA3D02R129035DE010 3LSQPHRLP1MW

CANDELA DISTRIBUTION (continued):



(END OF REPORT)