

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1309976

Luminaire Tested: LDSQA3D05R129035DE010 3LSQCDR1MMS

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1309976
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LDSQA3D05R129035DE010 3LSQCDR1MMS
Description: 3in Adjustable LED luminaire with, R12 optic, 3500K CCT AND, 90CRI , 3LSQCDR1MMS TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 634.0 lumens
Efficiency: N/A
Efficacy: 83.4 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.22
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 7.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1309976

CATALOG NUMBER: LDSQA3D05R129035DE010 3LSQCDR1MMS

Luminous Intensity Polar Plot

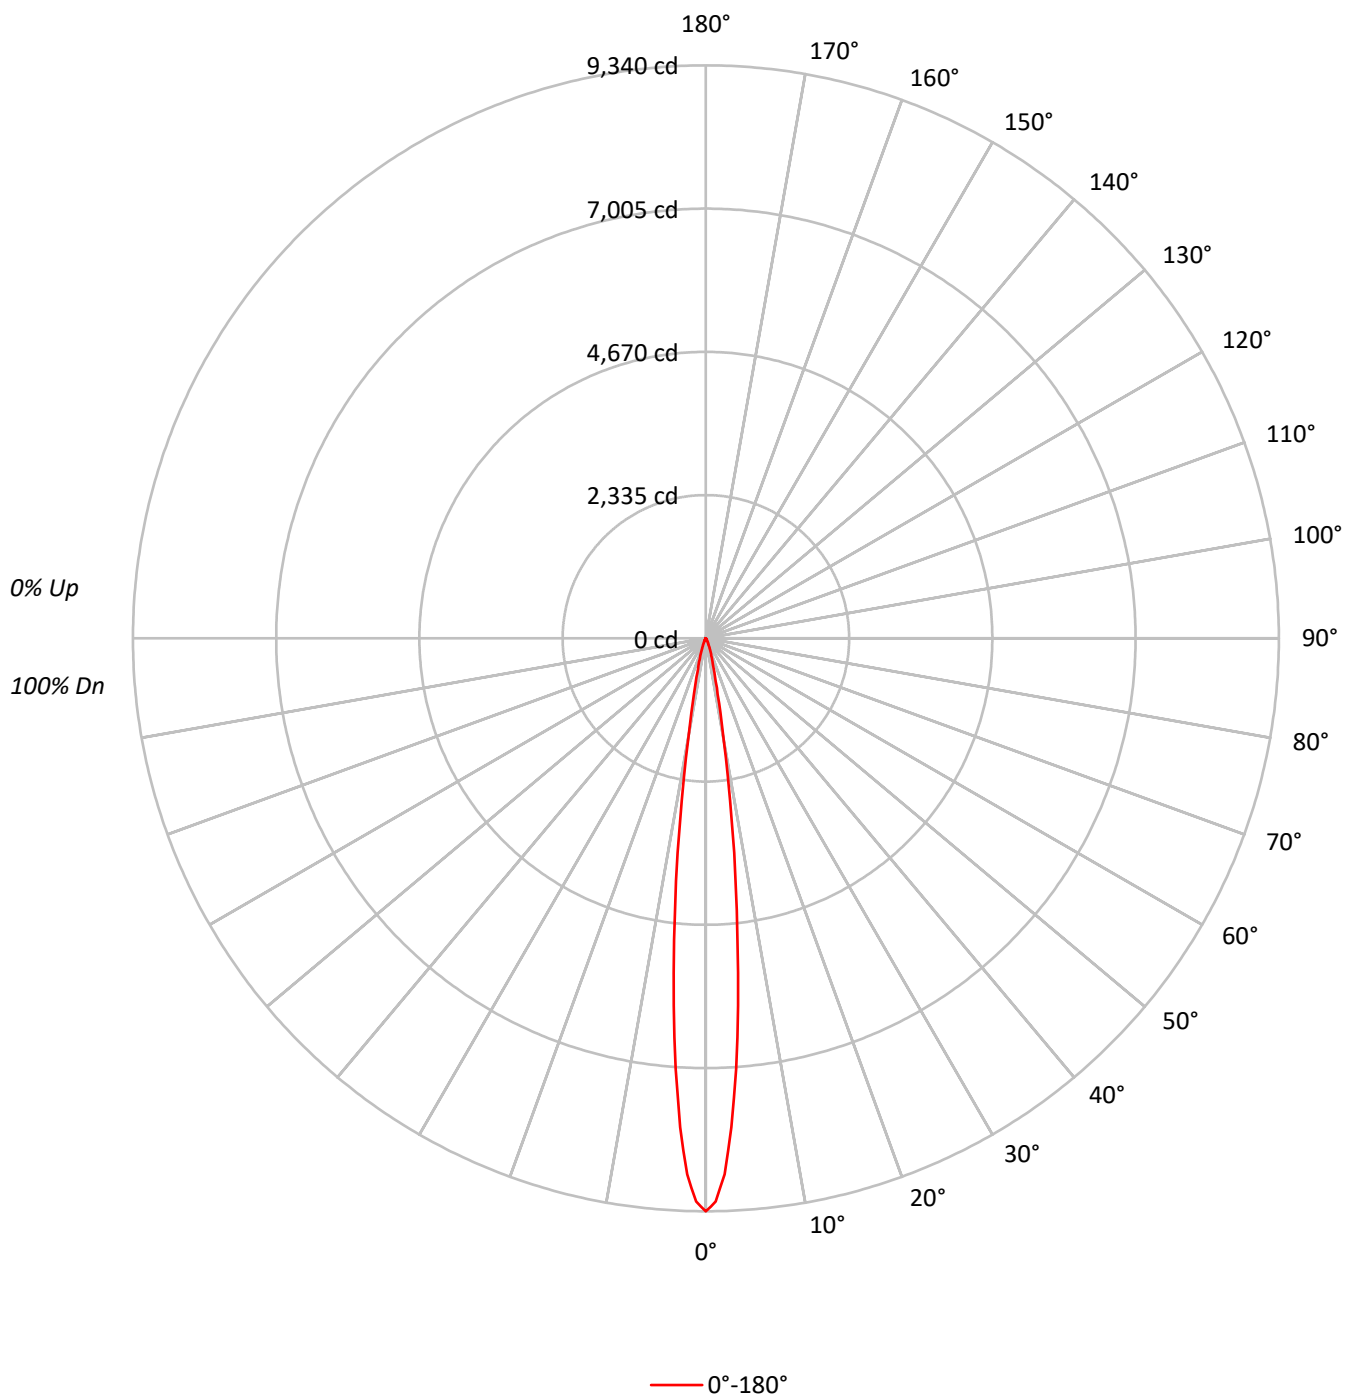

TEST NUMBER: P1309976

CATALOG NUMBER: LDSQA3D05R129035DE010 3LSQCDR1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98	98	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97	97	97
3	110	107	104	102	109	105	103	101	103	101	99	101	99	98	99	98	96	95	95	95
4	108	104	101	98	107	103	100	98	101	99	97	99	97	96	98	96	95	94	94	94
5	106	102	98	96	105	101	98	96	99	97	95	98	96	94	97	95	93	92	92	92
6	104	99	96	94	103	99	96	94	98	95	93	96	94	93	95	93	92	91	91	91
7	102	98	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	90	90	90
8	101	96	93	91	100	95	93	90	95	92	90	94	92	90	93	91	90	89	89	89
9	99	94	91	89	98	94	91	89	93	91	89	93	90	89	92	90	88	88	88	88
10	98	93	90	88	97	93	90	88	92	90	88	91	89	88	91	89	87	87	87	87

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1608611
5°	1039375
10°	293255
15°	82909
20°	34676
25°	15354
30°	7835
35°	4142
40°	1776
45°	487
50°	536
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 50°

Luminance: 536 cd/sqm

TEST NUMBER: P1309976

CATALOG NUMBER: LDSQA3D05R129035DE010 3LSQCDR1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	423.6	66.8
10°-20°	153.7	24.2
20°-30°	41.2	6.5
30°-40°	12.9	2.0
40°-50°	2.4	0.4
50°-60°	0.2	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	618.4	97.5
0°-40°	631.4	99.6
0°-60°	634.0	100.0
0°-90°	634.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	634.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9340	
5°	6012	424
15°	465	154
25°	81	41
35°	20	13
45°	2	2
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P1309976

CATALOG NUMBER: LDSQA3D05R129035DE010 3LSQCDR1MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	9340.3
1°	9182.7
2°	8739.3
3°	7980.7
4°	7038.7
5°	6012.1
6°	4942.1
7°	3984.4
8°	3066.1
9°	2281.9
10°	1676.9
11°	1235.5
12°	930.1
13°	721.2
14°	571.5
15°	465.0
17.5°	295.6
20°	189.2
22.5°	122.2
25°	80.8
27.5°	55.2
30°	39.4
32.5°	27.6
35°	19.7
37.5°	13.8
40°	7.9
42.5°	3.9
45°	2.0
47.5°	2.0
50°	2.0
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1309976

CATALOG NUMBER: LDSQA3D05R129035DE010 3LSQCDR1MMS

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)