

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P1316367

Luminaire Tested: LDSQA3D09R109740DE010 3LSQPHRLD1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1316367  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-19)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LDSQA3D09R109740DE010 3LSQPHRLD1MW  
Description: 3in Adjustable LED luminaire with, R10 optic, 4000K CCT AND, 97CRI , 3LSQPHRLD1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 726.0 lumens  
Efficiency: N/A  
Efficacy: 58.1 lumens/watt  
Spacing Criteria (0/90/45): 0.18 / 0.18 / 0.18  
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 12.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1316367

CATALOG NUMBER: LDSQA3D09R109740DE010 3LSQPHRLD1MW

### Luminous Intensity Polar Plot

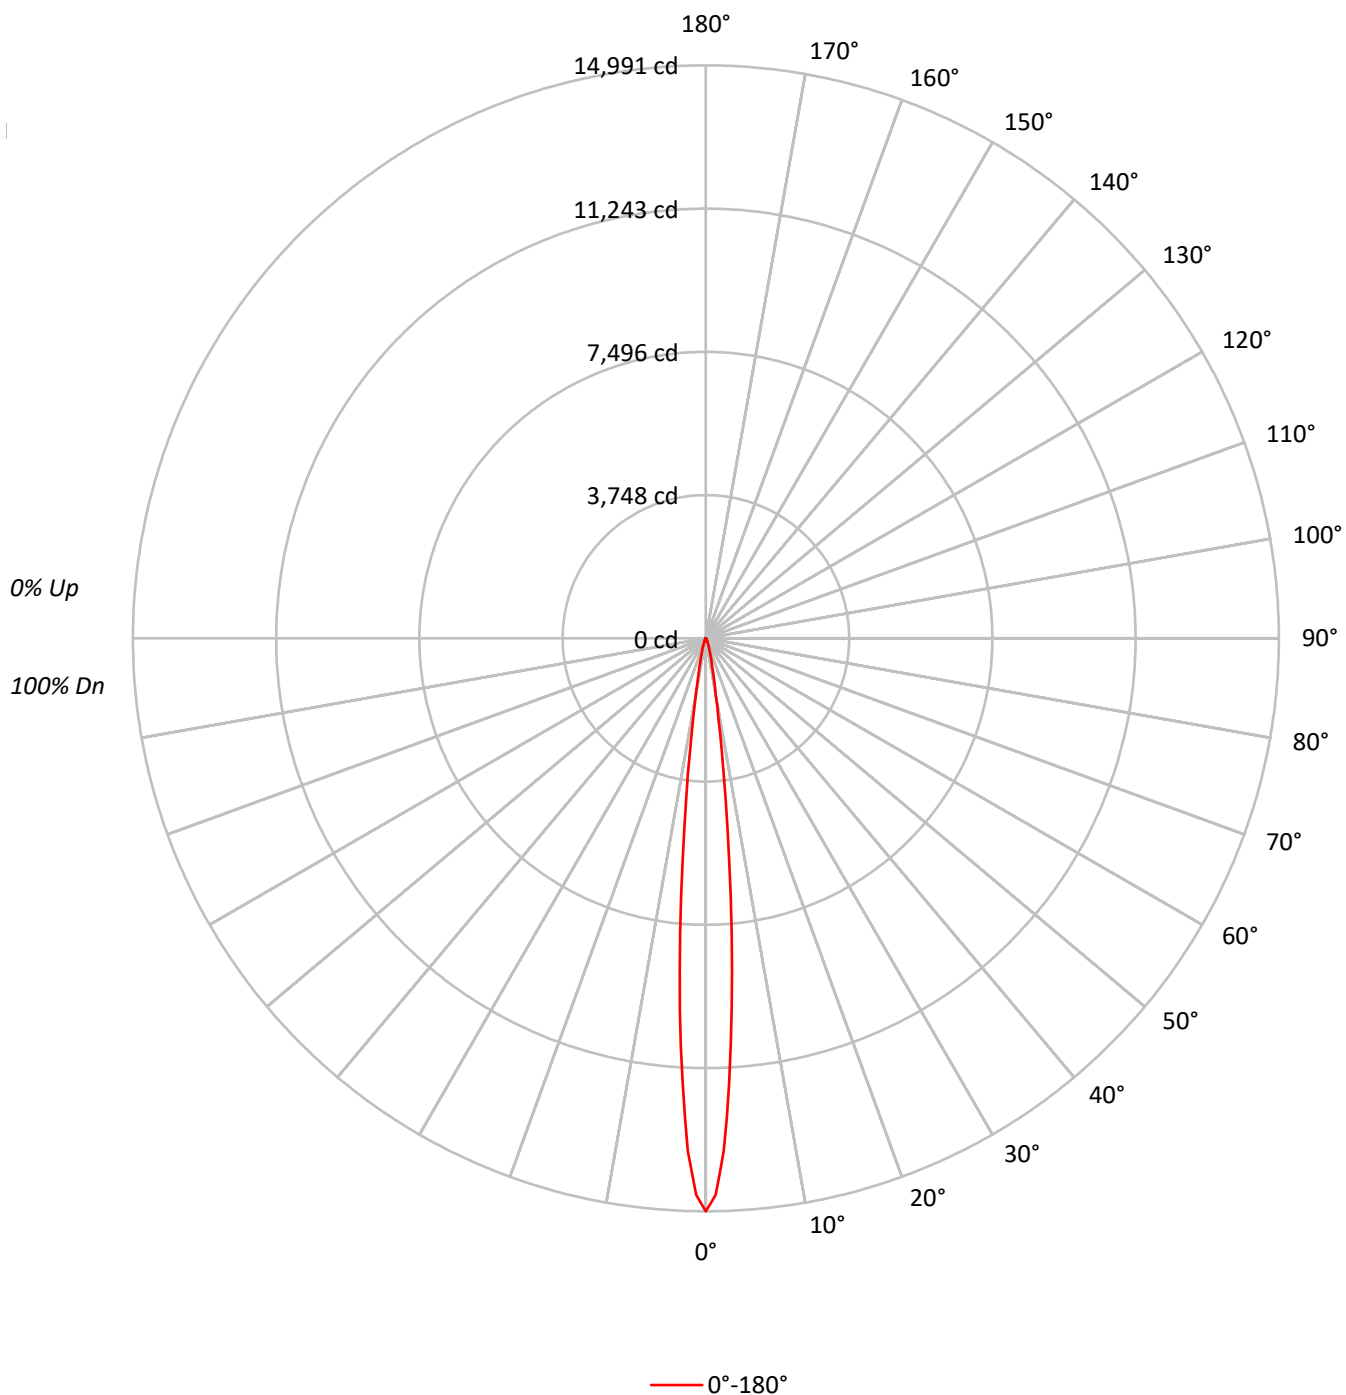

TEST NUMBER: P1316367

CATALOG NUMBER: LDSQA3D09R109740DE010 3LSQPHRLD1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |     | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 |
| 1   | 116 | 114 | 113 | 111 | 114 | 112 | 111 | 110 | 108 | 107 | 106 | 105 | 104 | 103 | 101 | 101 | 100 | 99  | 99  | 99  |
| 2   | 113 | 110 | 108 | 106 | 111 | 109 | 107 | 105 | 106 | 104 | 103 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 97  | 97  |
| 3   | 111 | 107 | 104 | 102 | 109 | 106 | 103 | 101 | 104 | 102 | 100 | 101 | 100 | 98  | 99  | 98  | 97  | 96  | 96  | 96  |
| 4   | 109 | 105 | 102 | 99  | 107 | 104 | 101 | 99  | 102 | 99  | 98  | 100 | 98  | 97  | 98  | 97  | 96  | 95  | 95  | 95  |
| 5   | 107 | 102 | 99  | 97  | 105 | 101 | 99  | 97  | 100 | 98  | 96  | 99  | 97  | 95  | 97  | 96  | 94  | 93  | 93  | 93  |
| 6   | 105 | 100 | 97  | 95  | 104 | 100 | 97  | 95  | 98  | 96  | 94  | 97  | 95  | 94  | 96  | 95  | 93  | 92  | 92  | 92  |
| 7   | 103 | 99  | 96  | 93  | 102 | 98  | 95  | 93  | 97  | 95  | 93  | 96  | 94  | 92  | 95  | 93  | 92  | 91  | 91  | 91  |
| 8   | 102 | 97  | 94  | 92  | 101 | 97  | 94  | 92  | 96  | 93  | 92  | 95  | 93  | 91  | 94  | 92  | 91  | 90  | 90  | 90  |
| 9   | 100 | 96  | 93  | 91  | 100 | 95  | 93  | 91  | 95  | 92  | 90  | 94  | 92  | 90  | 93  | 91  | 90  | 89  | 89  | 89  |
| 10  | 99  | 94  | 92  | 90  | 98  | 94  | 91  | 90  | 94  | 91  | 89  | 93  | 91  | 89  | 92  | 91  | 89  | 88  | 88  | 88  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 2581755 |
| 5°  | 1333739 |
| 10° | 262109  |
| 15° | 82516   |
| 20° | 36032   |
| 25° | 15943   |
| 30° | 8591    |
| 35° | 4541    |
| 40° | 1619    |
| 45° | 585     |
| 50° | 0       |
| 55° | 0       |
| 60° | 0       |
| 65° | 0       |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 47.5°

Luminance: 612 cd/sqm

TEST NUMBER: P1316367

CATALOG NUMBER: LDSQA3D09R109740DE010 3LSQPHRLD1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 519.0  | 71.5      |
| 10°-20°   | 147.5  | 20.3      |
| 20°-30°   | 43.0   | 5.9       |
| 30°-40°   | 14.1   | 1.9       |
| 40°-50°   | 2.5    | 0.3       |
| 50°-60°   | 0.0    | 0.0       |
| 60°-70°   | 0.0    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 709.4  | 97.7      |
| 0°-40°    | 723.5  | 99.7      |
| 0°-60°    | 726.0  | 100.0     |
| 0°-90°    | 726.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 726.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 14991 |      |
| 5°  | 7715  | 519  |
| 15° | 463   | 147  |
| 25° | 84    | 43   |
| 35° | 22    | 14   |
| 45° | 2     | 2    |
| 55° | 0     | 0    |
| 65° | 0     | 0    |
| 75° | 0     | 0    |
| 85° | 0     | 0    |
| 90° | 0     |      |

TEST NUMBER: P1316367

CATALOG NUMBER: LDSQA3D09R109740DE010 3LSQPHRLD1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |         |
|-------|---------|
| 0°    | 14990.8 |
| 1°    | 14559.1 |
| 2°    | 13429.6 |
| 3°    | 11657.4 |
| 4°    | 9719.7  |
| 5°    | 7714.8  |
| 6°    | 5817.9  |
| 7°    | 4213.5  |
| 8°    | 2964.1  |
| 9°    | 2084.0  |
| 10°   | 1498.8  |
| 11°   | 1110.3  |
| 12°   | 853.7   |
| 13°   | 685.9   |
| 14°   | 558.8   |
| 15°   | 462.8   |
| 17.5° | 307.0   |
| 20°   | 196.6   |
| 22.5° | 124.7   |
| 25°   | 83.9    |
| 27.5° | 60.0    |
| 30°   | 43.2    |
| 32.5° | 31.2    |
| 35°   | 21.6    |
| 37.5° | 14.4    |
| 40°   | 7.2     |
| 42.5° | 4.8     |
| 45°   | 2.4     |
| 47.5° | 2.4     |
| 50°   | 0.0     |
| 52.5° | 0.0     |
| 55°   | 0.0     |
| 57.5° | 0.0     |
| 60°   | 0.0     |
| 62.5° | 0.0     |
| 65°   | 0.0     |
| 67.5° | 0.0     |
| 70°   | 0.0     |
| 72.5° | 0.0     |
| 75°   | 0.0     |
| 77.5° | 0.0     |
| 80°   | 0.0     |
| 82.5° | 0.0     |
| 85°   | 0.0     |
| 87.5° | 0.0     |



TEST NUMBER: P1316367

CATALOG NUMBER: LDSQA3D09R109740DE010 3LSQPHRLD1MW

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)