

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P744057

Luminaire Tested: LD4D20D010-EU4DR2520359035-4LBDP1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P744057
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D20D010-EU4DR2520359035-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1370.6 lumens
Efficiency: N/A
Efficacy: 59.3 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P744057

CATALOG NUMBER: LD4D20D010-EU4DR2520359035-4LBDP1B

Luminous Intensity Polar Plot

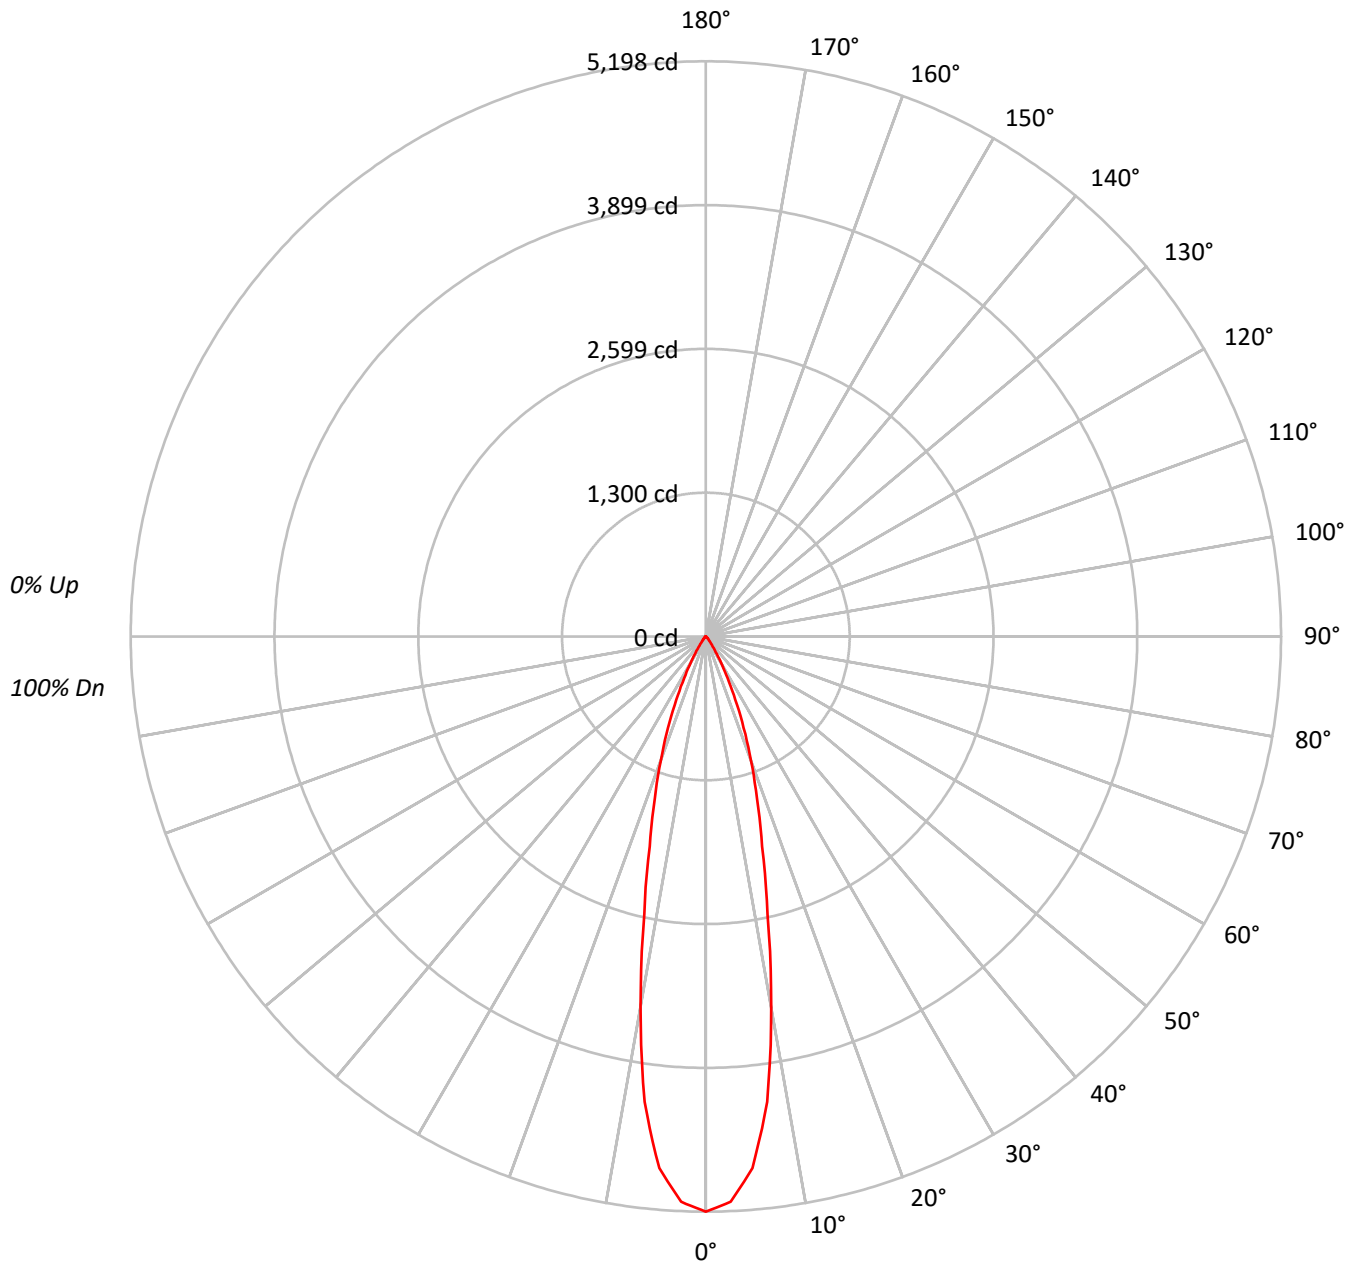



TEST NUMBER: P744057

CATALOG NUMBER: LD4D20D010-EU4DR2520359035-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	113	111	109	112	110	109	107	106	105	104		103	102	101		99
2	111	107	104	101	109	105	102	100	102	100	98		99	97	96		97
3	107	102	98	95	105	101	97	94	98	95	93		96	93	91		94
4	103	97	93	90	102	96	93	90	94	91	89		93	90	88		91
5	100	93	89	86	98	93	89	86	91	87	85		89	86	84		88
6	97	90	85	82	95	89	85	82	88	84	81		87	83	81		85
7	93	87	82	79	92	86	82	79	85	81	78		84	80	78		83
8	91	84	79	76	90	83	79	76	82	78	76		81	78	75		80
9	88	81	76	73	87	80	76	73	80	76	73		79	75	73		78
10	85	78	74	71	85	78	74	71	77	73	71		76	73	71		76

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	567970
5°	528999
10°	377350
15°	222248
20°	138283
25°	75890
30°	34708
35°	13138
40°	5948
45°	3569
50°	1496
55°	952
60°	656
65°	465
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3569 cd/sqm



TEST NUMBER: P744057

CATALOG NUMBER: LD4D20D010-EU4DR2520359035-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.5	30.2
10°-20°	561.4	41.0
20°-30°	297.1	21.7
30°-40°	73.3	5.4
40°-50°	17.9	1.3
50°-60°	4.7	0.3
60°-70°	1.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1273.1	92.9
0°-40°	1346.4	98.2
0°-60°	1369.0	99.9
0°-90°	1370.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1370.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5198	
5°	4823	415
15°	1965	561
25°	630	297
35°	98	73
45°	23	18
55°	5	5
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P744057

CATALOG NUMBER: LD4D20D010-EU4DR2520359035-4LBDP1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	5198.3
2.5°	5112.9
5°	4823.2
7.5°	4241.1
10°	3401.2
12.5°	2571.1
15°	1964.8
17.5°	1531.3
20°	1189.3
22.5°	891.9
25°	629.5
27.5°	422.2
30°	275.1
32.5°	167.4
35°	98.5
37.5°	60.3
40°	41.7
42.5°	31.9
45°	23.1
47.5°	14.0
50°	8.8
52.5°	6.4
55°	5.0
57.5°	4.0
60°	3.0
62.5°	2.4
65°	1.8
67.5°	0.6
70°	0.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)