

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P750615

Luminaire Tested: LD4D60D010-EU4DR2555659035-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P750615
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D60D010-EU4DR2555659035-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6004.5 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P750615

CATALOG NUMBER: LD4D60D010-EU4DR2555659035-4LBS1LI

Luminous Intensity Polar Plot

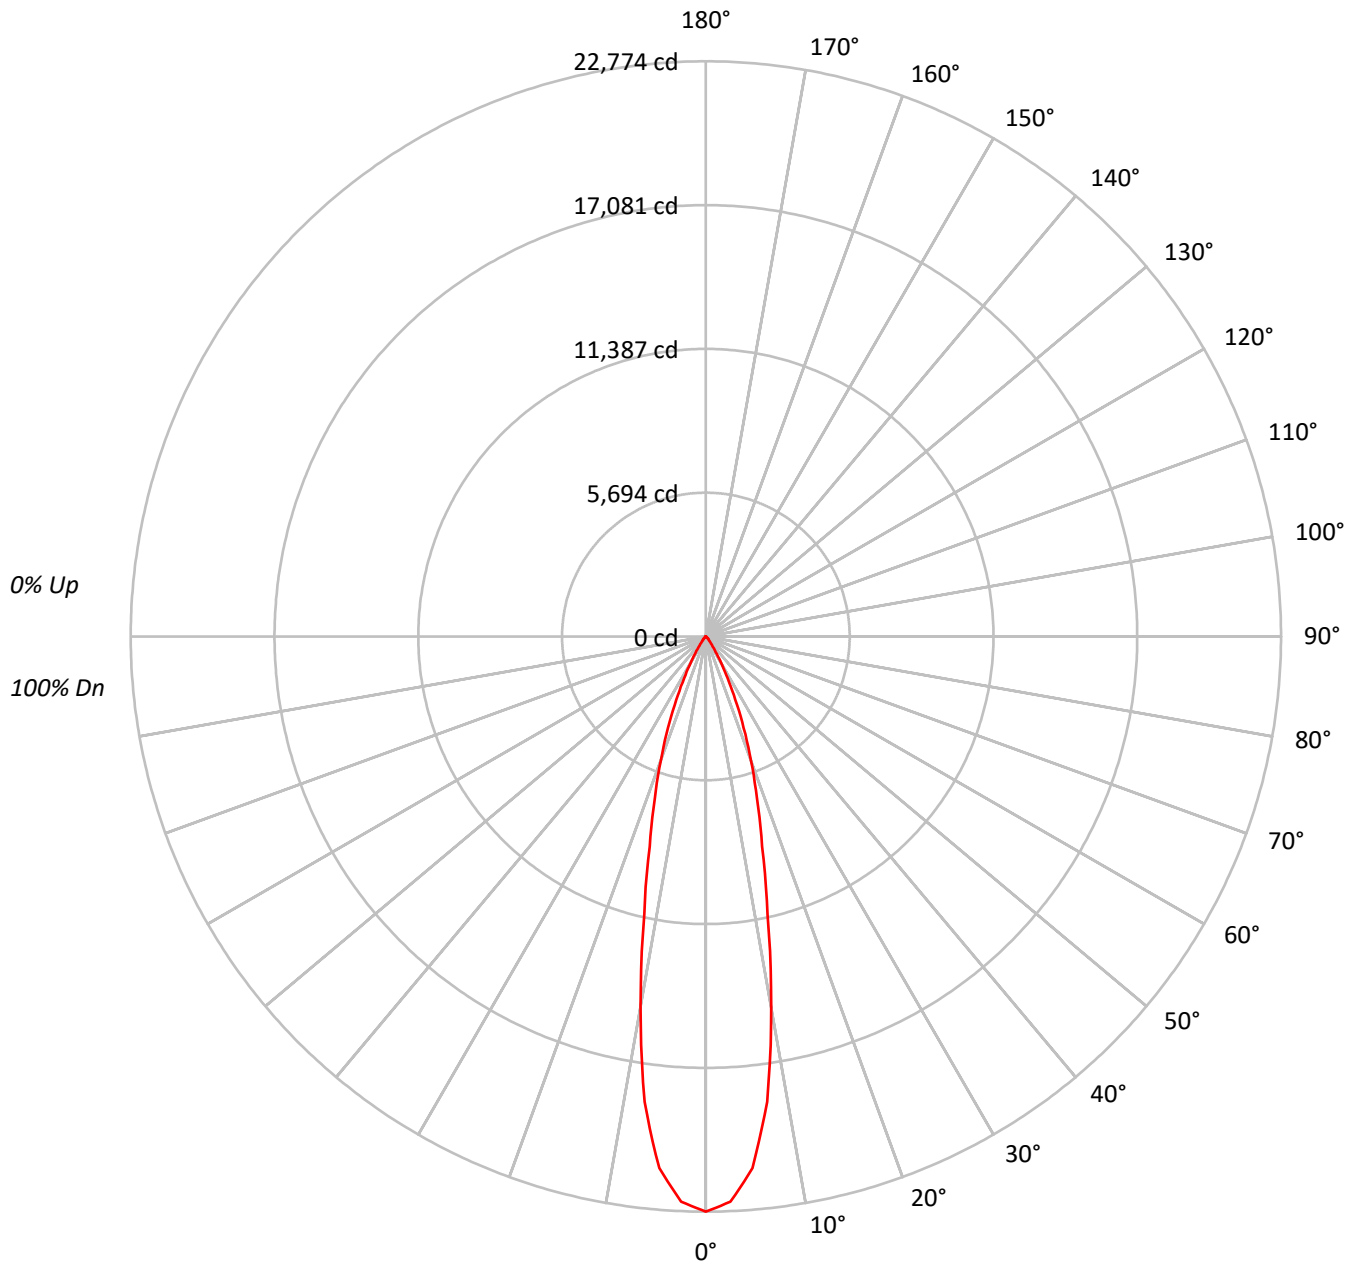



TEST NUMBER: P750615

CATALOG NUMBER: LD4D60D010-EU4DR2555659035-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																				
0	119	119	119	119	116	116	116	116		111	111	111		106	106	106		102	102	102
1	115	113	111	109	112	110	109	107		106	105	104		103	102	101		99	99	98
2	111	107	104	101	109	105	102	100		102	100	98		99	97	96		97	95	94
3	107	102	98	95	105	101	97	94		98	95	93		96	93	91		94	92	90
4	103	97	93	90	102	96	93	90		94	91	89		93	90	88		91	89	87
5	100	93	89	86	98	93	89	86		91	87	85		89	86	84		88	85	83
6	97	90	85	82	95	89	85	82		88	84	81		87	83	81		85	83	80
7	93	87	82	79	92	86	82	79		85	81	78		84	80	78		83	80	78
8	91	84	79	76	90	83	79	76		82	78	76		81	78	75		80	77	75
9	88	81	76	73	87	80	76	73		80	76	73		79	75	73		78	75	73
10	85	78	74	71	85	78	74	71		77	73	71		76	73	71		76	73	70

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2488261
5°	2317499
10°	1653133
15°	973638
20°	605805
25°	332469
30°	152052
35°	57581
40°	26073
45°	15684
50°	6510
55°	4191
60°	2928
65°	1991
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 15684 cd/sqm



TEST NUMBER: P750615

CATALOG NUMBER: LD4D60D010-EU4DR2555659035-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1816.0	30.2
10°-20°	2459.6	41.0
20°-30°	1301.6	21.7
30°-40°	321.3	5.4
40°-50°	78.4	1.3
50°-60°	20.6	0.3
60°-70°	6.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5577.1	92.9
0°-40°	5898.4	98.2
0°-60°	5997.4	99.9
0°-90°	6004.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6004.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	22774	
5°	21130	###
15°	8608	2460
25°	2758	1302
35°	432	321
45°	102	78
55°	22	21
65°	8	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P750615

CATALOG NUMBER: LD4D60D010-EU4DR2555659035-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	22773.6
2.5°	22399.3
5°	21130.0
7.5°	18580.0
10°	14900.3
12.5°	11263.8
15°	8607.5
17.5°	6708.3
20°	5210.2
22.5°	3907.4
25°	2757.8
27.5°	1849.4
30°	1205.2
32.5°	733.2
35°	431.7
37.5°	264.2
40°	182.8
42.5°	139.8
45°	101.5
47.5°	61.3
50°	38.3
52.5°	27.8
55°	22.0
57.5°	17.2
60°	13.4
62.5°	10.5
65°	7.7
67.5°	2.9
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)