

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P752521

Luminaire Tested: LD4D70BD010-EU4DR5070959024-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P752521
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D70BD010-EU4DR5070959024-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6029.4 lumens
Efficiency: N/A
Efficacy: 90.5 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P752521

CATALOG NUMBER: LD4D70BD010-EU4DR5070959024-4LBDP1H

Luminous Intensity Polar Plot

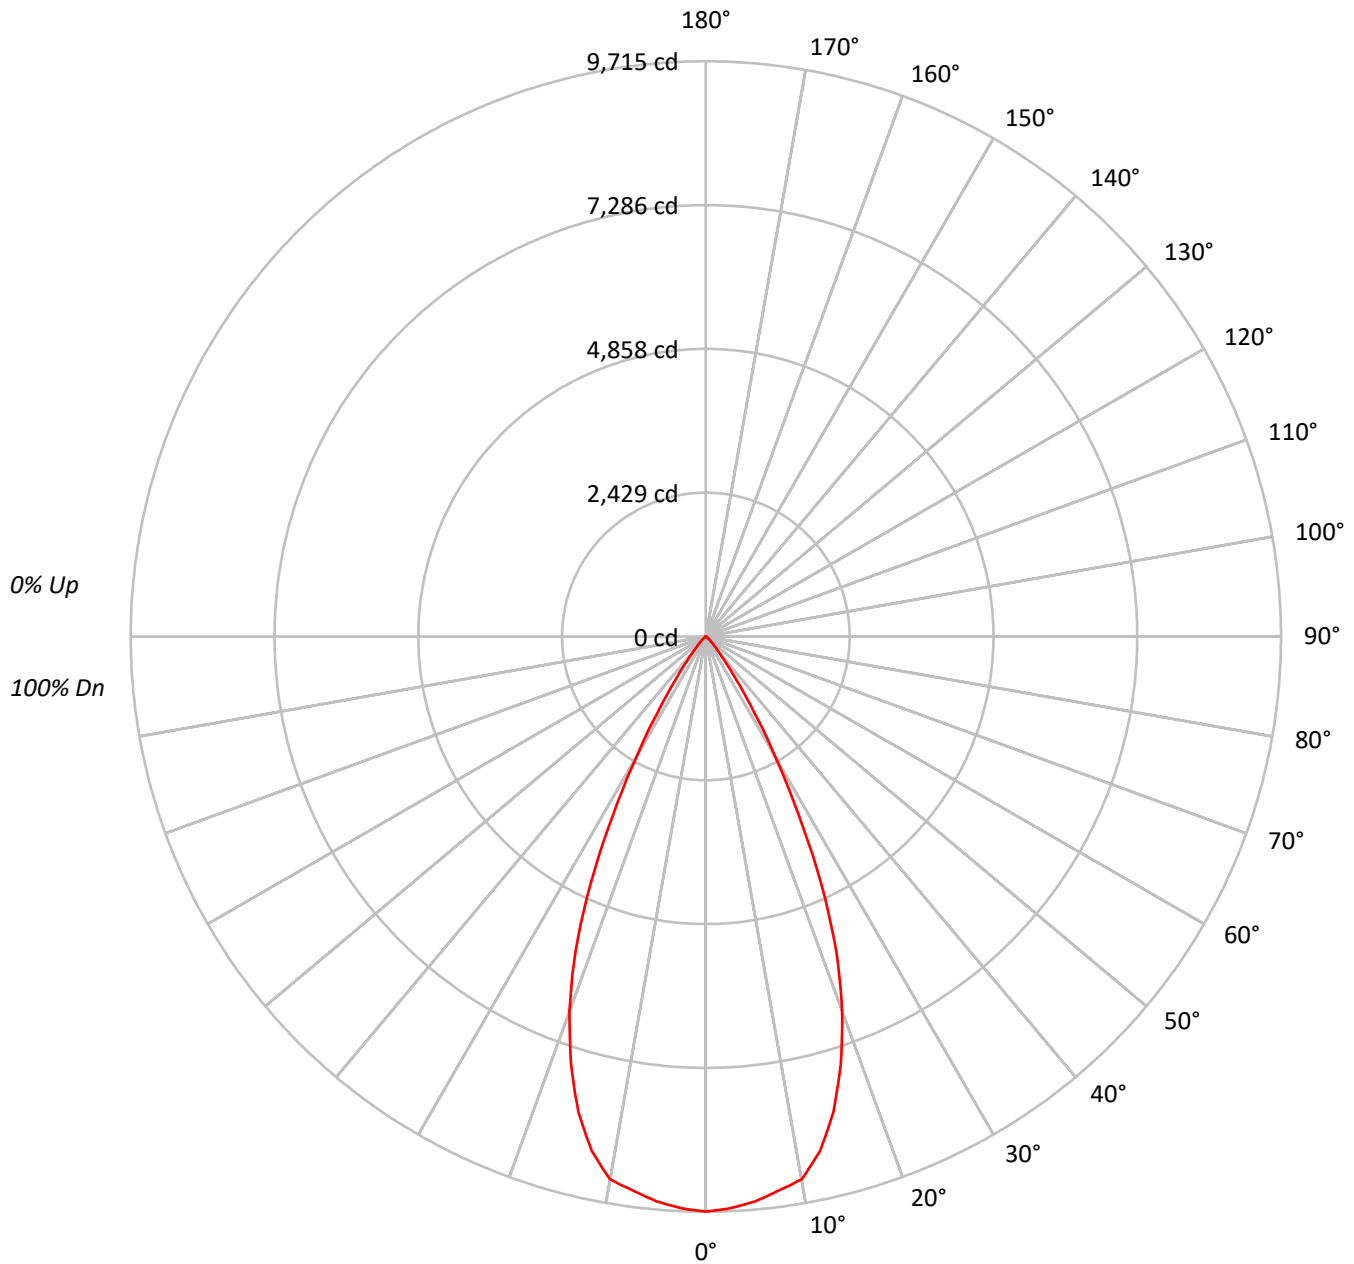

TEST NUMBER: P752521

CATALOG NUMBER: LD4D70BD010-EU4DR5070959024-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	112	109	107	112	110	108	106	106	104	102	102	101	99	98	97	97	95		
2	109	105	101	98	107	103	100	97	100	98	95	97	95	93	95	93	91	90		
3	105	99	95	91	103	98	94	90	95	92	89	93	90	88	91	88	86	85		
4	100	94	89	85	99	93	88	85	90	87	84	89	85	83	87	84	82	80		
5	96	89	84	80	95	88	83	79	86	82	79	85	81	78	83	80	77	76		
6	92	84	79	75	91	83	79	75	82	78	74	81	77	74	79	76	74	72		
7	88	80	75	71	87	79	74	71	78	74	71	77	73	70	76	73	70	69		
8	85	76	71	67	84	76	71	67	75	70	67	74	70	67	73	69	66	65		
9	81	73	68	64	80	72	67	64	71	67	64	71	67	64	70	66	63	62		
10	78	70	64	61	77	69	64	61	68	64	61	68	64	61	67	63	60	59		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1061446
5°	1050321
10°	1033021
15°	940653
20°	782726
25°	555618
30°	294087
35°	119844
40°	44515
45°	20381
50°	8346
55°	4362
60°	2142
65°	646
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 20381 cd/sqm



TEST NUMBER: P752521

CATALOG NUMBER: LD4D70BD010-EU4DR5070959024-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	905.2	15.0
10°-20°	2287.5	37.9
20°-30°	2054.8	34.1
30°-40°	643.4	10.7
40°-50°	112.7	1.9
50°-60°	22.4	0.4
60°-70°	3.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5247.5	87.0
0°-40°	5890.9	97.7
0°-60°	6026.0	99.9
0°-90°	6029.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6029.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9715	
5°	9576	905
15°	8316	2288
25°	4609	2055
35°	898	643
45°	132	113
55°	23	22
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P752521

CATALOG NUMBER: LD4D70BD010-EU4DR5070959024-4LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	9714.8
2.5°	9666.5
5°	9576.4
7.5°	9438.8
10°	9311.0
12.5°	8901.5
15°	8315.9
17.5°	7572.2
20°	6731.8
22.5°	5759.6
25°	4608.8
27.5°	3388.4
30°	2331.0
32.5°	1517.7
35°	898.5
37.5°	516.0
40°	312.1
42.5°	203.1
45°	131.9
47.5°	80.3
50°	49.1
52.5°	33.6
55°	22.9
57.5°	15.6
60°	9.8
62.5°	5.7
65°	2.5
67.5°	0.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)