

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756032

Luminaire Tested: LD4D95BD010-EU4DR2570959024-4LBDP1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P756032
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D95BD010-EU4DR2570959024-4LBDP1LI
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7077.3 lumens
Efficiency: N/A
Efficacy: 71.3 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P756032

CATALOG NUMBER: LD4D95BD010-EU4DR2570959024-4LBDP1LI

Luminous Intensity Polar Plot

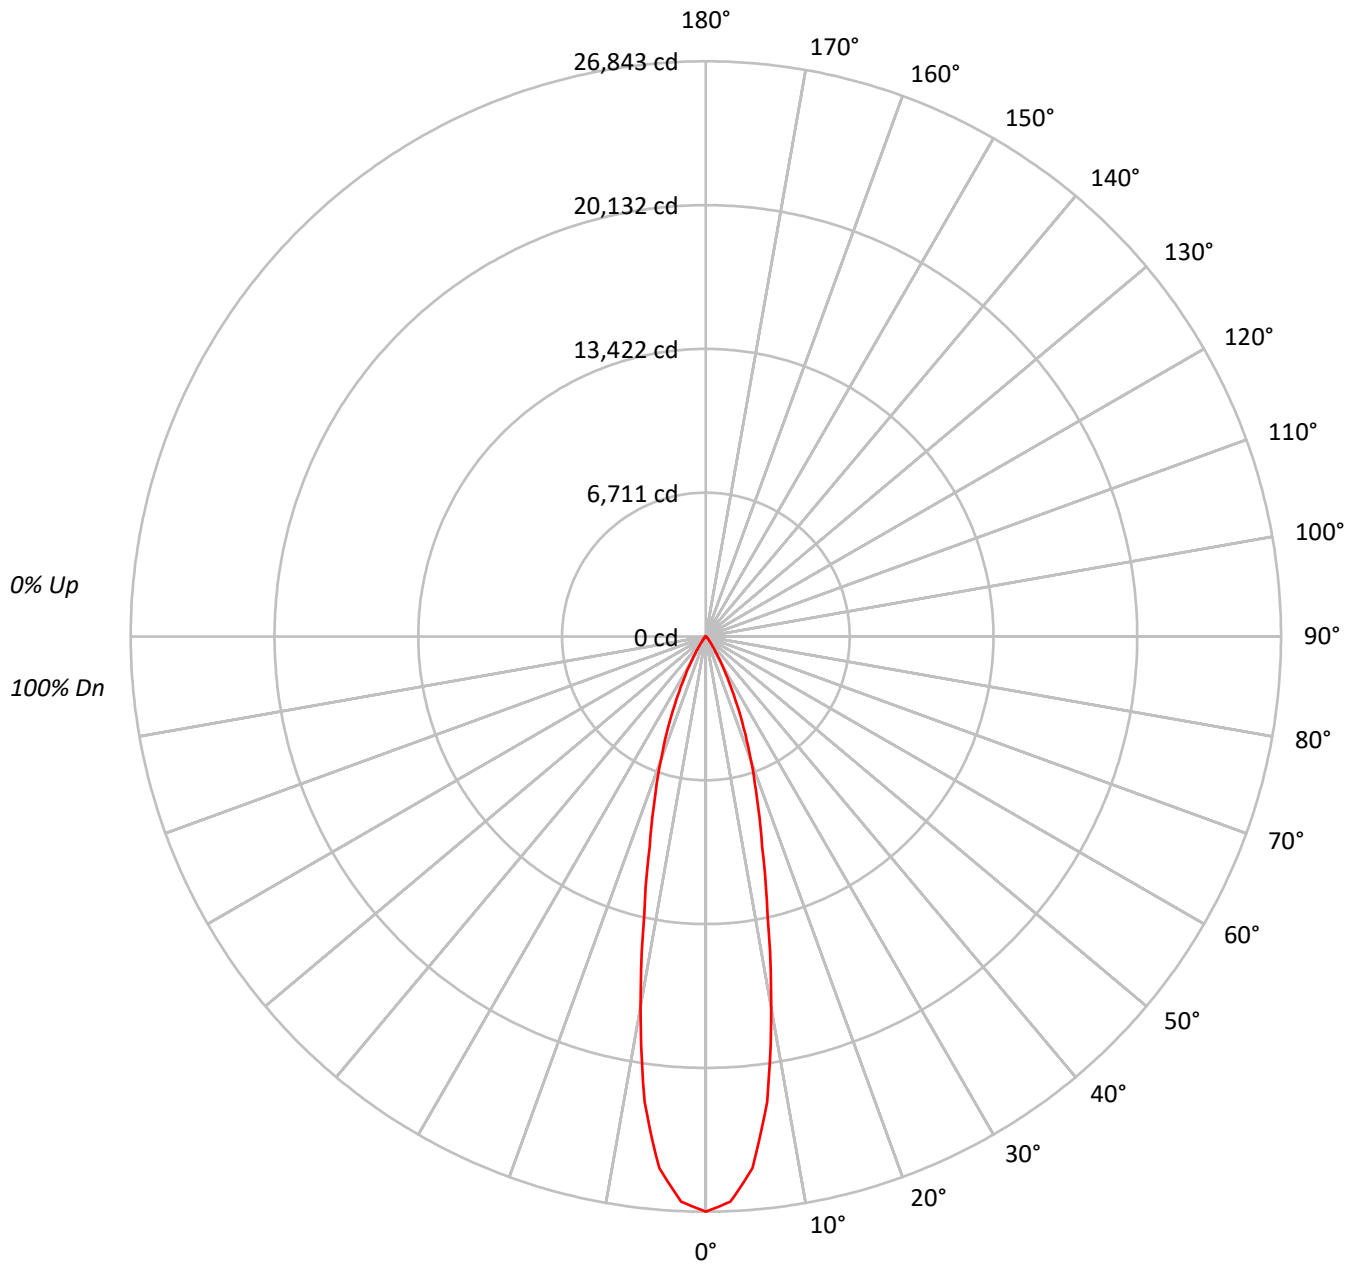



TEST NUMBER: P756032

CATALOG NUMBER: LD4D95BD010-EU4DR2570959024-4LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96		
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92		
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89		
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85		
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82		
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79		
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77		
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74		
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72		
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2932865
5°	2731588
10°	1948516
15°	1147597
20°	714055
25°	391879
30°	179215
35°	67878
40°	30737
45°	18480
50°	7666
55°	4953
60°	3453
65°	2327
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 18480 cd/sqm



TEST NUMBER: P756032

CATALOG NUMBER: LD4D95BD010-EU4DR2570959024-4LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2140.4	30.2
10°-20°	2899.1	41.0
20°-30°	1534.1	21.7
30°-40°	378.7	5.4
40°-50°	92.4	1.3
50°-60°	24.3	0.3
60°-70°	8.2	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6573.6	92.9
0°-40°	6952.3	98.2
0°-60°	7069.0	99.9
0°-90°	7077.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7077.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	26843	
5°	24906	###
15°	10145	2899
25°	3251	1534
35°	509	379
45°	120	92
55°	26	24
65°	9	8
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P756032

CATALOG NUMBER: LD4D95BD010-EU4DR2570959024-4LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	26842.8
2.5°	26401.6
5°	24905.5
7.5°	21899.8
10°	17562.7
12.5°	13276.4
15°	10145.4
17.5°	7906.9
20°	6141.2
22.5°	4605.6
25°	3250.6
27.5°	2179.8
30°	1420.5
32.5°	864.3
35°	508.9
37.5°	311.4
40°	215.5
42.5°	164.7
45°	119.6
47.5°	72.2
50°	45.1
52.5°	32.7
55°	26.0
57.5°	20.3
60°	15.8
62.5°	12.4
65°	9.0
67.5°	3.4
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)