

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756504

Luminaire Tested: LD4D95BD010-EU4DR5570959024-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P756504
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D95BD010-EU4DR5570959024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8525.9 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P756504

CATALOG NUMBER: LD4D95BD010-EU4DR5570959024-4LBS1LI

Luminous Intensity Polar Plot

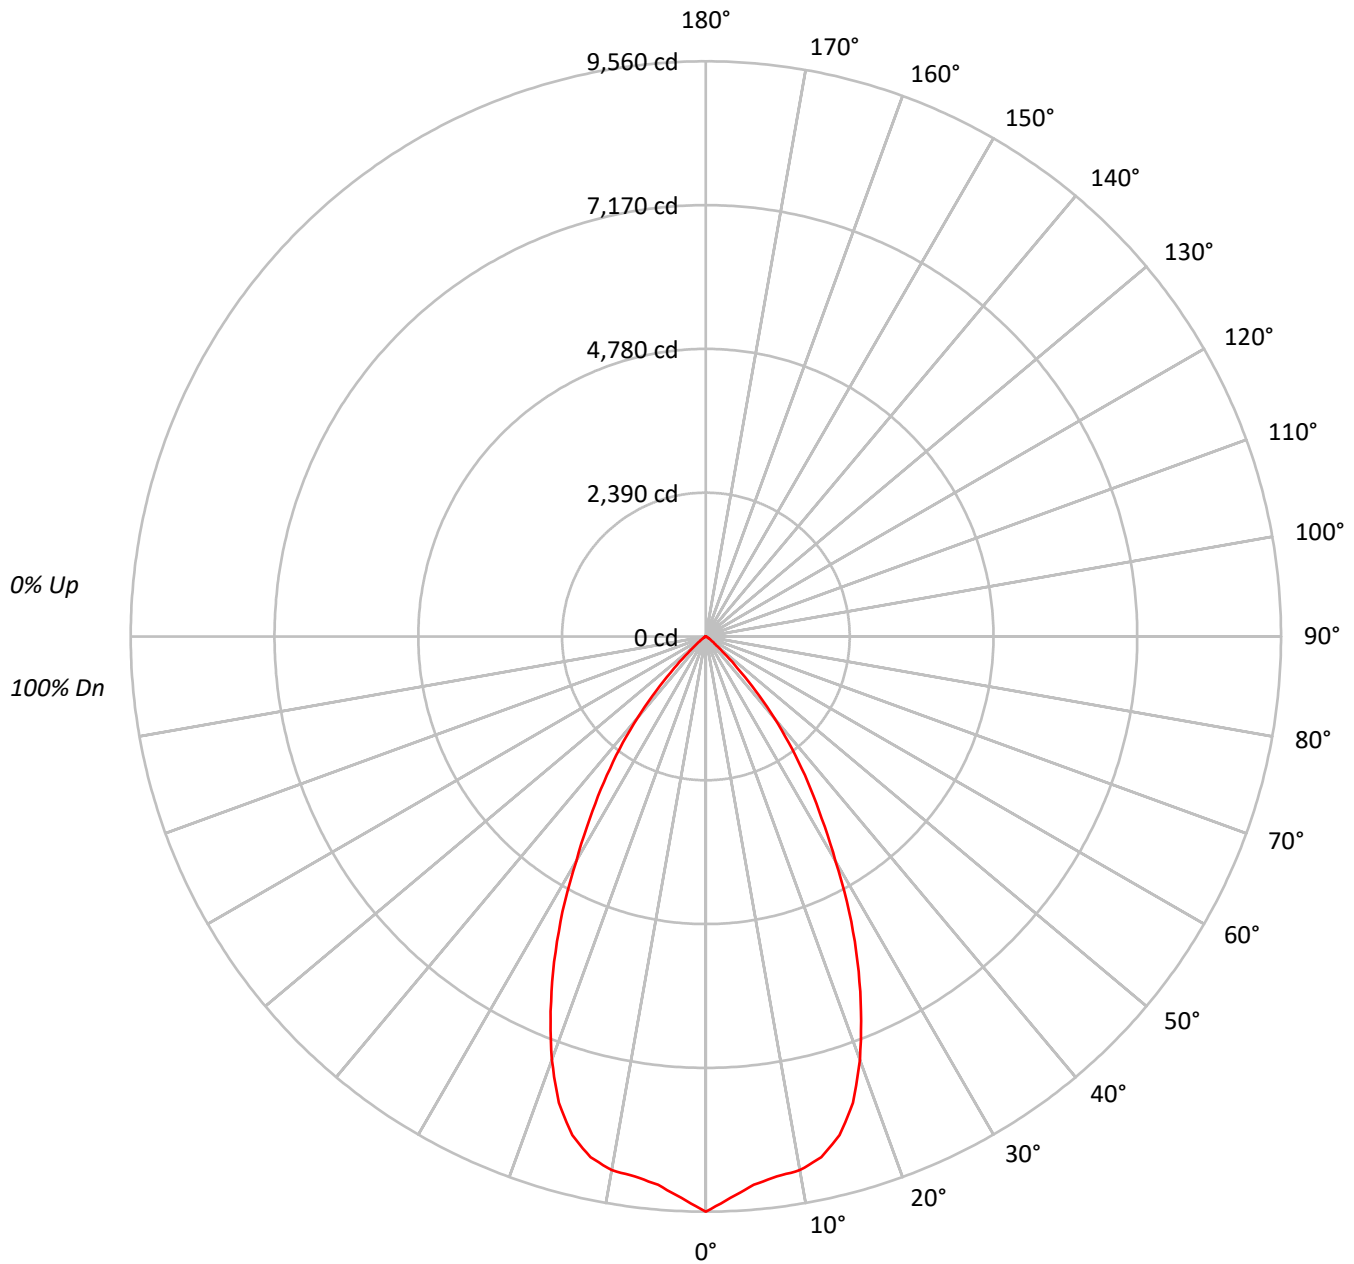



TEST NUMBER: P756504

CATALOG NUMBER: LD4D95BD010-EU4DR5570959024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74
7	83	74	68	64	82	73	67	63	72	67	63		71	66	63		70
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66
9	75	66	60	56	74	65	59	55	64	59	55		63	58	55		62
10	72	62	56	52	71	61	56	52	61	56	52		60	55	52		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1044577
5°	1003094
10°	999304
15°	970606
20°	870279
25°	719249
30°	543298
35°	393933
40°	252098
45°	115147
50°	37650
55°	16249
60°	6993
65°	931
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 115147 cd/sqm



TEST NUMBER: P756504

CATALOG NUMBER: LD4D95BD010-EU4DR5570959024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	870.3	10.2
10°-20°	2375.1	27.9
20°-30°	2706.7	31.7
30°-40°	1842.6	21.6
40°-50°	634.9	7.4
50°-60°	87.8	1.0
60°-70°	8.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5952.1	69.8
0°-40°	7794.7	91.4
0°-60°	8517.4	99.9
0°-90°	8525.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8525.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9560	
5°	9146	870
15°	8581	2375
25°	5966	2707
35°	2953	1843
45°	745	635
55°	85	88
65°	4	8
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P756504

CATALOG NUMBER: LD4D95BD010-EU4DR5570959024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	9560.4
2.5°	9341.2
5°	9145.8
7.5°	9049.8
10°	9007.1
12.5°	8865.0
15°	8580.7
17.5°	8129.3
20°	7484.8
22.5°	6740.8
25°	5966.1
27.5°	5159.3
30°	4306.3
32.5°	3583.7
35°	2953.4
37.5°	2354.0
40°	1767.5
42.5°	1225.0
45°	745.2
47.5°	401.6
50°	221.5
52.5°	131.5
55°	85.3
57.5°	54.5
60°	32.0
62.5°	14.2
65°	3.6
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)