

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756683

Luminaire Tested: LD4D95BD010-EU4DR6570959030-4LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P756683
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D95BD010-EU4DR6570959030-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6655.6 lumens
Efficiency: N/A
Efficacy: 67.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P756683

CATALOG NUMBER: LD4D95BD010-EU4DR6570959030-4LBDP1MW

Luminous Intensity Polar Plot

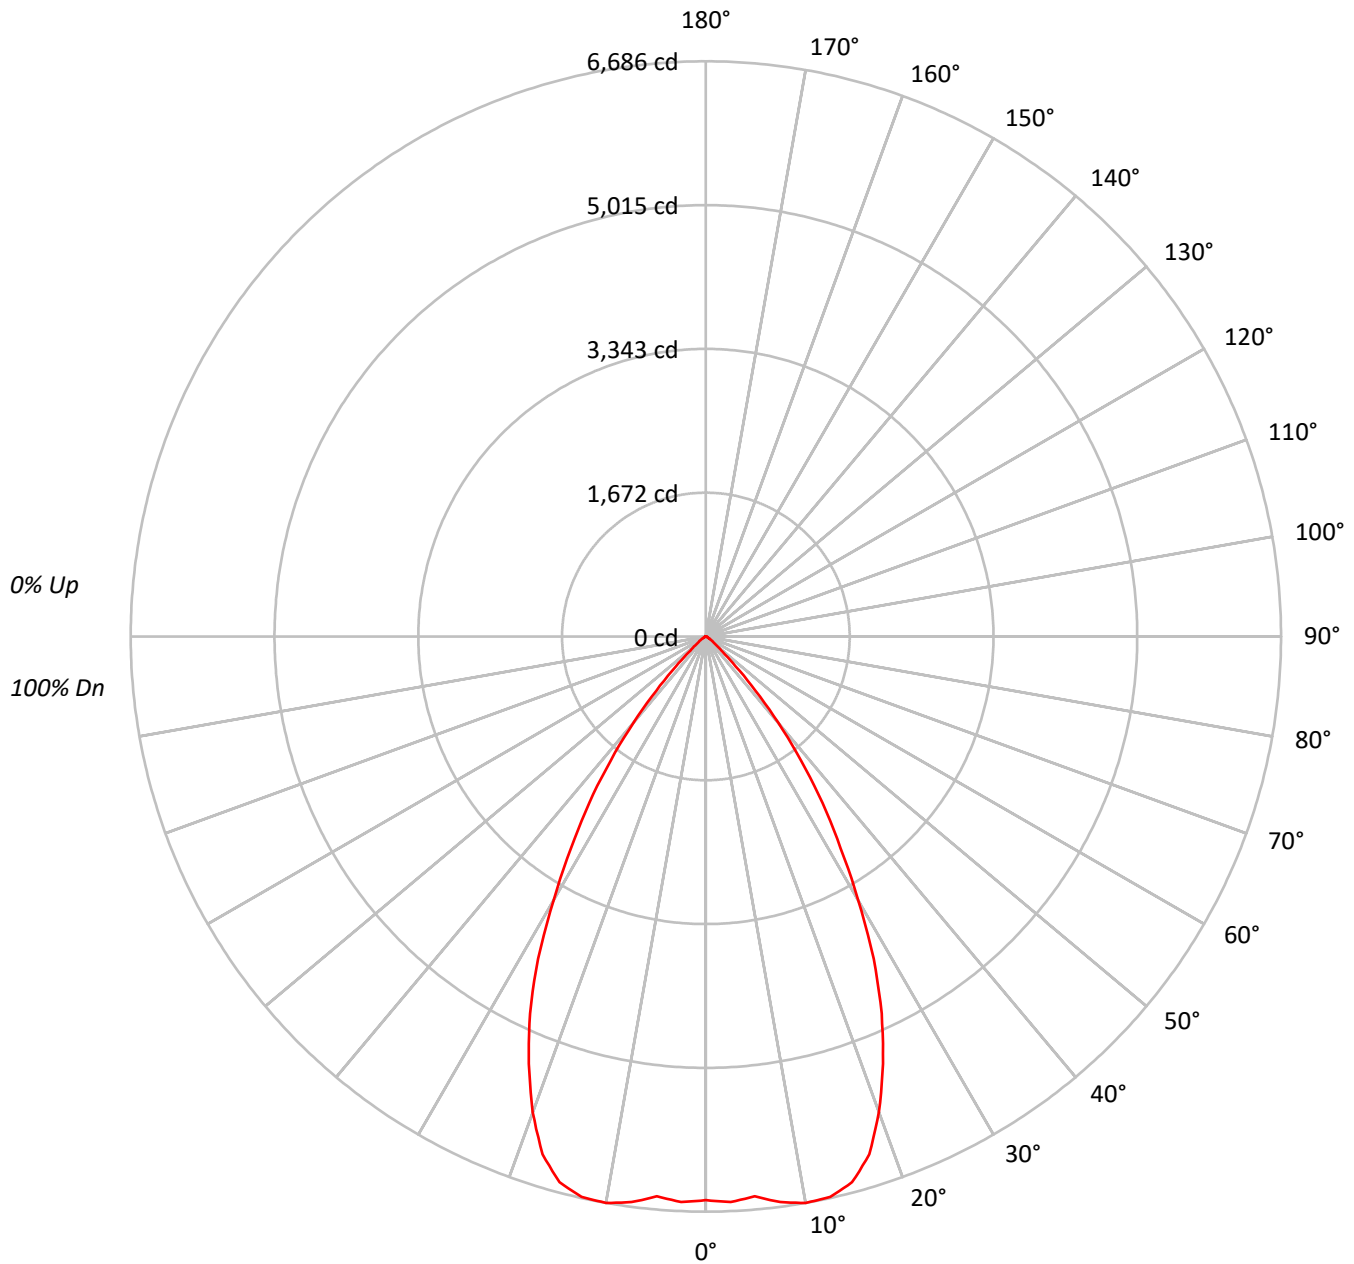



TEST NUMBER: P756683

CATALOG NUMBER: LD4D95BD010-EU4DR6570959030-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	113	111	108	106		111	108	106	104		104	103	101		101	99	98		97	96	95
2	108	103	99	95		106	101	97	94		98	95	92		95	92	90		92	90	88
3	102	96	91	87		100	94	90	86		92	88	85		89	86	83		87	84	82
4	97	89	84	79		95	88	83	79		86	82	78		84	80	77		82	79	76
5	92	83	78	73		90	83	77	73		81	76	72		79	75	72		77	74	71
6	87	78	72	68		86	77	72	68		76	71	67		74	70	67		73	69	66
7	83	73	67	63		81	73	67	63		71	66	62		70	66	62		69	65	62
8	79	69	63	59		77	68	63	59		67	62	58		66	62	58		65	61	58
9	75	65	59	55		74	65	59	55		64	58	55		63	58	55		62	58	54
10	71	61	56	52		70	61	55	52		60	55	51		59	55	51		59	54	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	715975
5°	716571
10°	741798
15°	743030
20°	684080
25°	582876
30°	446202
35°	315237
40°	186075
45°	75544
50°	27384
55°	15258
60°	8741
65°	4809
70°	5047
75°	3926
80°	4090
85°	3510

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 75544 cd/sqm



TEST NUMBER: P756683

CATALOG NUMBER: LD4D95BD010-EU4DR6570959030-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	631.0	9.5
10°-20°	1820.1	27.3
20°-30°	2183.8	32.8
30°-40°	1467.6	22.1
40°-50°	439.3	6.6
50°-60°	77.5	1.2
60°-70°	22.0	0.3
70°-80°	10.8	0.2
80°-90°	3.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4634.9	69.6
0°-40°	6102.5	91.7
0°-60°	6619.4	99.5
0°-90°	6655.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6655.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6553	
5°	6533	631
15°	6569	1820
25°	4835	2184
35°	2363	1468
45°	489	439
55°	80	78
65°	19	22
75°	9	11
85°	3	3
90°	0	



TEST NUMBER: P756683

CATALOG NUMBER: LD4D95BD010-EU4DR6570959030-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	6552.9
2.5°	6580.9
5°	6533.4
7.5°	6632.1
10°	6686.1
12.5°	6673.1
15°	6568.8
17.5°	6313.6
20°	5883.4
22.5°	5376.8
25°	4834.9
27.5°	4223.0
30°	3536.7
32.5°	2914.7
35°	2363.4
37.5°	1818.7
40°	1304.6
42.5°	852.1
45°	488.9
47.5°	258.9
50°	161.1
52.5°	111.7
55°	80.1
57.5°	57.7
60°	40.0
62.5°	26.1
65°	18.6
67.5°	16.8
70°	15.8
72.5°	12.1
75°	9.3
77.5°	8.4
80°	6.5
82.5°	4.7
85°	2.8
87.5°	1.9
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)