

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P756255

Luminaire Tested: LD4D95BD010-EU4DR3570959050-4LBS1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P756255
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D95BD010-EU4DR3570959050-4LBS1B
Description: 4 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8772.9 lumens
Efficiency: N/A
Efficacy: 88.4 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P756255

CATALOG NUMBER: LD4D95BD010-EU4DR3570959050-4LBS1B

Luminous Intensity Polar Plot

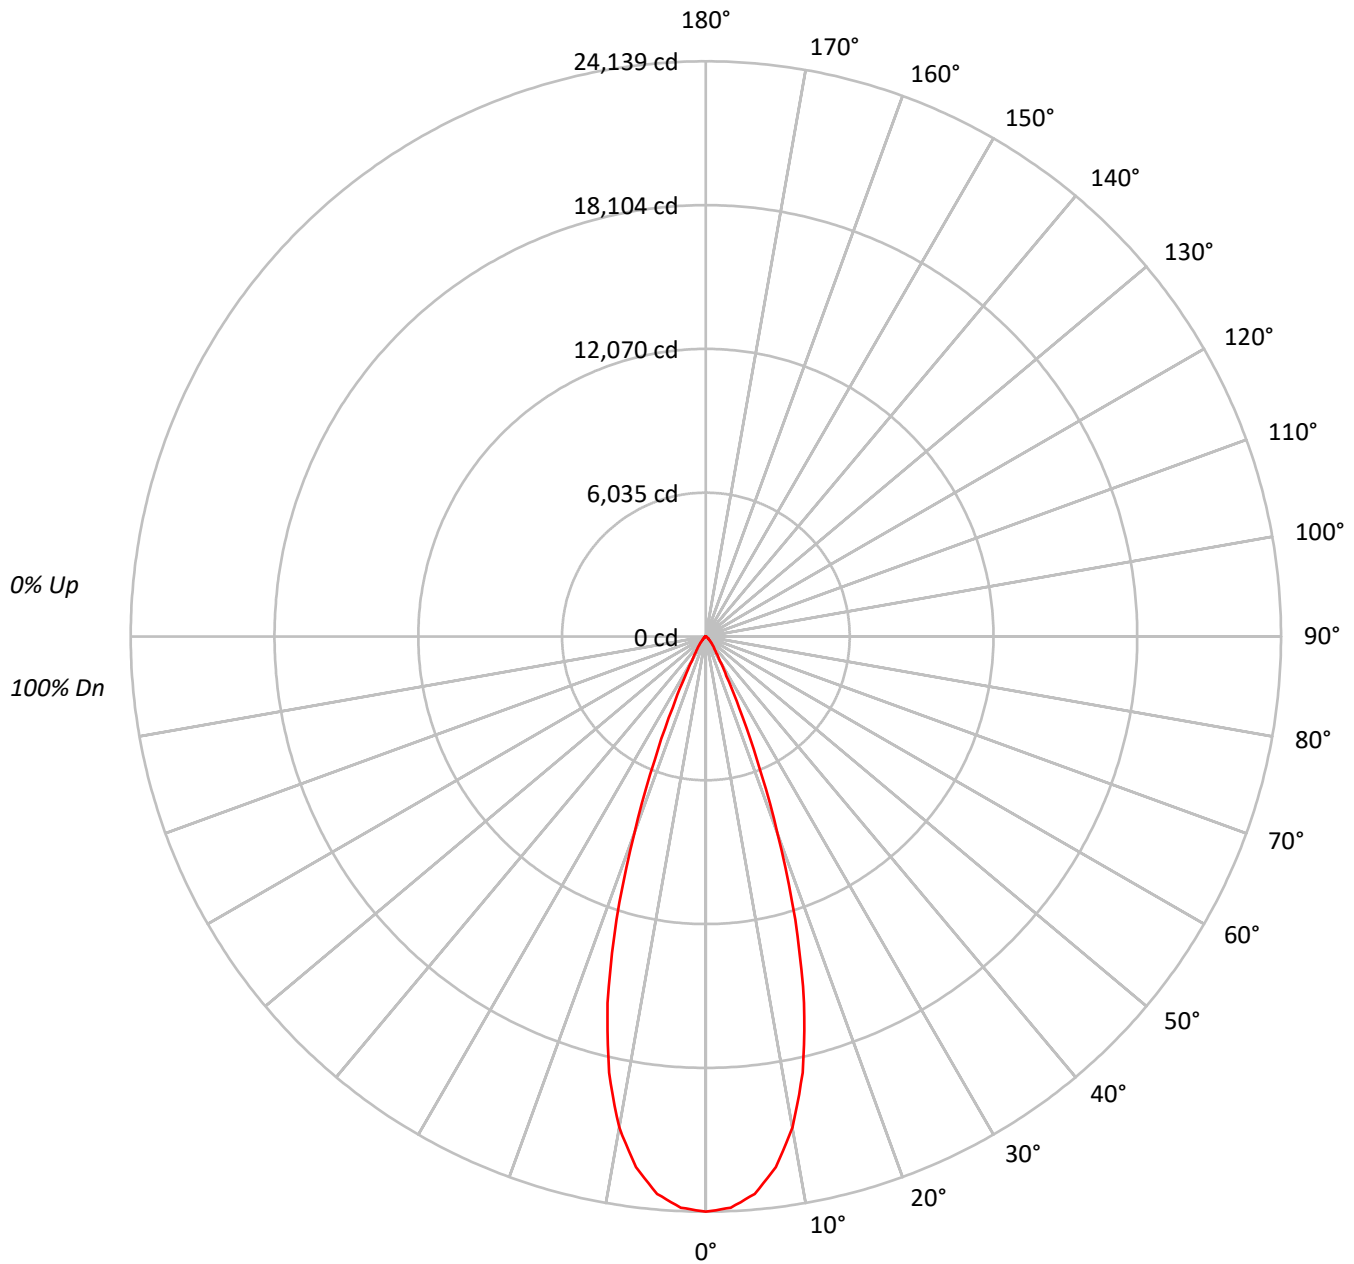



TEST NUMBER: P756255

CATALOG NUMBER: LD4D95BD010-EU4DR3570959050-4LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	115	112	110	108		112	110	108	107		106	105	103		103	101	100		99	98	98
2	110	106	103	101		108	105	102	99		102	99	97		99	97	95		96	95	93
3	106	101	97	94		105	100	96	93		97	95	92		95	93	91		93	91	89
4	103	97	92	89		101	96	92	89		94	90	88		92	89	87		90	88	86
5	99	93	88	85		98	92	87	84		90	86	84		89	85	83		87	84	82
6	96	89	84	81		94	88	84	81		87	83	80		85	82	80		84	81	79
7	93	85	81	78		91	85	80	77		84	80	77		83	79	77		82	79	76
8	90	82	78	74		88	82	77	74		81	77	74		80	76	74		79	76	73
9	87	79	75	72		86	79	75	72		78	74	71		77	74	71		77	73	71
10	84	77	72	69		83	76	72	69		76	72	69		75	71	69		74	71	69

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2637402
5°	2575429
10°	2321140
15°	1801584
20°	1021829
25°	397545
30°	148305
35°	81297
40°	53130
45°	32341
50°	20585
55°	14553
60°	10642
65°	5791
70°	415
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 32341 cd/sqm



TEST NUMBER: P756255

CATALOG NUMBER: LD4D95BD010-EU4DR3570959050-4LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2159.6	24.6
10°-20°	4216.5	48.1
20°-30°	1719.7	19.6
30°-40°	411.5	4.7
40°-50°	171.5	2.0
50°-60°	71.0	0.8
60°-70°	22.2	0.3
70°-80°	0.5	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8095.8	92.3
0°-40°	8507.3	97.0
0°-60°	8749.9	99.7
0°-90°	8772.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8772.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	24139	
5°	23482	###
15°	15927	4217
25°	3298	1720
35°	610	412
45°	209	172
55°	76	71
65°	22	22
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P756255

CATALOG NUMBER: LD4D95BD010-EU4DR3570959050-4LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	24138.6
2.5°	23993.8
5°	23481.7
7.5°	22460.2
10°	20921.3
12.5°	18754.6
15°	15927.0
17.5°	12468.8
20°	8788.2
22.5°	5603.9
25°	3297.6
27.5°	1864.0
30°	1175.5
32.5°	825.4
35°	609.5
37.5°	471.3
40°	372.5
42.5°	287.0
45°	209.3
47.5°	156.7
50°	121.1
52.5°	96.1
55°	76.4
57.5°	61.9
60°	48.7
62.5°	35.5
65°	22.4
67.5°	7.9
70°	1.3
72.5°	1.3
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.3
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report







(END OF REPORT)