

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P779318

Luminaire Tested: LER4D08D010-EC4DR450210IC9030-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P779318
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4D08D010-EC4DR450210IC9030-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 846.2 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P779318

CATALOG NUMBER: LER4D08D010-EC4DR450210IC9030-4LBS1LI

Luminous Intensity Polar Plot

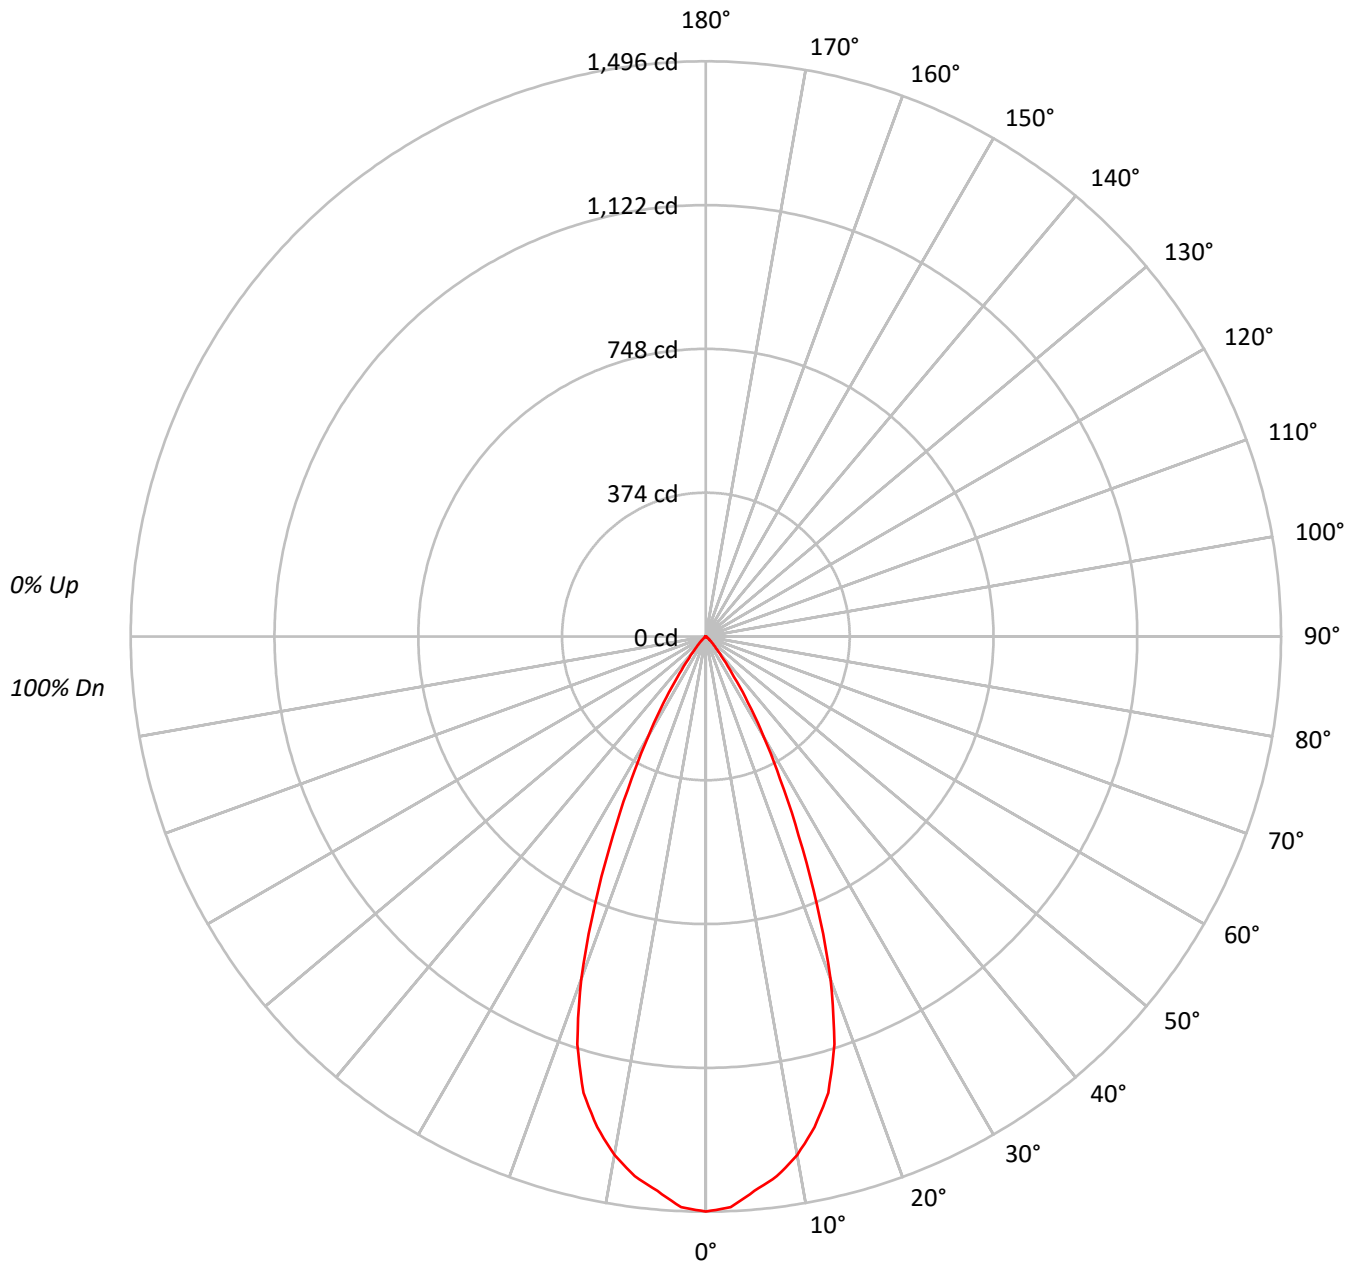



TEST NUMBER: P779318

CATALOG NUMBER: LER4D08D010-EC4DR450210IC9030-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		98
2	109	105	102	99	107	103	100	98	100	98	95		97	95	93		95
3	105	99	95	91	103	98	94	91	95	92	89		93	90	88		91
4	100	94	89	85	99	93	88	85	91	87	84		89	86	83		87
5	96	89	84	80	95	88	83	80	86	82	79		85	81	79		83
6	92	85	80	76	91	84	79	76	83	78	75		81	77	75		80
7	89	81	75	72	87	80	75	72	79	74	71		78	74	71		77
8	85	77	72	68	84	76	71	68	75	71	68		74	70	67		73
9	82	73	68	65	81	73	68	65	72	68	65		71	67	64		71
10	79	70	65	62	78	70	65	62	69	65	62		68	64	61		68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	163421
5°	158770
10°	151897
15°	139018
20°	110296
25°	68862
30°	37950
35°	17046
40°	6704
45°	3168
50°	1496
55°	781
60°	393
65°	78
70°	32
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3168 cd/sqm



TEST NUMBER: P779318

CATALOG NUMBER: LER4D08D010-EC4DR450210IC9030-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	136.0	16.1
10°-20°	334.8	39.6
20°-30°	265.1	31.3
30°-40°	88.3	10.4
40°-50°	17.5	2.1
50°-60°	4.0	0.5
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	735.9	87.0
0°-40°	824.1	97.4
0°-60°	845.6	99.9
0°-90°	846.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	846.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1496	
5°	1448	136
15°	1229	335
25°	571	265
35°	128	88
45°	20	18
55°	4	4
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P779318

CATALOG NUMBER: LER4D08D010-EC4DR450210IC9030-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1495.7
2.5°	1485.9
5°	1447.6
7.5°	1415.9
10°	1369.1
12.5°	1306.8
15°	1229.0
17.5°	1112.1
20°	948.6
22.5°	753.7
25°	571.2
27.5°	418.2
30°	300.8
32.5°	204.6
35°	127.8
37.5°	75.7
40°	47.0
42.5°	30.9
45°	20.5
47.5°	13.2
50°	8.8
52.5°	5.9
55°	4.1
57.5°	2.7
60°	1.8
62.5°	0.9
65°	0.3
67.5°	0.1
70°	0.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)