

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P781395

Luminaire Tested: LER4D40BD010-EC4DR6040509050-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P781395
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4D40BD010-EC4DR6040509050-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4020.6 lumens
Efficiency: N/A
Efficacy: 114.2 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P781395

CATALOG NUMBER: LER4D40BD010-EC4DR6040509050-4LBS1MW

Luminous Intensity Polar Plot

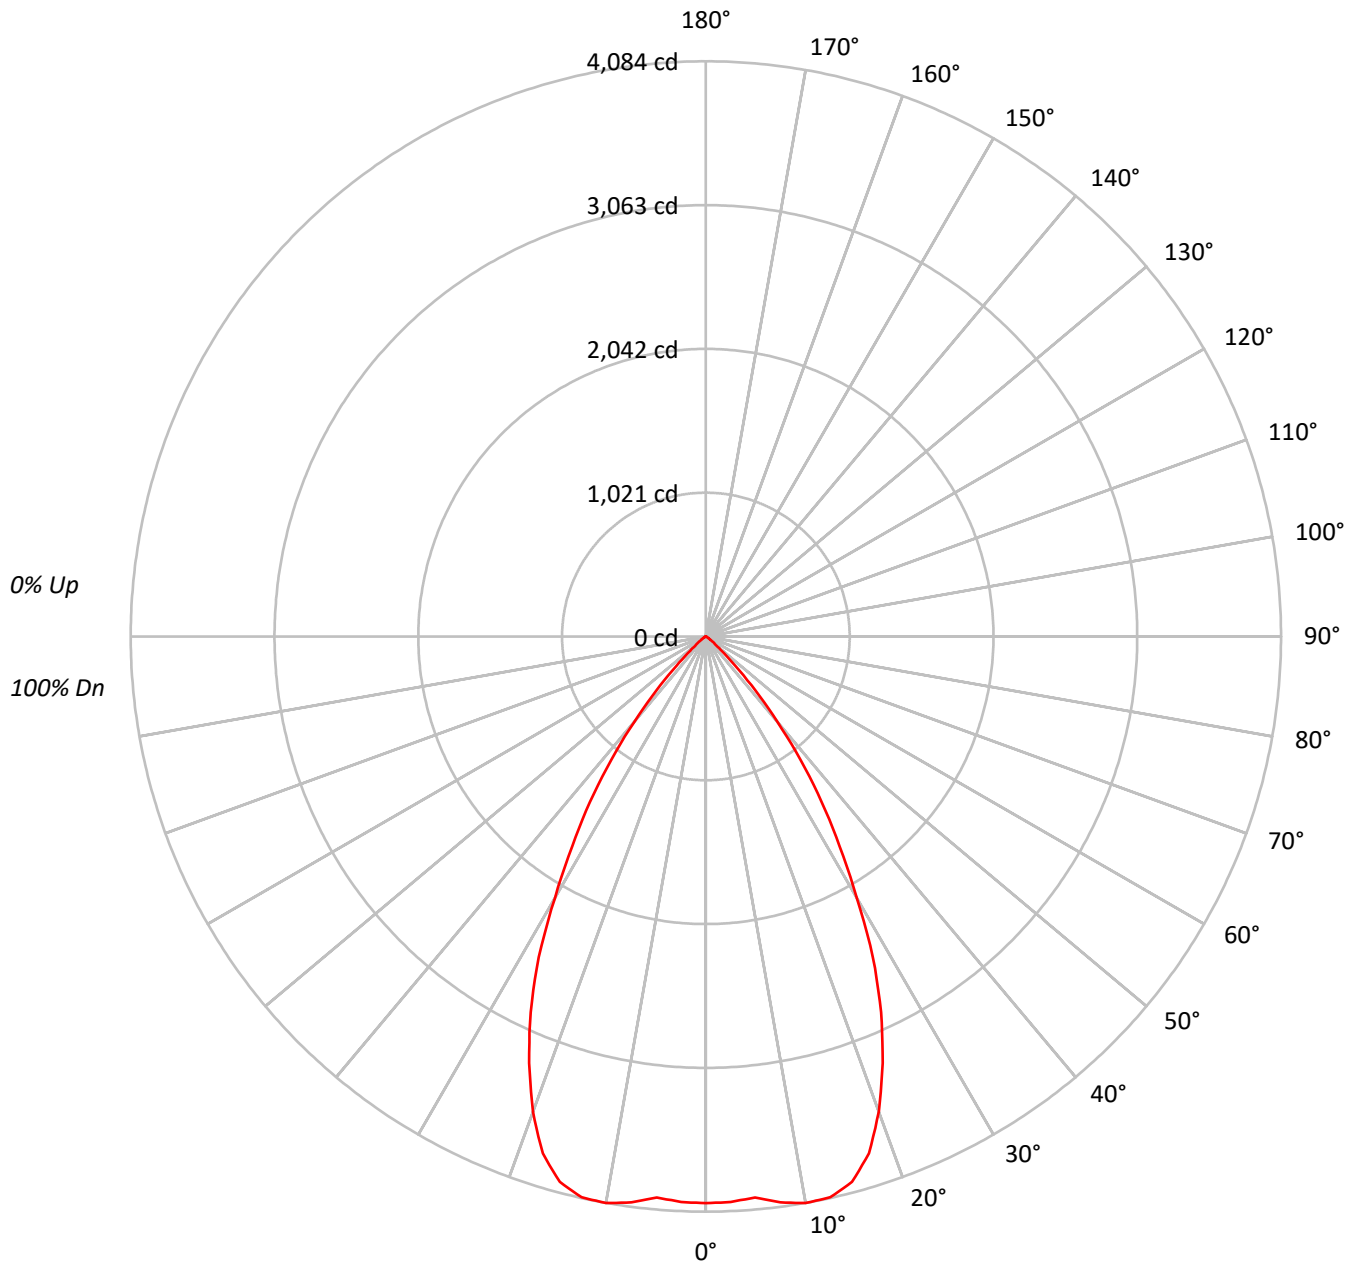



TEST NUMBER: P781395

CATALOG NUMBER: LER4D40BD010-EC4DR6040509050-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78
6	87	79	73	68	86	78	72	68	76	71	68		75	70	67		74
7	83	74	68	63	82	73	67	63	72	67	63		71	66	63		69
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66
9	75	65	59	55	74	65	59	55	64	59	55		63	58	55		62
10	72	62	56	52	71	61	56	52	61	55	52		60	55	52		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	439611
5°	438537
10°	453105
15°	453569
20°	417338
25°	354977
30°	270482
35°	191271
40°	112321
45°	45320
50°	15128
55°	7277
60°	2994
65°	440
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 45320 cd/sqm

TEST NUMBER: P781395

CATALOG NUMBER: LER4D40BD010-EC4DR6040509050-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	385.7	9.6
10°-20°	1110.9	27.6
20°-30°	1329.6	33.1
30°-40°	889.3	22.1
40°-50°	263.7	6.6
50°-60°	37.9	0.9
60°-70°	3.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2826.1	70.3
0°-40°	3715.4	92.4
0°-60°	4017.0	99.9
0°-90°	4020.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4020.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4024	
5°	3998	386
15°	4010	1111
25°	2944	1330
35°	1434	889
45°	293	264
55°	38	38
65°	2	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P781395

CATALOG NUMBER: LER4D40BD010-EC4DR6040509050-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	4023.5
2.5°	4018.4
5°	3998.4
7.5°	4052.6
10°	4084.0
12.5°	4078.3
15°	4009.8
17.5°	3848.3
20°	3589.3
22.5°	3278.3
25°	2944.5
27.5°	2568.4
30°	2143.9
32.5°	1765.0
35°	1434.0
37.5°	1102.5
40°	787.5
42.5°	519.3
45°	293.3
47.5°	150.1
50°	89.0
52.5°	57.6
55°	38.2
57.5°	24.5
60°	13.7
62.5°	5.7
65°	1.7
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)