

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P781438

Luminaire Tested: LER4D40BD010-EC4DR7040509040-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P781438
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4D40BD010-EC4DR7040509040-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4439.6 lumens
Efficiency: N/A
Efficacy: 126.1 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P781438

CATALOG NUMBER: LER4D40BD010-EC4DR7040509040-4LBS1LI

Luminous Intensity Polar Plot

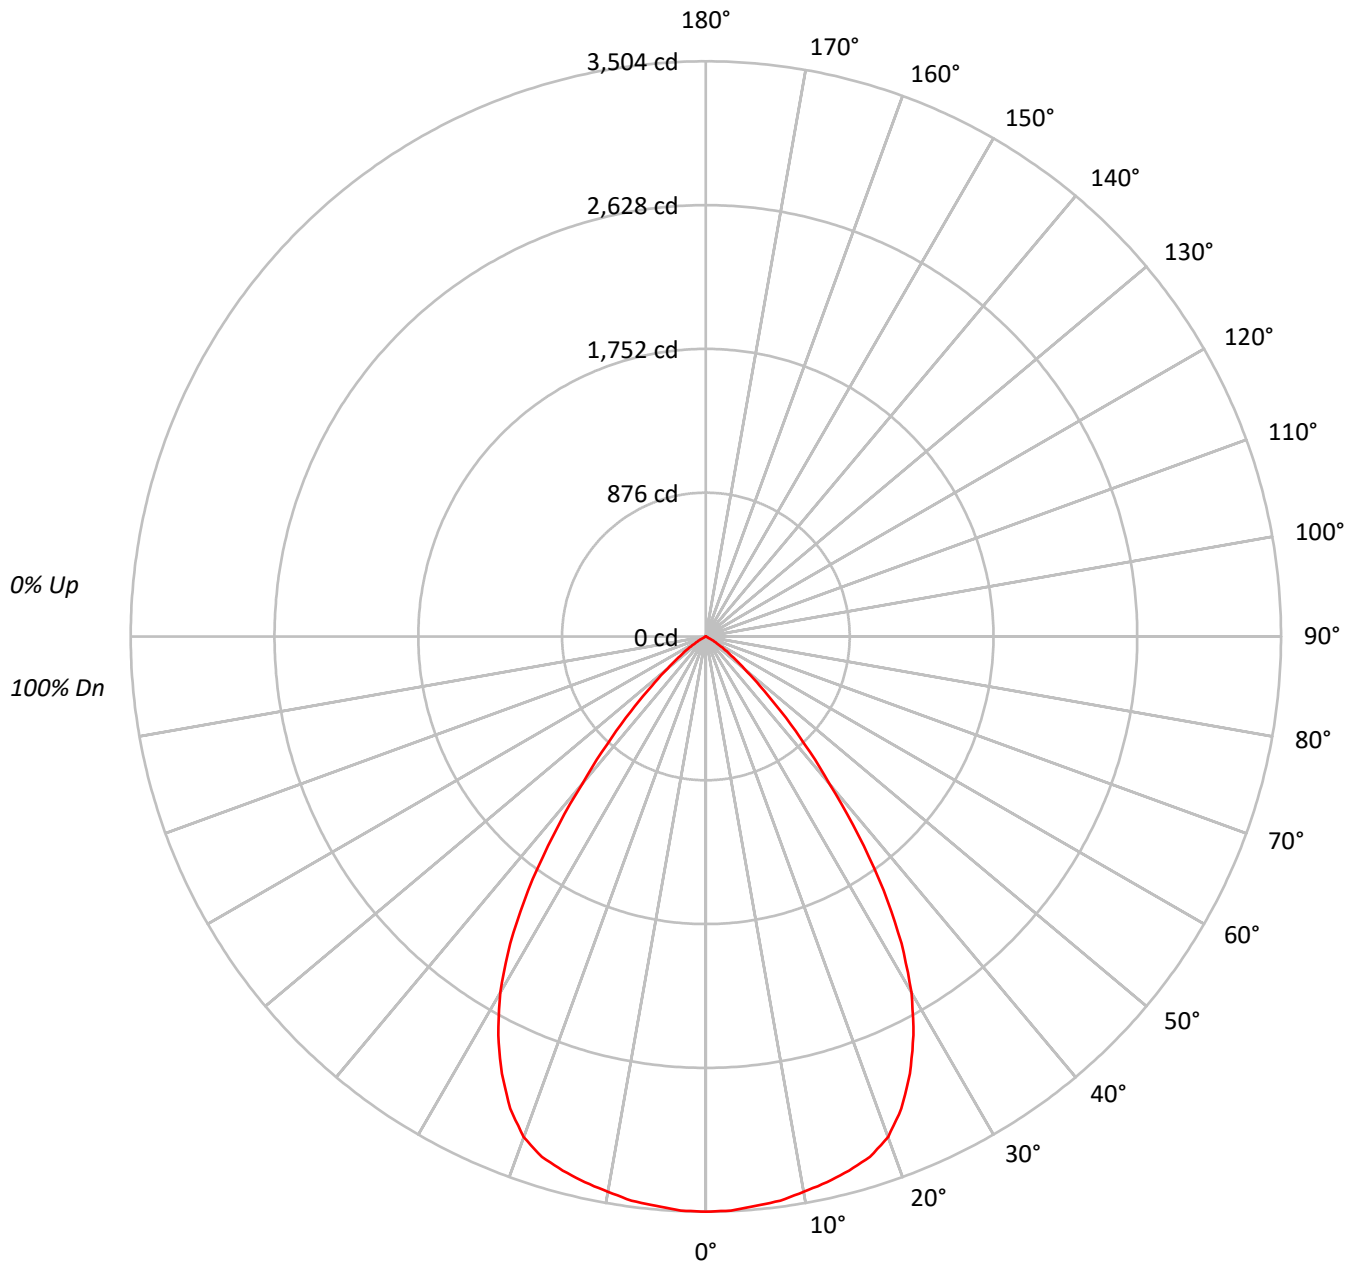



TEST NUMBER: P781438

CATALOG NUMBER: LER4D40BD010-EC4DR7040509040-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	111	108	106	103	104	102	100		100	99	97		97
2	107	102	97	94	105	100	96	92	97	93	90		94	91	88		91
3	101	94	88	84	99	92	87	83	90	85	82		87	84	81		85
4	95	87	81	76	93	86	80	76	83	78	75		81	77	74		79
5	89	80	74	69	88	79	73	69	78	72	68		76	71	68		74
6	84	75	68	63	83	74	68	63	72	67	63		71	66	62		69
7	80	69	63	58	78	69	62	58	67	62	58		66	61	57		65
8	75	65	58	54	74	64	58	54	63	57	53		62	57	53		61
9	71	61	54	50	70	60	54	50	59	53	50		58	53	49		57
10	67	57	50	46	66	56	50	46	55	50	46		55	50	46		54

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	382861
5°	381899
10°	381078
15°	380972
20°	377247
25°	354374
30°	315926
35°	251893
40°	167248
45°	99989
50°	51844
55°	27240
60°	9637
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 99989 cd/sqm



TEST NUMBER: P781438

CATALOG NUMBER: LER4D40BD010-EC4DR7040509040-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	331.1	7.5
10°-20°	949.7	21.4
20°-30°	1339.8	30.2
30°-40°	1156.6	26.1
40°-50°	517.9	11.7
50°-60°	135.6	3.1
60°-70°	8.8	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2620.6	59.0
0°-40°	3777.2	85.1
0°-60°	4430.7	99.8
0°-90°	4439.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4439.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3504	
5°	3482	331
15°	3368	950
25°	2940	1340
35°	1888	1157
45°	647	518
55°	143	136
65°	1	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P781438

CATALOG NUMBER: LER4D40BD010-EC4DR7040509040-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3504.1
2.5°	3500.3
5°	3482.0
7.5°	3466.9
10°	3434.8
12.5°	3405.8
15°	3368.0
17.5°	3324.5
20°	3244.5
22.5°	3112.8
25°	2939.5
27.5°	2738.5
30°	2504.1
32.5°	2217.4
35°	1888.5
37.5°	1525.5
40°	1172.6
42.5°	891.0
45°	647.1
47.5°	446.1
50°	305.0
52.5°	210.5
55°	143.0
57.5°	86.3
60°	44.1
62.5°	13.9
65°	0.6
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)