

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P781521

Luminaire Tested: LER4D45BD010-EC4DR4040509027-4LBS1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P781521
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4D45BD010-EC4DR4040509027-4LBS1H
Description: 4 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4395.5 lumens
Efficiency: N/A
Efficacy: 113.6 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P781521

CATALOG NUMBER: LER4D45BD010-EC4DR4040509027-4LBS1H

Luminous Intensity Polar Plot

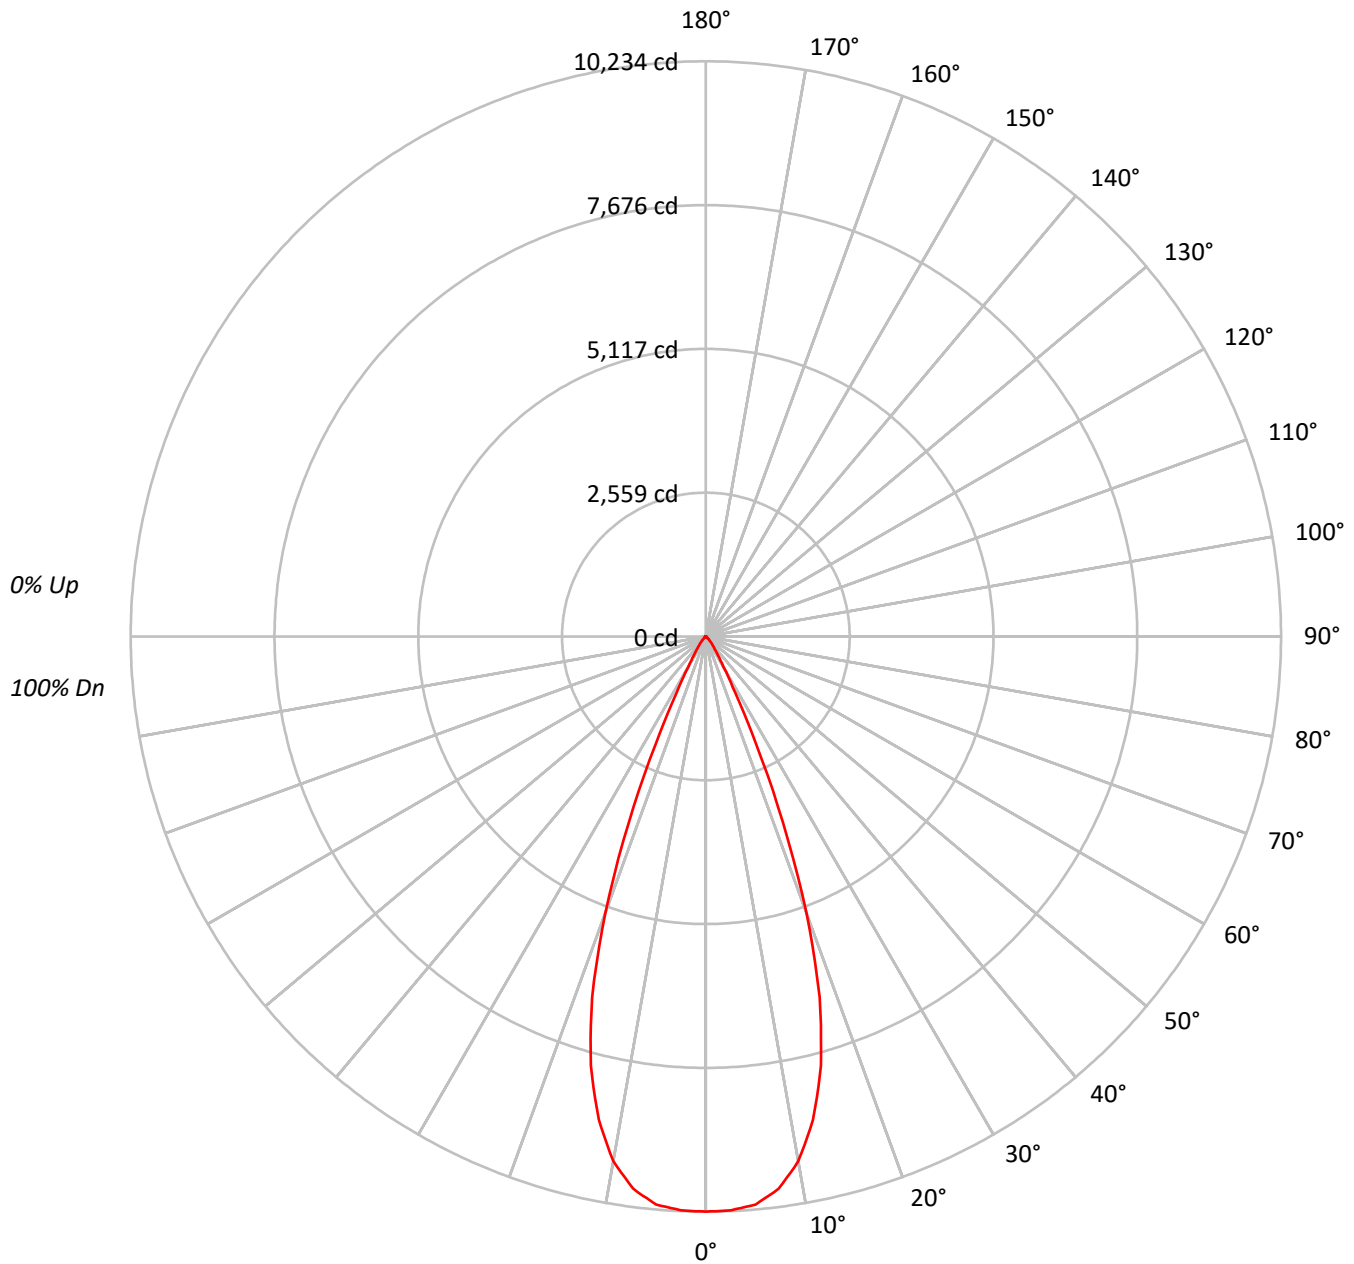

TEST NUMBER: P781521

CATALOG NUMBER: LER4D45BD010-EC4DR4040509027-4LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	112	110	108	112	110	108	107	106	105	103		103	101	100		99
2	110	106	103	100	108	105	102	99	102	99	97		99	97	95		96
3	106	101	97	94	104	100	96	93	97	94	92		95	93	90		93
4	102	97	92	89	101	95	91	88	93	90	87		92	89	86		90
5	99	92	88	84	97	91	87	84	90	86	83		88	85	83		87
6	95	88	84	80	94	88	83	80	86	82	80		85	82	79		84
7	92	85	80	77	91	84	80	77	83	79	76		82	79	76		81
8	89	82	77	74	88	81	77	74	80	76	73		79	76	73		78
9	86	79	74	71	85	78	74	71	77	73	71		76	73	70		76
10	83	76	71	68	82	75	71	68	75	71	68		74	70	68		73

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1118142
5°	1112706
10°	1051749
15°	894118
20°	609409
25°	254277
30°	79950
35°	37160
40°	20553
45°	9426
50°	4572
55°	2514
60°	1311
65°	465
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9426 cd/sqm



TEST NUMBER: P781521

CATALOG NUMBER: LER4D45BD010-EC4DR4040509027-4LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	947.3	21.6
10°-20°	2122.2	48.3
20°-30°	1062.3	24.2
30°-40°	194.7	4.4
40°-50°	53.7	1.2
50°-60°	12.6	0.3
60°-70°	2.4	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4131.8	94.0
0°-40°	4326.6	98.4
0°-60°	4393.0	99.9
0°-90°	4395.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4395.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10234	
5°	10145	947
15°	7904	2122
25°	2109	1062
35°	279	195
45°	61	54
55°	13	13
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P781521

CATALOG NUMBER: LER4D45BD010-EC4DR4040509027-4LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	10233.7
2.5°	10218.7
5°	10145.2
7.5°	9910.9
10°	9479.8
12.5°	8807.9
15°	7904.5
17.5°	6729.8
20°	5241.2
22.5°	3573.2
25°	2109.2
27.5°	1115.0
30°	633.7
32.5°	409.5
35°	278.6
37.5°	199.1
40°	144.1
42.5°	98.6
45°	61.0
47.5°	38.9
50°	26.9
52.5°	19.1
55°	13.2
57.5°	8.4
60°	6.0
62.5°	3.6
65°	1.8
67.5°	1.2
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)