

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P781743

Luminaire Tested: LER4D50D010-EC4DR3540509030-4LBS1MW

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P781743
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4D50D010-EC4DR3540509030-4LBS1MW
Description: 4 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4625.5 lumens
Efficiency: N/A
Efficacy: 98.4 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P781743

CATALOG NUMBER: LER4D50D010-EC4DR3540509030-4LBS1MW

Luminous Intensity Polar Plot

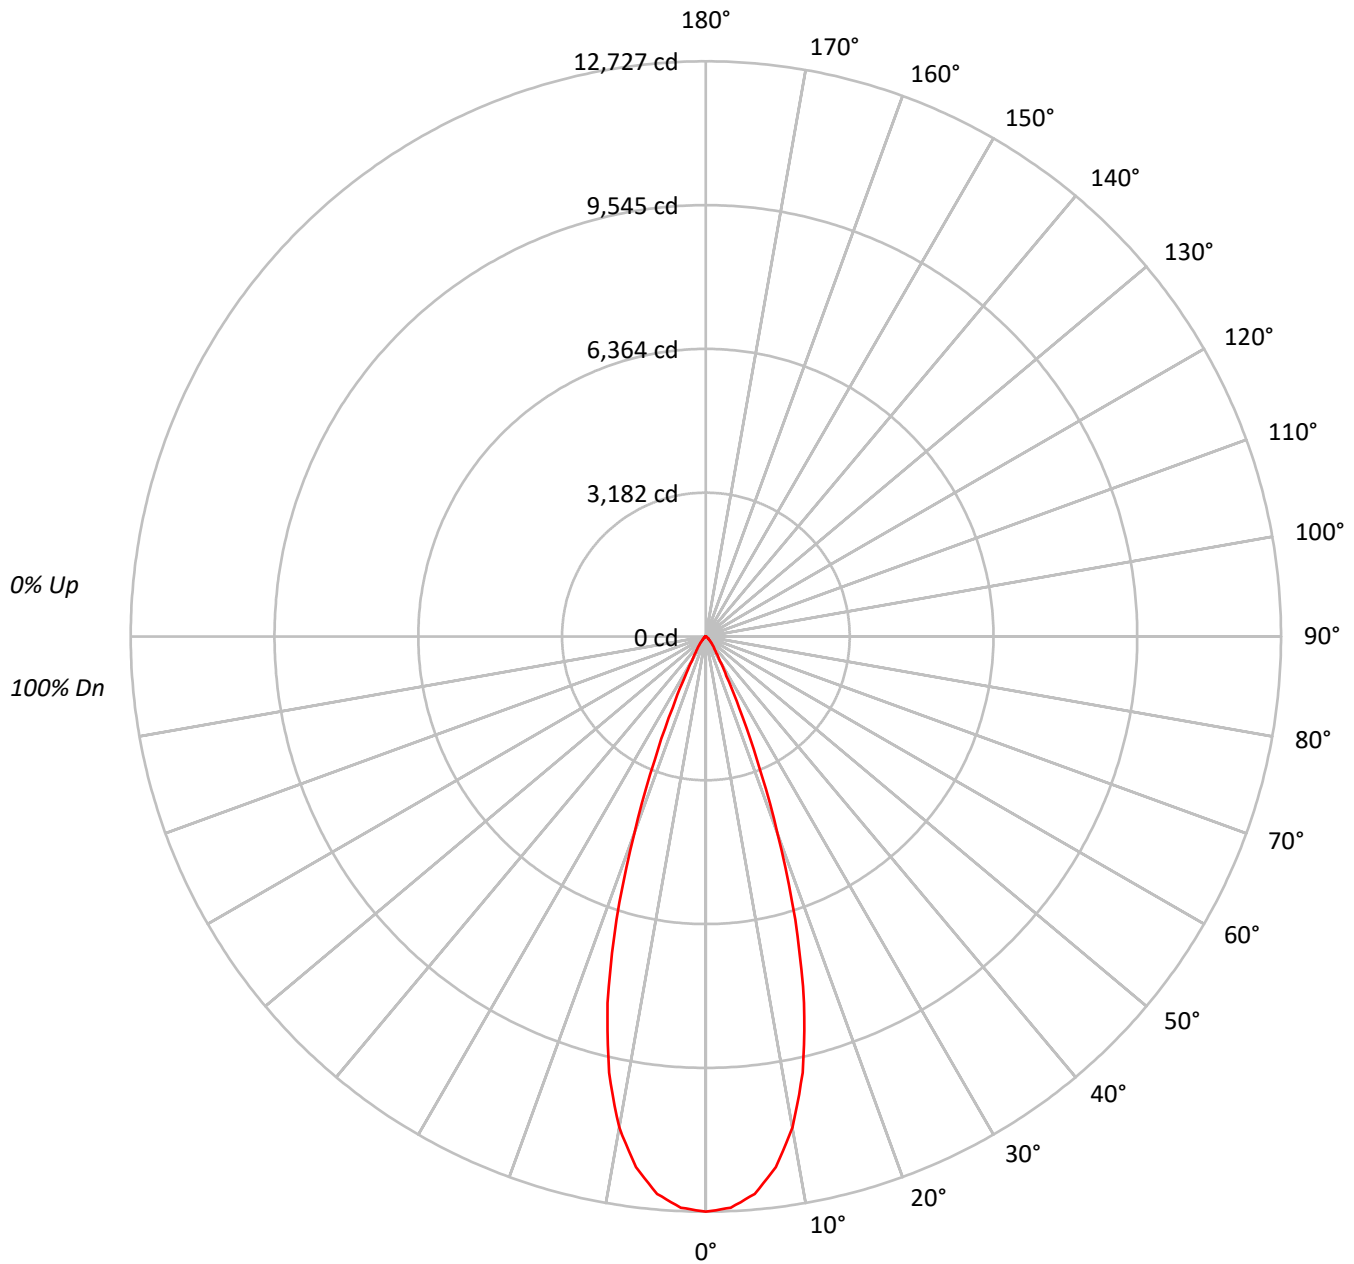



TEST NUMBER: P781743

CATALOG NUMBER: LER4D50D010-EC4DR3540509030-4LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	112	110	108	112	110	108	107	106	105	103		103	101	100		99
2	110	106	103	101	108	105	102	99	102	99	97		99	97	95		96
3	106	101	97	94	105	100	96	93	97	95	92		95	93	91		93
4	103	97	92	89	101	96	92	89	94	90	88		92	89	87		90
5	99	93	88	85	98	92	87	84	90	86	84		89	85	83		87
6	96	89	84	81	94	88	84	81	87	83	80		85	82	80		84
7	93	85	81	78	91	85	80	77	84	80	77		83	79	77		82
8	90	82	78	74	88	82	77	74	81	77	74		80	76	74		79
9	87	79	75	72	86	79	75	72	78	74	71		77	74	71		77
10	84	77	72	69	83	76	72	69	76	72	69		75	71	69		74

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1390529
5°	1357859
10°	1223793
15°	949861
20°	538750
25°	209598
30°	78196
35°	42856
40°	28012
45°	17059
50°	10862
55°	7677
60°	5616
65°	3051
70°	224
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 17059 cd/sqm



TEST NUMBER: P781743

CATALOG NUMBER: LER4D50D010-EC4DR3540509030-4LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1138.6	24.6
10°-20°	2223.1	48.1
20°-30°	906.7	19.6
30°-40°	217.0	4.7
40°-50°	90.4	2.0
50°-60°	37.4	0.8
60°-70°	11.7	0.3
70°-80°	0.3	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4268.4	92.3
0°-40°	4485.4	97.0
0°-60°	4613.3	99.7
0°-90°	4625.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4625.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12727	
5°	12380	###
15°	8397	2223
25°	1739	907
35°	321	217
45°	110	90
55°	40	37
65°	12	12
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P781743

CATALOG NUMBER: LER4D50D010-EC4DR3540509030-4LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	12726.7
2.5°	12650.4
5°	12380.4
7.5°	11841.8
10°	11030.5
12.5°	9888.1
15°	8397.3
17.5°	6574.0
20°	4633.5
22.5°	2954.6
25°	1738.6
27.5°	982.8
30°	619.8
32.5°	435.2
35°	321.3
37.5°	248.5
40°	196.4
42.5°	151.3
45°	110.4
47.5°	82.6
50°	63.9
52.5°	50.7
55°	40.3
57.5°	32.6
60°	25.7
62.5°	18.7
65°	11.8
67.5°	4.2
70°	0.7
72.5°	0.7
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.7
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)