

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P784572

Luminaire Tested: LER4DD35BD010-EC4DR6520359030-4LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P784572
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD35BD010-EC4DR6520359030-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2085.8 lumens
Efficiency: N/A
Efficacy: 67.7 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 30.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P784572

CATALOG NUMBER: LER4DD35BD010-EC4DR6520359030-4LBDP1B

Luminous Intensity Polar Plot

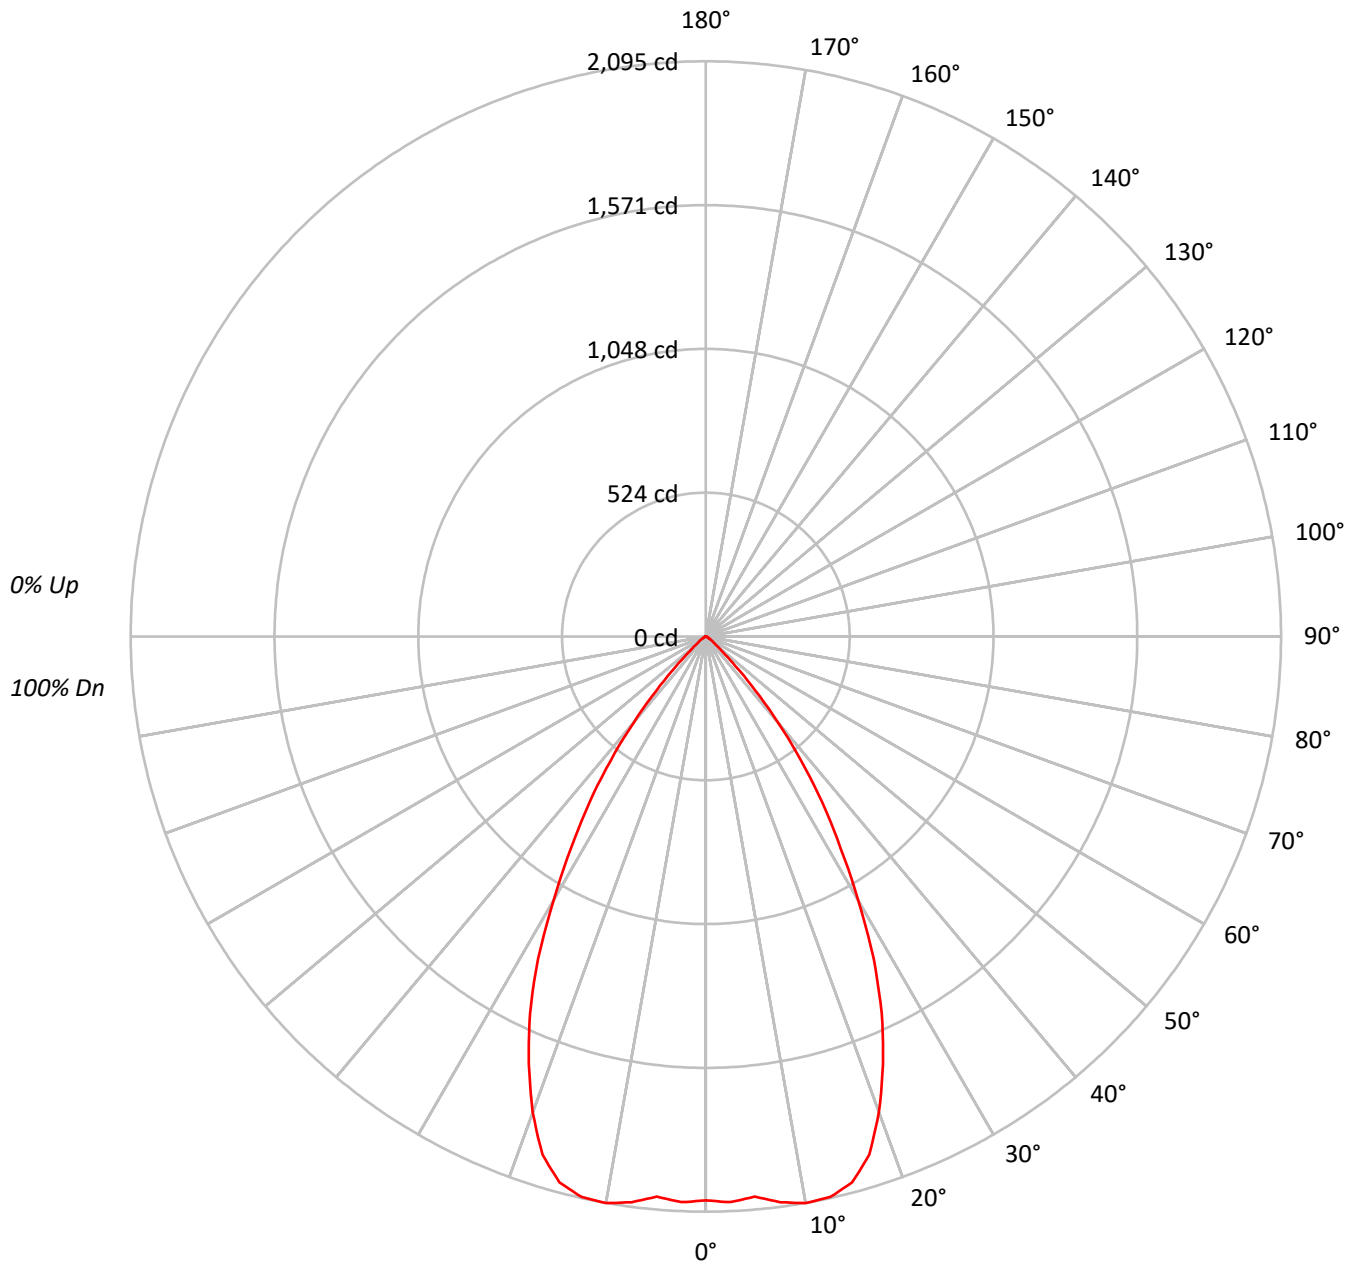

TEST NUMBER: P784572

CATALOG NUMBER: LER4DD35BD010-EC4DR6520359030-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	111	108	106	111	108	106	104	104	103	101		101	99	98		97
2	108	103	99	95	106	101	97	94	98	95	92		95	92	90		92
3	102	96	91	87	100	94	90	86	92	88	85		89	86	83		87
4	97	89	84	79	95	88	83	79	86	82	78		84	80	77		82
5	92	83	78	73	90	83	77	73	81	76	72		79	75	72		77
6	87	78	72	68	86	77	72	68	76	71	67		74	70	67		73
7	83	73	67	63	81	73	67	63	71	66	62		70	66	62		69
8	79	69	63	59	77	68	63	59	67	62	58		66	62	58		65
9	75	65	59	55	74	65	59	55	64	58	55		63	58	55		62
10	71	61	56	52	70	61	55	52	60	55	51		59	55	51		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	224378
5°	224566
10°	232477
15°	232859
20°	214384
25°	182666
30°	139840
35°	98797
40°	58321
45°	23672
50°	8584
55°	4781
60°	2732
65°	1499
70°	1597
75°	1224
80°	1258
85°	1128

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 23672 cd/sqm



TEST NUMBER: P784572

CATALOG NUMBER: LER4DD35BD010-EC4DR6520359030-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	197.7	9.5
10°-20°	570.4	27.3
20°-30°	684.4	32.8
30°-40°	459.9	22.1
40°-50°	137.7	6.6
50°-60°	24.3	1.2
60°-70°	6.9	0.3
70°-80°	3.4	0.2
80°-90°	1.1	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1452.6	69.6
0°-40°	1912.5	91.7
0°-60°	2074.5	99.5
0°-90°	2085.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2085.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2054	
5°	2048	198
15°	2059	570
25°	1515	684
35°	741	460
45°	153	138
55°	25	24
65°	6	7
75°	3	3
85°	1	1
90°	0	



TEST NUMBER: P784572

CATALOG NUMBER: LER4DD35BD010-EC4DR6520359030-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	2053.6
2.5°	2062.4
5°	2047.5
7.5°	2078.4
10°	2095.4
12.5°	2091.3
15°	2058.6
17.5°	1978.6
20°	1843.8
22.5°	1685.1
25°	1515.2
27.5°	1323.5
30°	1108.4
32.5°	913.4
35°	740.7
37.5°	570.0
40°	408.9
42.5°	267.0
45°	153.2
47.5°	81.1
50°	50.5
52.5°	35.0
55°	25.1
57.5°	18.1
60°	12.5
62.5°	8.2
65°	5.8
67.5°	5.3
70°	5.0
72.5°	3.8
75°	2.9
77.5°	2.6
80°	2.0
82.5°	1.5
85°	0.9
87.5°	0.6
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)