

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P784725

Luminaire Tested: LER4DD40BD010-EC4DR4540509040-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P784725
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD40BD010-EC4DR4540509040-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4075.6 lumens
Efficiency: N/A
Efficacy: 115.8 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 35.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P784725

CATALOG NUMBER: LER4DD40BD010-EC4DR4540509040-4LBDP1H

Luminous Intensity Polar Plot

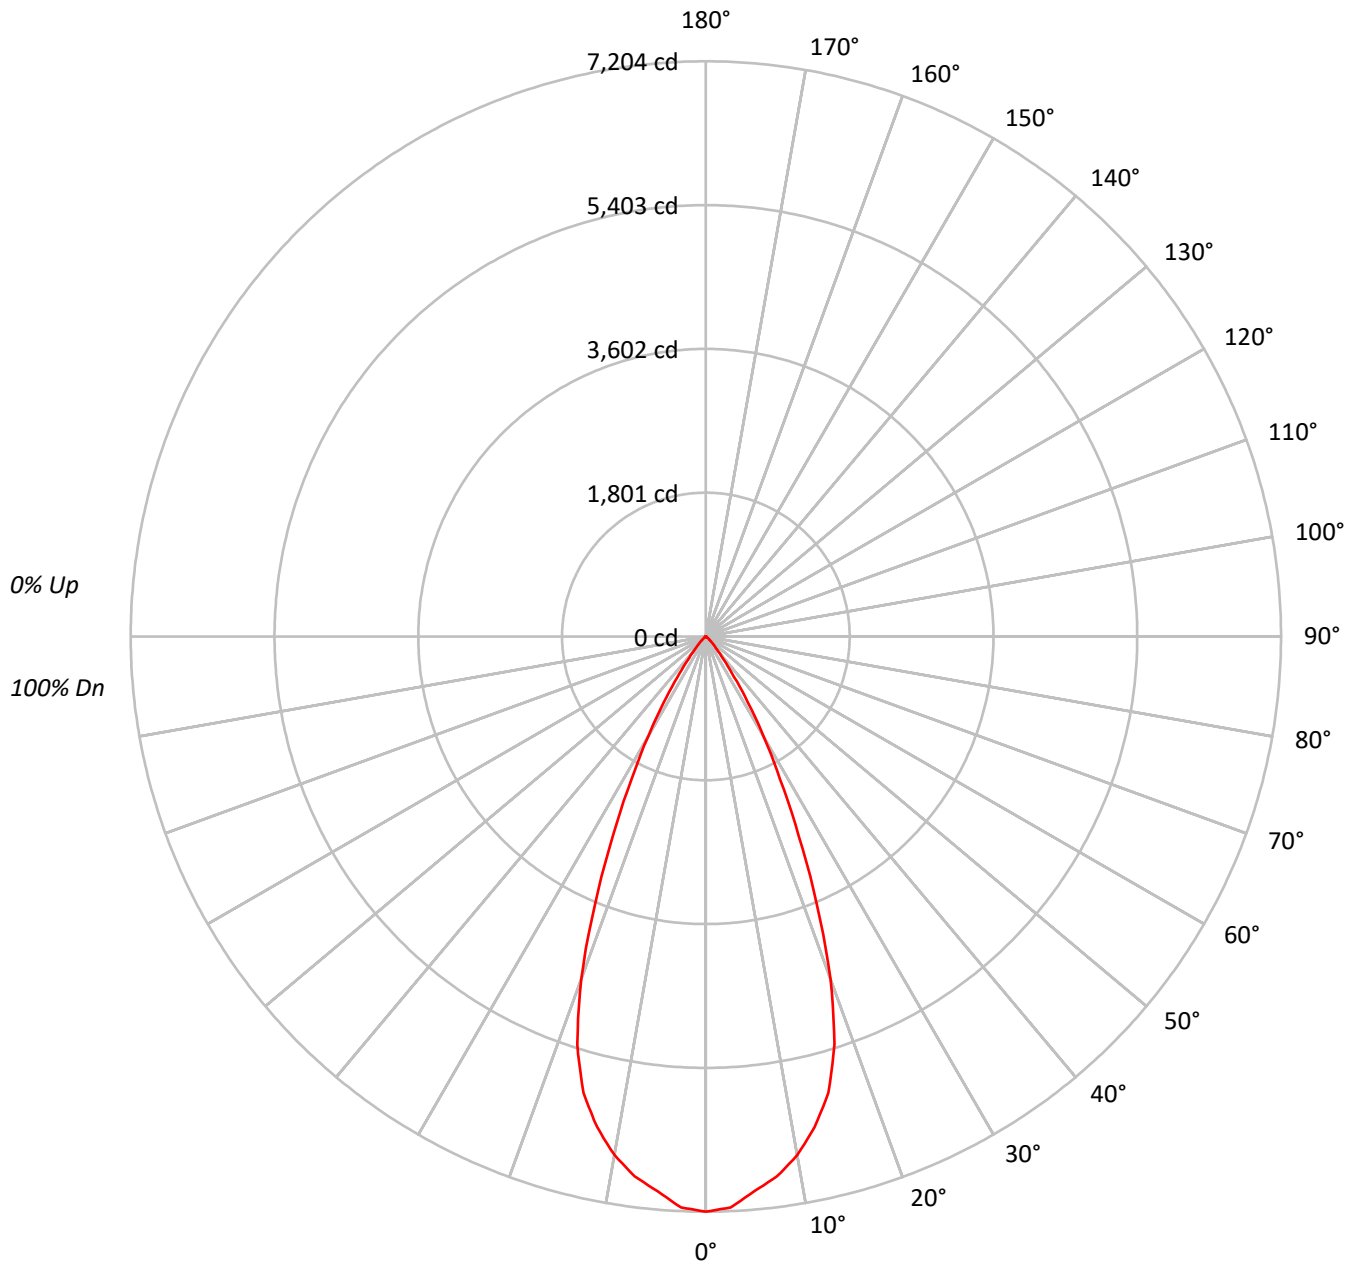

TEST NUMBER: P784725

CATALOG NUMBER: LER4DD40BD010-EC4DR4540509040-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		98
2	109	105	102	99	107	103	100	98	100	98	95		97	95	93		95
3	105	99	95	91	103	98	94	91	95	92	89		93	90	88		91
4	100	94	89	85	99	93	88	85	91	87	84		89	86	83		87
5	96	89	84	80	95	88	83	80	86	82	79		85	81	79		83
6	92	85	80	76	91	84	79	76	83	78	75		81	77	75		80
7	89	81	75	72	87	80	75	72	79	74	71		78	74	71		77
8	85	77	72	68	84	76	71	68	75	71	68		74	70	67		73
9	82	73	68	65	81	73	68	65	72	68	65		71	67	64		71
10	79	70	65	62	78	70	65	62	69	65	62		68	64	61		68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	787093
5°	764676
10°	731591
15°	669562
20°	531193
25°	331625
30°	182786
35°	82070
40°	32320
45°	15235
50°	7224
55°	3772
60°	1857
65°	440
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 15235 cd/sqm



TEST NUMBER: P784725

CATALOG NUMBER: LER4DD40BD010-EC4DR4540509040-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	655.1	16.1
10°-20°	1612.3	39.6
20°-30°	1276.7	31.3
30°-40°	425.2	10.4
40°-50°	84.4	2.1
50°-60°	19.1	0.5
60°-70°	2.8	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3544.1	87.0
0°-40°	3969.2	97.4
0°-60°	4072.8	99.9
0°-90°	4075.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4075.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7204	
5°	6972	655
15°	5919	1612
25°	2751	1277
35°	615	425
45°	99	84
55°	20	19
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P784725

CATALOG NUMBER: LER4DD40BD010-EC4DR4540509040-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	7203.8
2.5°	7156.7
5°	6972.0
7.5°	6819.6
10°	6594.1
12.5°	6293.8
15°	5919.3
17.5°	5356.1
20°	4568.5
22.5°	3630.2
25°	2750.8
27.5°	2014.3
30°	1448.8
32.5°	985.3
35°	615.3
37.5°	364.9
40°	226.6
42.5°	149.0
45°	98.6
47.5°	63.5
50°	42.5
52.5°	28.3
55°	19.8
57.5°	13.0
60°	8.5
62.5°	4.5
65°	1.7
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)