

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P784873

Luminaire Tested: LER4DD45BD010-EC4DR2540509050-4LBDP1H

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P784873
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD45BD010-EC4DR2540509050-4LBDP1H
Description: 4 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3922.5 lumens
Efficiency: N/A
Efficacy: 101.4 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P784873

CATALOG NUMBER: LER4DD45BD010-EC4DR2540509050-4LBDP1H

Luminous Intensity Polar Plot

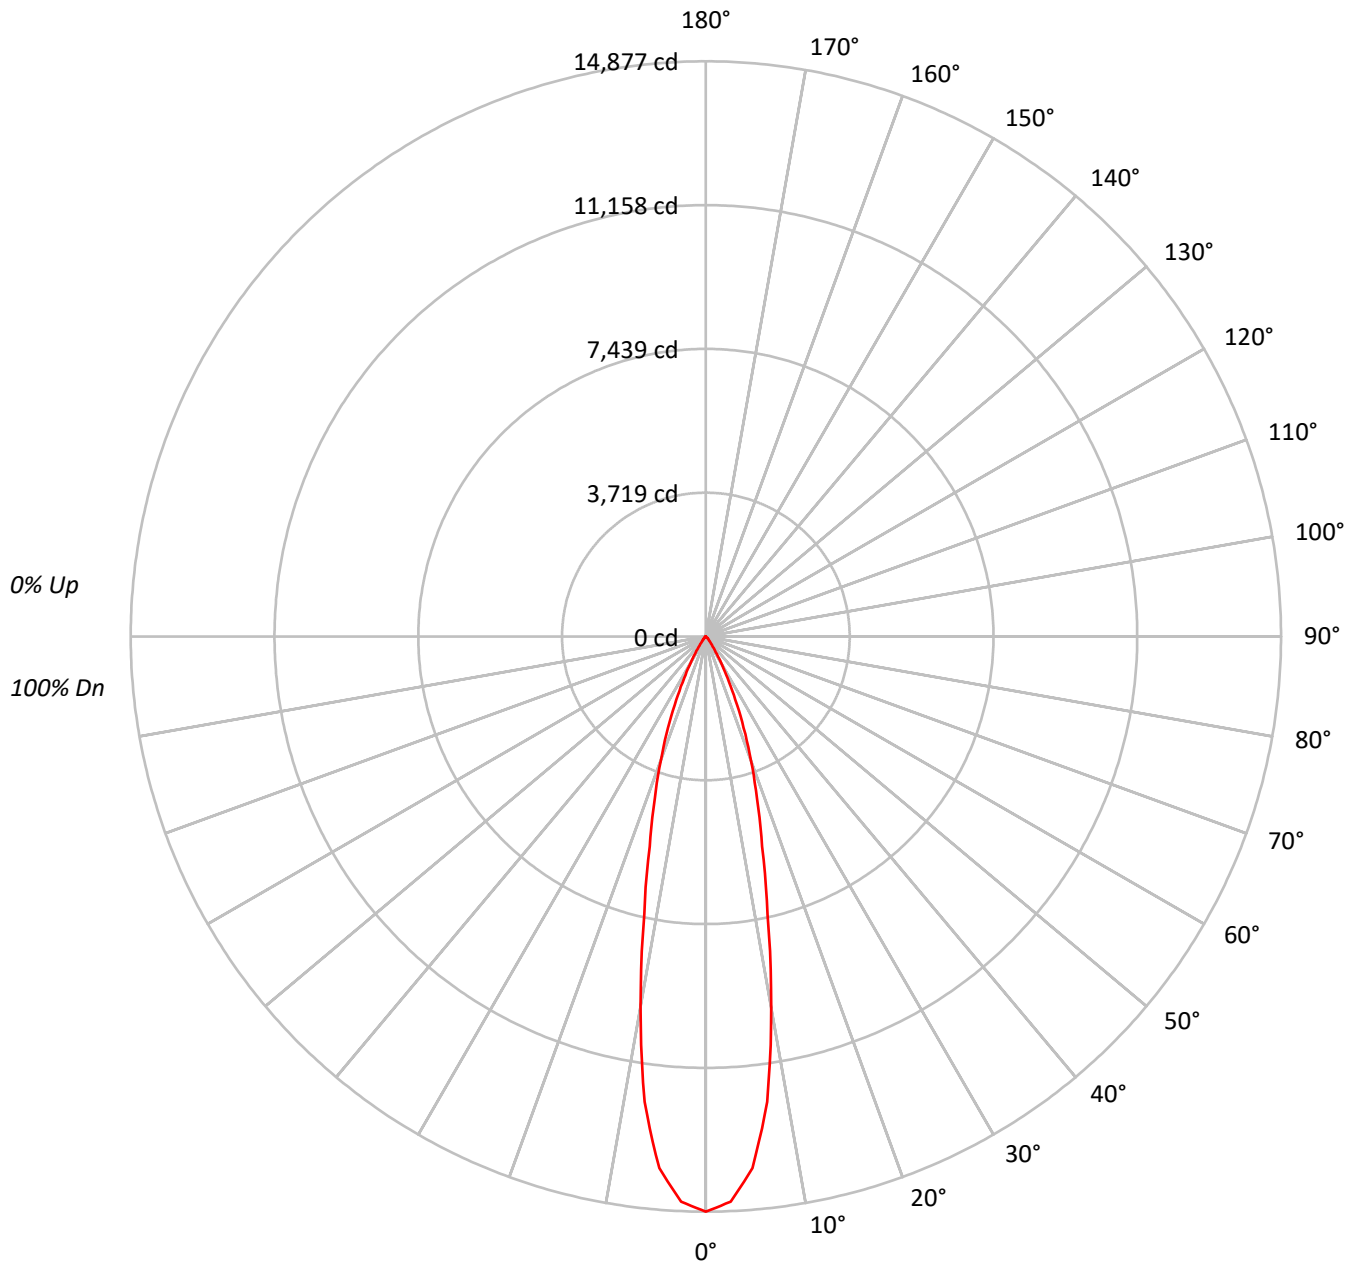

TEST NUMBER: P784873

CATALOG NUMBER: LER4DD45BD010-EC4DR2540509050-4LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	113	111	109	112	110	109	107	106	105	104		103	102	101		99
2	111	107	104	101	109	105	102	100	102	100	98		99	97	96		97
3	107	102	98	95	105	101	97	94	98	95	93		96	93	91		94
4	103	97	93	90	102	96	93	90	94	91	89		93	90	88		91
5	100	93	89	86	98	93	89	86	91	87	85		89	86	84		88
6	97	90	85	82	95	89	85	82	88	84	81		87	83	81		85
7	93	87	82	79	92	86	82	79	85	81	78		84	80	78		83
8	91	84	79	76	90	83	79	76	82	78	76		81	78	75		80
9	88	81	76	73	87	80	76	73	80	76	73		79	75	73		78
10	85	78	74	71	85	78	74	71	77	73	71		76	73	71		76

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1625494
5°	1513942
10°	1079940
15°	636046
20°	395758
25°	217194
30°	99328
35°	37614
40°	17030
45°	10245
50°	4249
55°	2743
60°	1923
65°	1293
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 10245 cd/sqm

TEST NUMBER: P784873

CATALOG NUMBER: LER4DD45BD010-EC4DR2540509050-4LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1186.3	30.2
10°-20°	1606.8	41.0
20°-30°	850.3	21.7
30°-40°	209.9	5.4
40°-50°	51.2	1.3
50°-60°	13.5	0.3
60°-70°	4.5	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3643.3	92.9
0°-40°	3853.2	98.2
0°-60°	3917.9	99.9
0°-90°	3922.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3922.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14877	
5°	13804	###
15°	5623	1607
25°	1802	850
35°	282	210
45°	66	51
55°	14	13
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P784873

CATALOG NUMBER: LER4DD45BD010-EC4DR2540509050-4LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	14877.2
2.5°	14632.7
5°	13803.5
7.5°	12137.7
10°	9733.9
12.5°	7358.3
15°	5623.0
17.5°	4382.3
20°	3403.7
22.5°	2552.6
25°	1801.6
27.5°	1208.1
30°	787.3
32.5°	479.0
35°	282.0
37.5°	172.6
40°	119.4
42.5°	91.3
45°	66.3
47.5°	40.0
50°	25.0
52.5°	18.1
55°	14.4
57.5°	11.3
60°	8.8
62.5°	6.9
65°	5.0
67.5°	1.9
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)