

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P784968

Luminaire Tested: LER4DD45BD010-EC4DR4540509050-4LBDP1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P784968
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD45BD010-EC4DR4540509050-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3963.5 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P784968

CATALOG NUMBER: LER4DD45BD010-EC4DR4540509050-4LBDP1B

Luminous Intensity Polar Plot

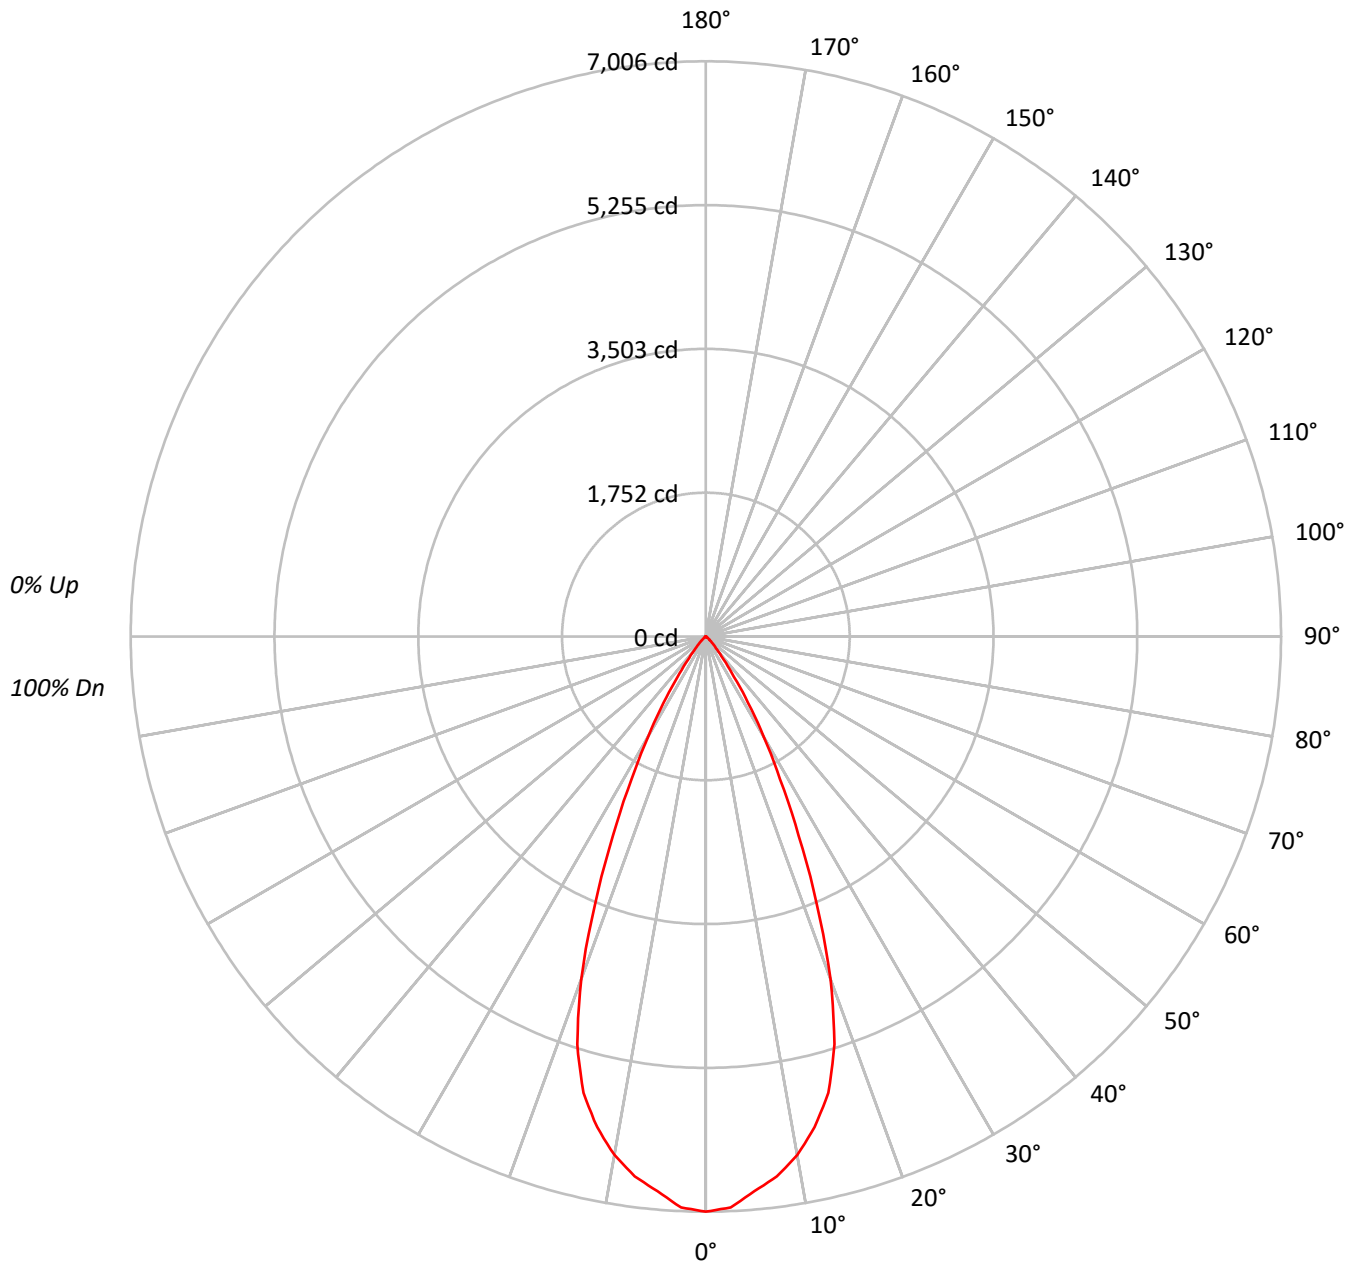

TEST NUMBER: P784968

CATALOG NUMBER: LER4DD45BD010-EC4DR4540509050-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		98
2	109	105	102	99	107	103	100	98	100	98	95		97	95	93		95
3	105	99	95	91	103	98	94	91	95	92	89		93	90	88		91
4	100	94	89	85	99	93	88	85	91	87	84		89	86	83		87
5	96	89	84	80	95	88	83	80	86	82	79		85	81	79		83
6	92	85	80	76	91	84	79	76	83	78	75		81	77	75		80
7	89	81	75	72	87	80	75	72	79	74	71		78	74	71		77
8	85	77	72	68	84	76	71	68	75	71	68		74	70	67		73
9	82	73	68	65	81	73	68	65	72	68	65		71	67	64		71
10	79	70	65	62	78	70	65	62	69	65	62		68	64	61		68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	765437
5°	743640
10°	711465
15°	651136
20°	516577
25°	322511
30°	177752
35°	79816
40°	31436
45°	14818
50°	7020
55°	3676
60°	1814
65°	440
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 14818 cd/sqm

TEST NUMBER: P784968

CATALOG NUMBER: LER4DD45BD010-EC4DR4540509050-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	637.1	16.1
10°-20°	1567.9	39.6
20°-30°	1241.6	31.3
30°-40°	413.5	10.4
40°-50°	82.1	2.1
50°-60°	18.7	0.5
60°-70°	2.7	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3446.6	87.0
0°-40°	3860.0	97.4
0°-60°	3960.7	99.9
0°-90°	3963.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3963.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7006	
5°	6780	637
15°	5756	1568
25°	2675	1242
35°	598	413
45°	96	82
55°	19	19
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P784968

CATALOG NUMBER: LER4DD45BD010-EC4DR4540509050-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	7005.6
2.5°	6959.8
5°	6780.2
7.5°	6632.0
10°	6412.7
12.5°	6120.6
15°	5756.4
17.5°	5208.7
20°	4442.8
22.5°	3530.3
25°	2675.2
27.5°	1958.8
30°	1408.9
32.5°	958.2
35°	598.4
37.5°	354.9
40°	220.4
42.5°	144.9
45°	95.9
47.5°	61.7
50°	41.3
52.5°	27.6
55°	19.3
57.5°	12.7
60°	8.3
62.5°	4.4
65°	1.7
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)