

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785192

Luminaire Tested: LER4DD50D010-EC4DR4540509027-4LBDP1B

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P785192
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD50D010-EC4DR4540509027-4LBDP1B
Description: 4 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4241.1 lumens
Efficiency: N/A
Efficacy: 90.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785192

CATALOG NUMBER: LER4DD50D010-EC4DR4540509027-4LBDP1B

Luminous Intensity Polar Plot

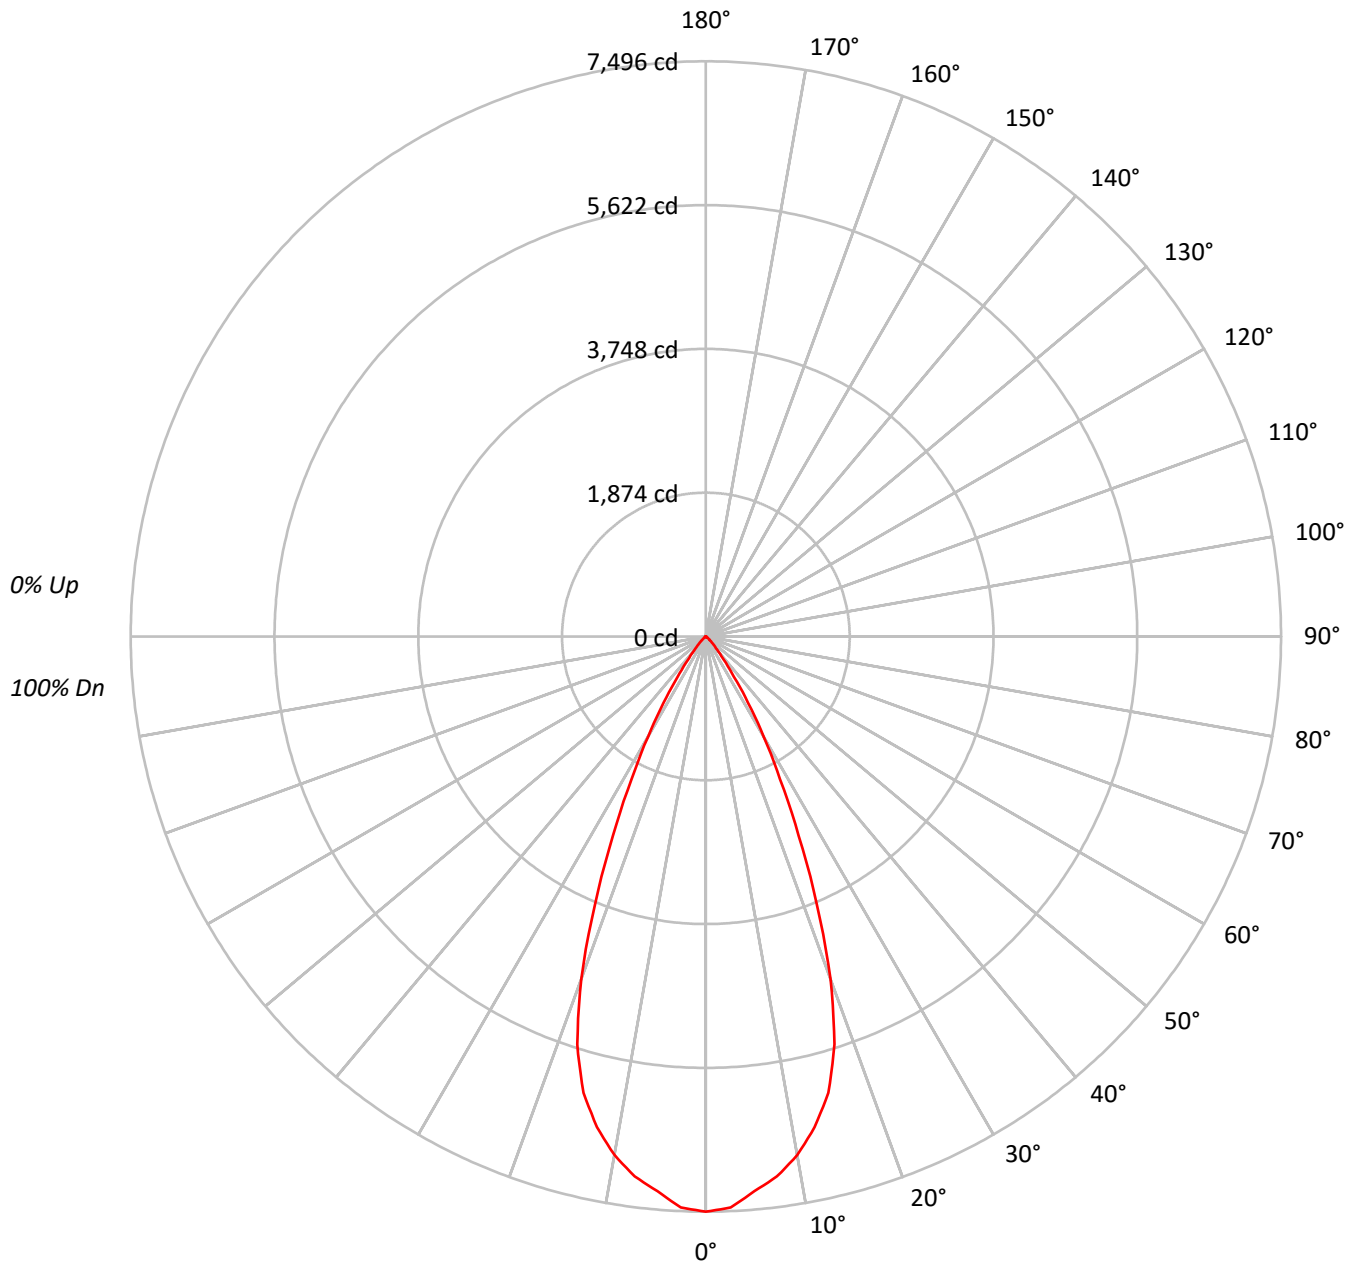

TEST NUMBER: P785192

CATALOG NUMBER: LER4DD50D010-EC4DR4540509027-4LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		98
2	109	105	102	99	107	103	100	98	100	98	95		97	95	93		95
3	105	99	95	91	103	98	94	91	95	92	89		93	90	88		91
4	100	94	89	85	99	93	88	85	91	87	84		89	86	83		87
5	96	89	84	80	95	88	83	80	86	82	79		85	81	79		83
6	92	85	80	76	91	84	79	76	83	78	75		81	77	75		80
7	89	81	75	72	87	80	75	72	79	74	71		78	74	71		77
8	85	77	72	68	84	76	71	68	75	71	68		74	70	67		73
9	82	73	68	65	81	73	68	65	72	68	65		71	67	64		71
10	79	70	65	62	78	70	65	62	69	65	62		68	64	61		68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	819051
5°	795726
10°	761302
15°	696744
20°	552761
25°	345103
30°	190204
35°	85405
40°	33632
45°	15854
50°	7513
55°	3924
60°	1923
65°	465
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 15854 cd/sqm



TEST NUMBER: P785192

CATALOG NUMBER: LER4DD50D010-EC4DR4540509027-4LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	681.7	16.1
10°-20°	1677.7	39.6
20°-30°	1328.6	31.3
30°-40°	442.4	10.4
40°-50°	87.8	2.1
50°-60°	19.9	0.5
60°-70°	2.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3688.0	87.0
0°-40°	4130.4	97.4
0°-60°	4238.2	99.9
0°-90°	4241.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4241.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7496	
5°	7255	682
15°	6160	1678
25°	2863	1329
35°	640	442
45°	103	88
55°	21	20
65°	2	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P785192

CATALOG NUMBER: LER4DD50D010-EC4DR4540509027-4LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	7496.3
2.5°	7447.4
5°	7255.1
7.5°	7096.5
10°	6861.9
12.5°	6549.4
15°	6159.6
17.5°	5573.6
20°	4754.0
22.5°	3777.6
25°	2862.6
27.5°	2096.1
30°	1507.6
32.5°	1025.3
35°	640.3
37.5°	379.7
40°	235.8
42.5°	155.1
45°	102.6
47.5°	66.0
50°	44.2
52.5°	29.5
55°	20.6
57.5°	13.6
60°	8.8
62.5°	4.7
65°	1.8
67.5°	0.6
70°	0.6
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)