

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P785303

Luminaire Tested: LER4DD50D010-EC4DR6540509040-4LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P785303
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LER4DD50D010-EC4DR6540509040-4LBDP1MW
Description: 4 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3870.1 lumens
Efficiency: N/A
Efficacy: 82.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P785303

CATALOG NUMBER: LER4DD50D010-EC4DR6540509040-4LBDP1MW

Luminous Intensity Polar Plot

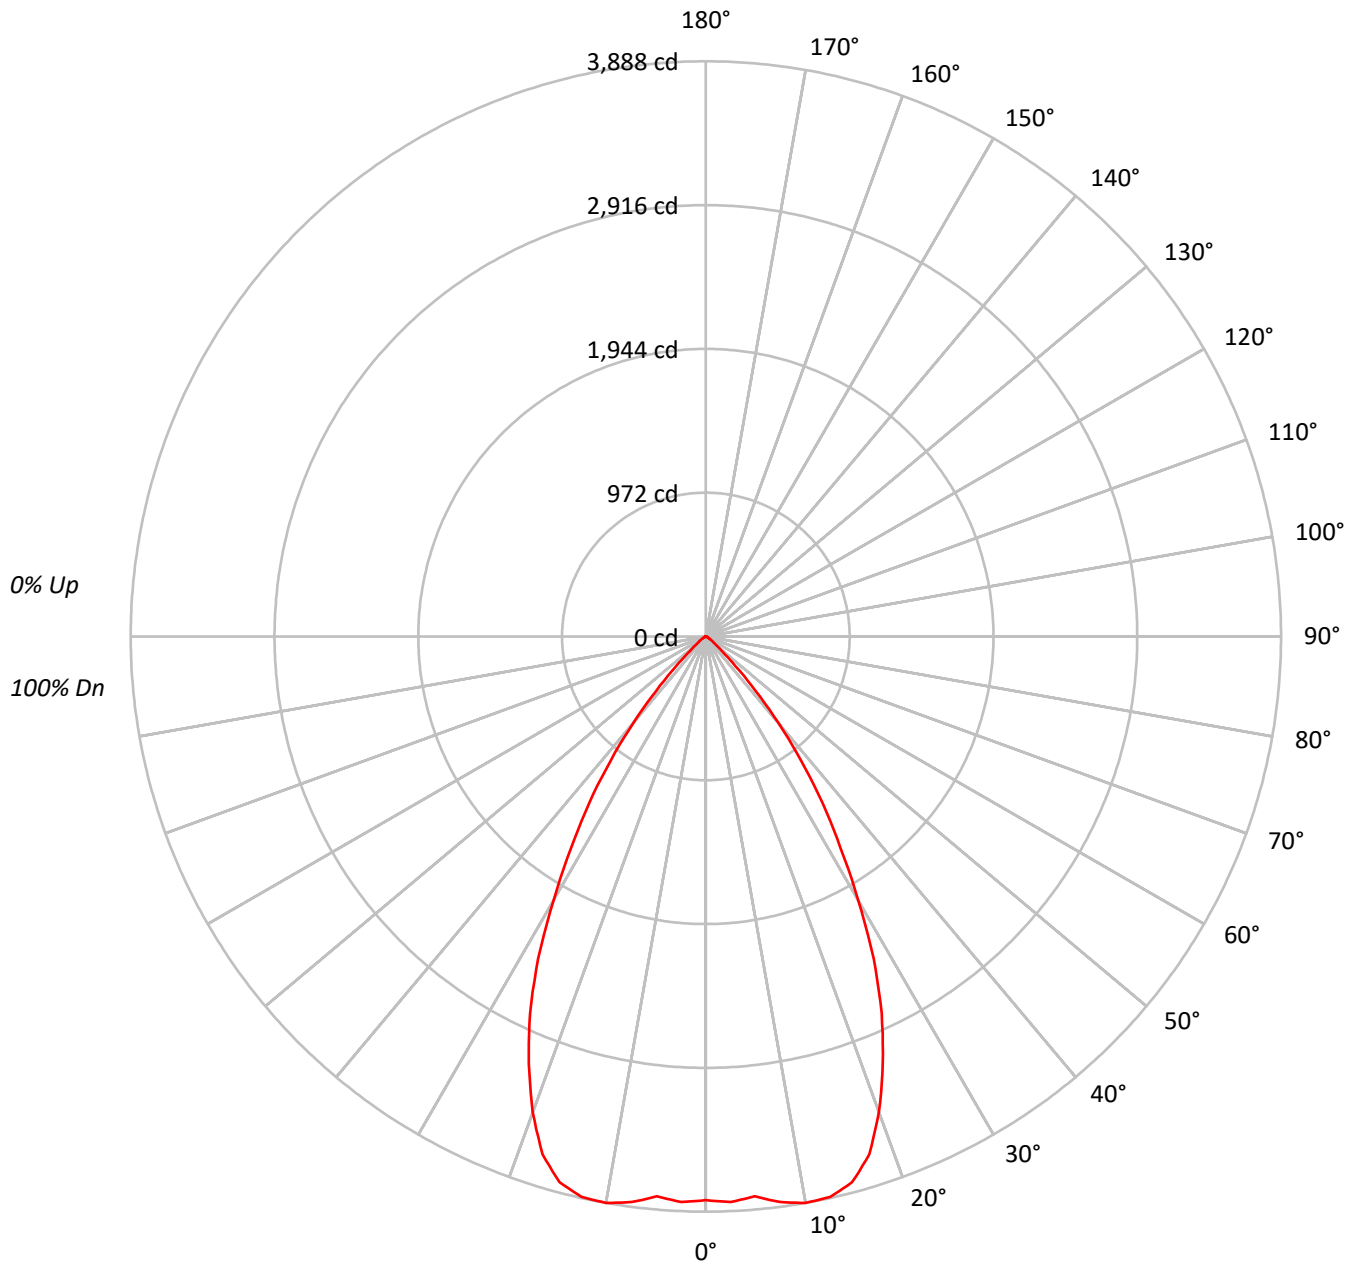



TEST NUMBER: P785303

CATALOG NUMBER: LER4DD50D010-EC4DR6540509040-4LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	111	108	106	111	108	106	104	104	103	101		101	99	98		97
2	108	103	99	95	106	101	97	94	98	95	92		95	92	90		92
3	102	96	91	87	100	94	90	86	92	88	85		89	86	83		87
4	97	89	84	79	95	88	83	79	86	82	78		84	80	77		82
5	92	83	78	73	90	83	77	73	81	76	72		79	75	72		77
6	87	78	72	68	86	77	72	68	76	71	67		74	70	67		73
7	83	73	67	63	81	73	67	63	71	66	62		70	66	62		69
8	79	69	63	59	77	68	63	59	67	62	58		66	62	58		65
9	75	65	59	55	74	65	59	55	64	58	55		63	58	55		62
10	71	61	56	52	70	61	55	52	60	55	51		59	55	51		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	416327
5°	416667
10°	431348
15°	432054
20°	397781
25°	338931
30°	259468
35°	183308
40°	108199
45°	43929
50°	15927
55°	8877
60°	5092
65°	2792
70°	2939
75°	2280
80°	2391
85°	2006

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 43929 cd/sqm



TEST NUMBER: P785303

CATALOG NUMBER: LER4DD50D010-EC4DR6540509040-4LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	9.5
10°-20°	1058.4	27.3
20°-30°	1269.8	32.8
30°-40°	853.4	22.1
40°-50°	255.5	6.6
50°-60°	45.1	1.2
60°-70°	12.8	0.3
70°-80°	6.3	0.2
80°-90°	2.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2695.1	69.6
0°-40°	3548.5	91.7
0°-60°	3849.1	99.5
0°-90°	3870.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3870.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3810	
5°	3799	367
15°	3820	1058
25°	2811	1270
35°	1374	853
45°	284	255
55°	47	45
65°	11	13
75°	5	6
85°	2	2
90°	0	



TEST NUMBER: P785303

CATALOG NUMBER: LER4DD50D010-EC4DR6540509040-4LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3810.4
2.5°	3826.7
5°	3799.0
7.5°	3856.4
10°	3887.9
12.5°	3880.3
15°	3819.6
17.5°	3671.3
20°	3421.1
22.5°	3126.5
25°	2811.4
27.5°	2455.6
30°	2056.6
32.5°	1694.8
35°	1374.3
37.5°	1057.5
40°	758.6
42.5°	495.5
45°	284.3
47.5°	150.5
50°	93.7
52.5°	65.0
55°	46.6
57.5°	33.6
60°	23.3
62.5°	15.2
65°	10.8
67.5°	9.7
70°	9.2
72.5°	7.0
75°	5.4
77.5°	4.9
80°	3.8
82.5°	2.7
85°	1.6
87.5°	1.1
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)