

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1191750

Luminaire Tested: **LDA4A25940D010TE LAR25NF 4LA1**

Issue Date: 3/3/2020

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

**Test Information**

Test Method: LM-41-14
Report Number: P1191750
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P25629)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA4A25940D010TE LAR25NF 4LA1
Description: PORTFOLIO 4" Adjustable Reflector, Self-flange Trim Ring, 25° Narrow Flood Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2598.3 lumens
Efficiency: N/A
Efficacy: 84.1 lumens/watt
Spacing Criteria (0/90/45): 0.43 / 0.43 / 0.45
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 30.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1191750

CATALOG NUMBER: LDA4A25940D010TE LAR25NF 4LA1

Luminous Intensity Polar Plot

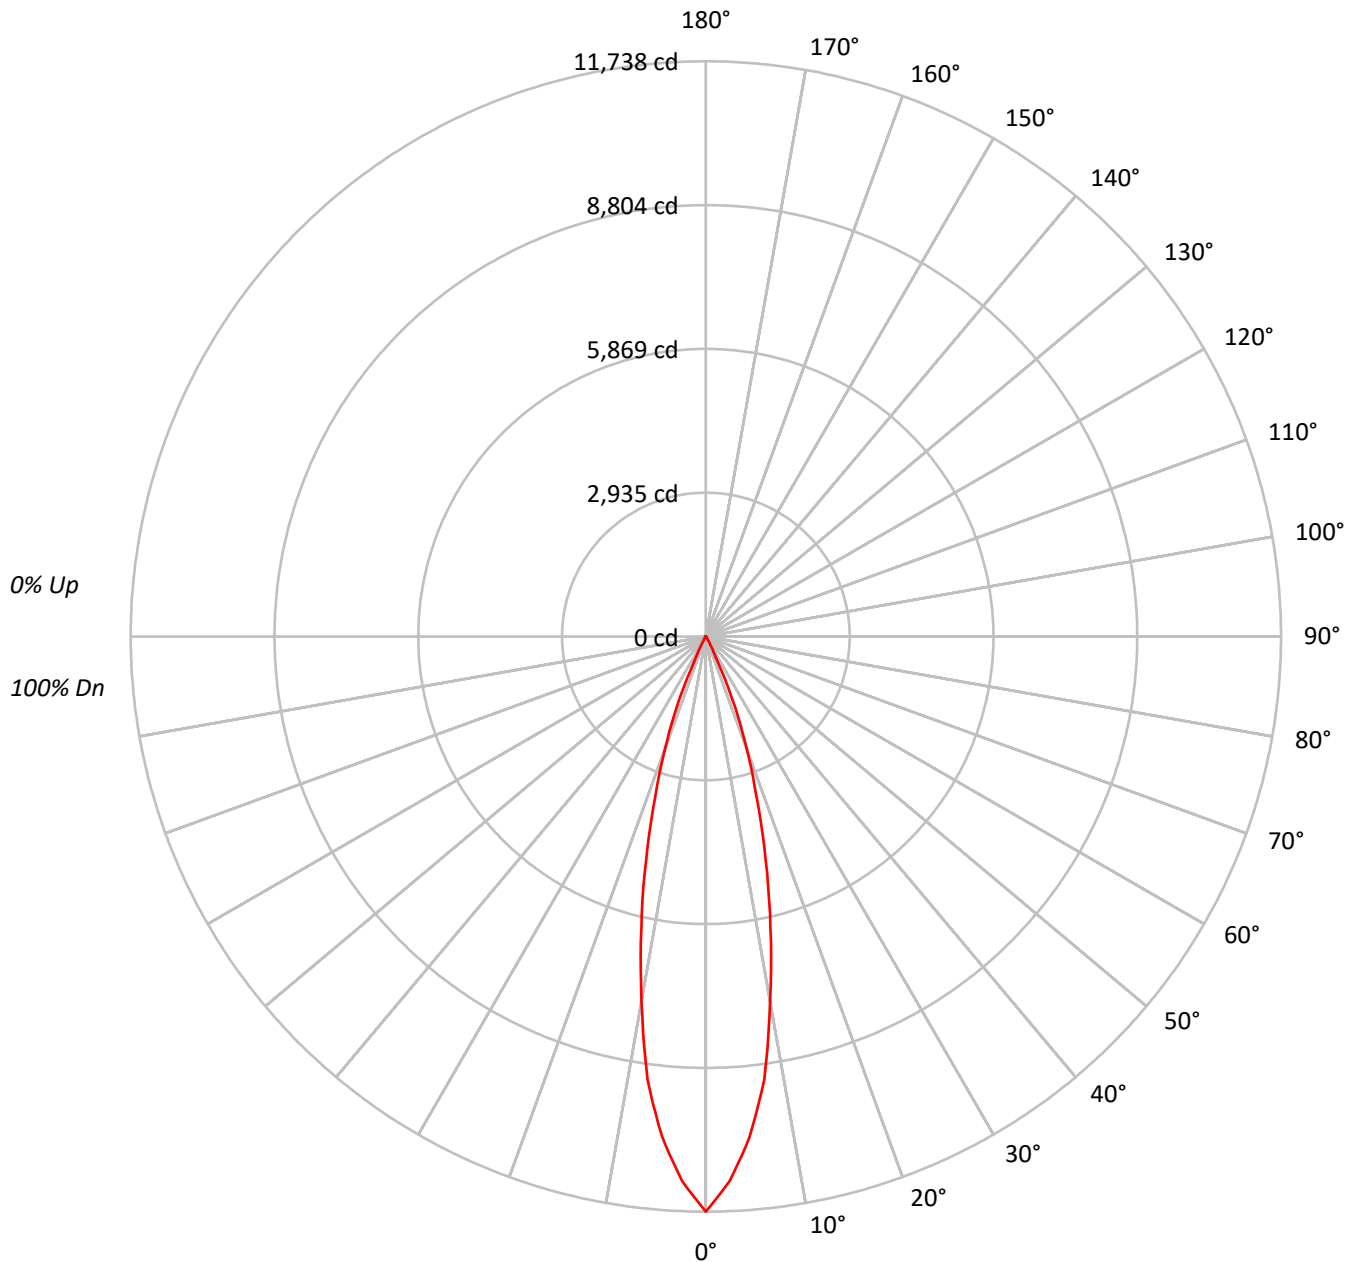



TEST NUMBER: P1191750

CATALOG NUMBER: LDA4A25940D010TE LAR25NF 4LA1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	113	111	110	113	111	109	108	107	106	105		103	102	101		100
2	112	108	105	103	109	106	104	102	103	101	99		100	99	97		98
3	108	104	100	97	106	102	99	97	100	97	95		98	96	94		96
4	105	100	96	93	103	99	95	93	97	94	92		95	93	91		93
5	102	96	92	89	101	95	92	89	94	91	88		92	90	88		91
6	99	93	89	86	98	93	89	86	91	88	85		90	87	85		89
7	97	90	86	83	95	90	86	83	89	85	83		88	85	83		87
8	94	88	84	81	93	87	83	81	86	83	81		85	82	80		85
9	92	85	81	79	91	85	81	79	84	81	78		83	80	78		83
10	89	83	79	76	89	83	79	76	82	79	76		81	78	76		81

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1447794
5°	1269110
10°	946590
15°	602141
20°	319333
25°	72063
30°	17305
35°	4969
40°	1675
45°	523
50°	288
55°	323
60°	370
65°	0
70°	0
75°	0
80°	0
85°	0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1191750

CATALOG NUMBER: LDA4A25940D010TE LAR25NF 4LA1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	896.6	34.5
10°-20°	1288.3	49.6
20°-30°	381.0	14.7
30°-40°	27.0	1.0
40°-50°	3.1	0.1
50°-60°	1.3	0.1
60°-70°	0.9	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2565.9	98.8
0°-40°	2592.9	99.8
0°-60°	2597.3	100.0
0°-90°	2598.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2598.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11738	
5°	10250	897
15°	4715	1288
25°	530	381
35°	33	27
45°	3	3
55°	2	1
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1191750

CATALOG NUMBER: LDA4A25940D010TE LAR25NF 4LA1

CANDELA DISTRIBUTION (FULL):

	0°
0°	11737.7
2.5°	11121.3
5°	10249.9
7.5°	9117.5
10°	7557.7
12.5°	6090.8
15°	4715.4
17.5°	3436.1
20°	2432.8
22.5°	1540.3
25°	529.5
27.5°	231.0
30°	121.5
32.5°	61.5
35°	33.0
37.5°	19.5
40°	10.4
42.5°	6.0
45°	3.0
47.5°	1.5
50°	1.5
52.5°	1.5
55°	1.5
57.5°	1.5
60°	1.5
62.5°	1.5
65°	0.0
67.5°	1.5
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)