

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P753384

Luminaire Tested: LD4D75BD010-EU4DR5570959024-4LBS1LI

Issue Date: 1/30/2024

Test Information

Test Method: LM-79-2019
Report Number: P753384
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 1/30/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD4D75BD010-EU4DR5570959024-4LBS1LI
Description: 4 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6942.9 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P753384

CATALOG NUMBER: LD4D75BD010-EU4DR5570959024-4LBS1LI

Luminous Intensity Polar Plot

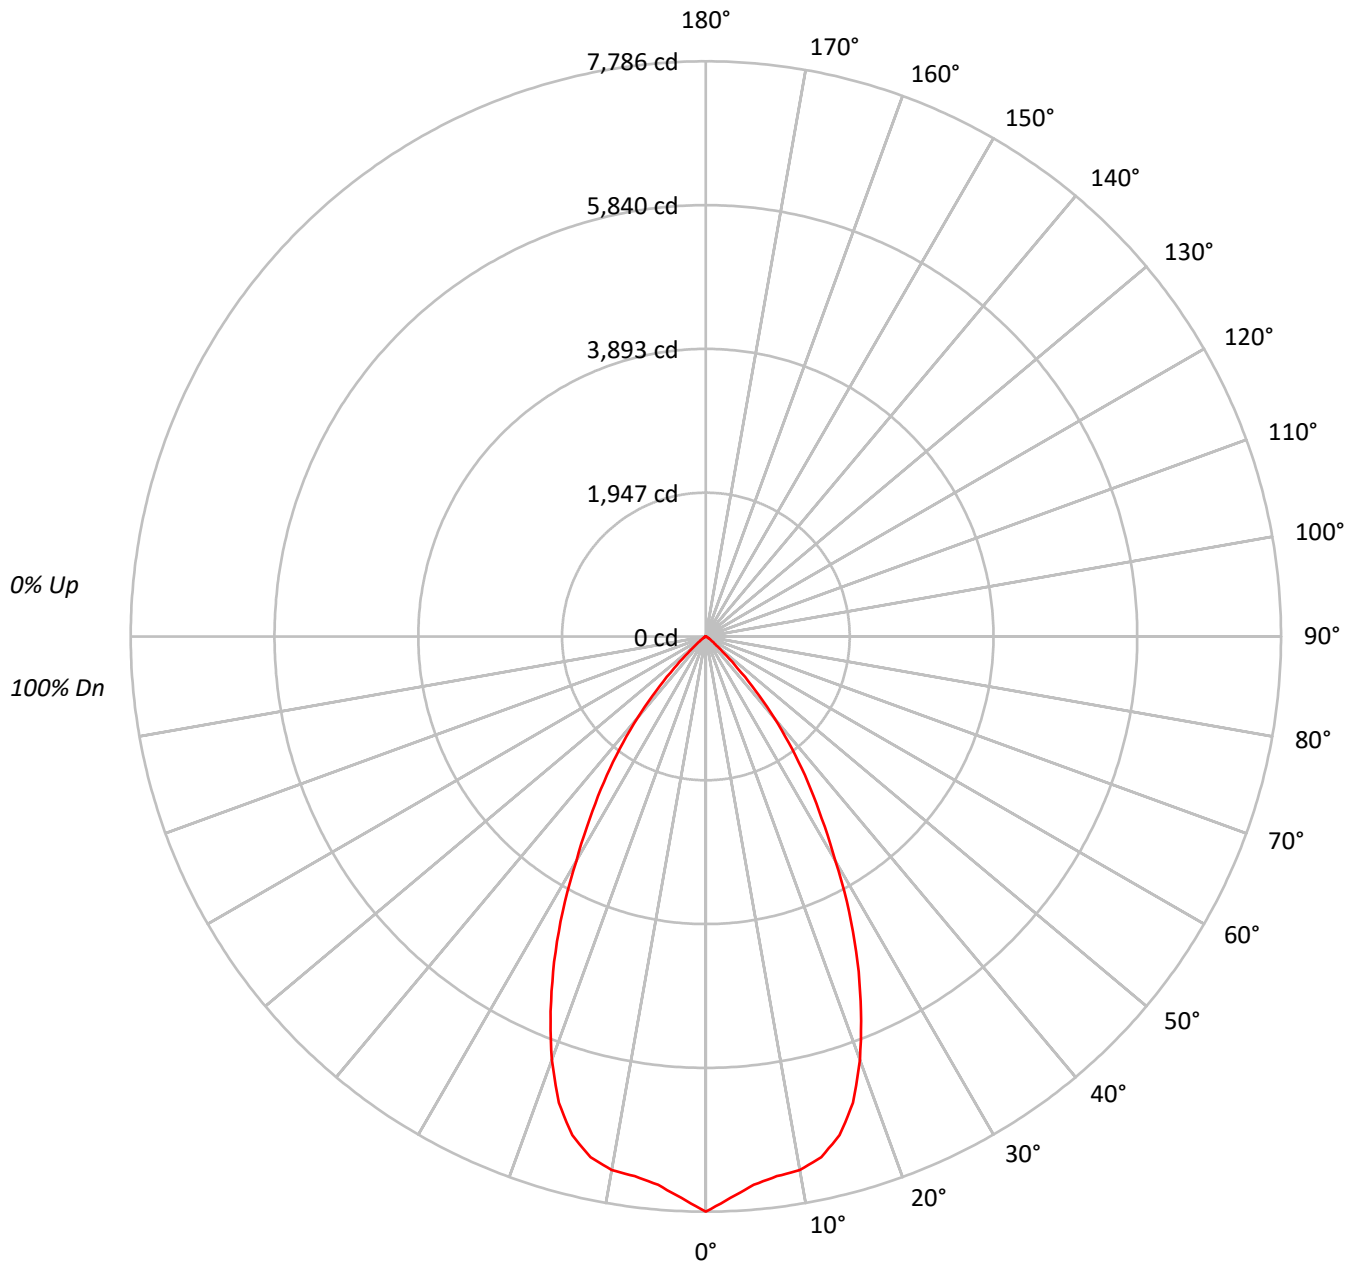

TEST NUMBER: P753384

CATALOG NUMBER: LD4D75BD010-EU4DR5570959024-4LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																				
0	119	119	119	119	116	116	116	116		111	111	111		106	106	106		102	102	102
1	114	111	108	106	111	109	106	104		105	103	101		101	99	98		97	96	95
2	108	103	99	96	106	101	98	95		98	95	92		95	93	90		92	90	89
3	102	96	91	87	100	95	90	86		92	88	85		90	86	84		87	85	82
4	97	90	84	80	95	88	83	79		86	82	78		84	81	78		82	79	77
5	92	84	78	74	91	83	77	73		81	76	73		79	75	72		78	74	71
6	88	79	73	68	86	78	72	68		76	71	68		75	70	67		74	70	67
7	83	74	68	64	82	73	67	63		72	67	63		71	66	63		70	65	62
8	79	69	63	59	78	69	63	59		68	63	59		67	62	59		66	62	58
9	75	66	60	56	74	65	59	55		64	59	55		63	58	55		62	58	55
10	72	62	56	52	71	61	56	52		61	56	52		60	55	52		59	55	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	850650
5°	816861
10°	813780
15°	790403
20°	708706
25°	585709
30°	442430
35°	320799
40°	205301
45°	93762
50°	30664
55°	13239
60°	5682
65°	750
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 93762 cd/sqm



TEST NUMBER: P753384

CATALOG NUMBER: LD4D75BD010-EU4DR5570959024-4LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	708.7	10.2
10°-20°	1934.2	27.9
20°-30°	2204.2	31.7
30°-40°	1500.5	21.6
40°-50°	517.0	7.4
50°-60°	71.5	1.0
60°-70°	6.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4847.0	69.8
0°-40°	6347.5	91.4
0°-60°	6936.0	99.9
0°-90°	6942.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6942.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7786	
5°	7448	709
15°	6988	1934
25°	4858	2204
35°	2405	1500
45°	607	517
55°	70	71
65°	3	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P753384

CATALOG NUMBER: LD4D75BD010-EU4DR5570959024-4LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	7785.5
2.5°	7607.0
5°	7447.8
7.5°	7369.7
10°	7334.9
12.5°	7219.2
15°	6987.6
17.5°	6620.0
20°	6095.2
22.5°	5489.4
25°	4858.4
27.5°	4201.4
30°	3506.8
32.5°	2918.3
35°	2405.1
37.5°	1916.9
40°	1439.4
42.5°	997.5
45°	606.8
47.5°	327.0
50°	180.4
52.5°	107.1
55°	69.5
57.5°	44.4
60°	26.0
62.5°	11.6
65°	2.9
67.5°	1.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report







(END OF REPORT)