

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761806

Luminaire Tested: LD6D15D010-EU6DR700215IC9030-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761806
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR700215IC9030-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1558.1 lumens
Efficiency: N/A
Efficacy: 98.6 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761806

CATALOG NUMBER: LD6D15D010-EU6DR700215IC9030-6LBS1LI

Luminous Intensity Polar Plot

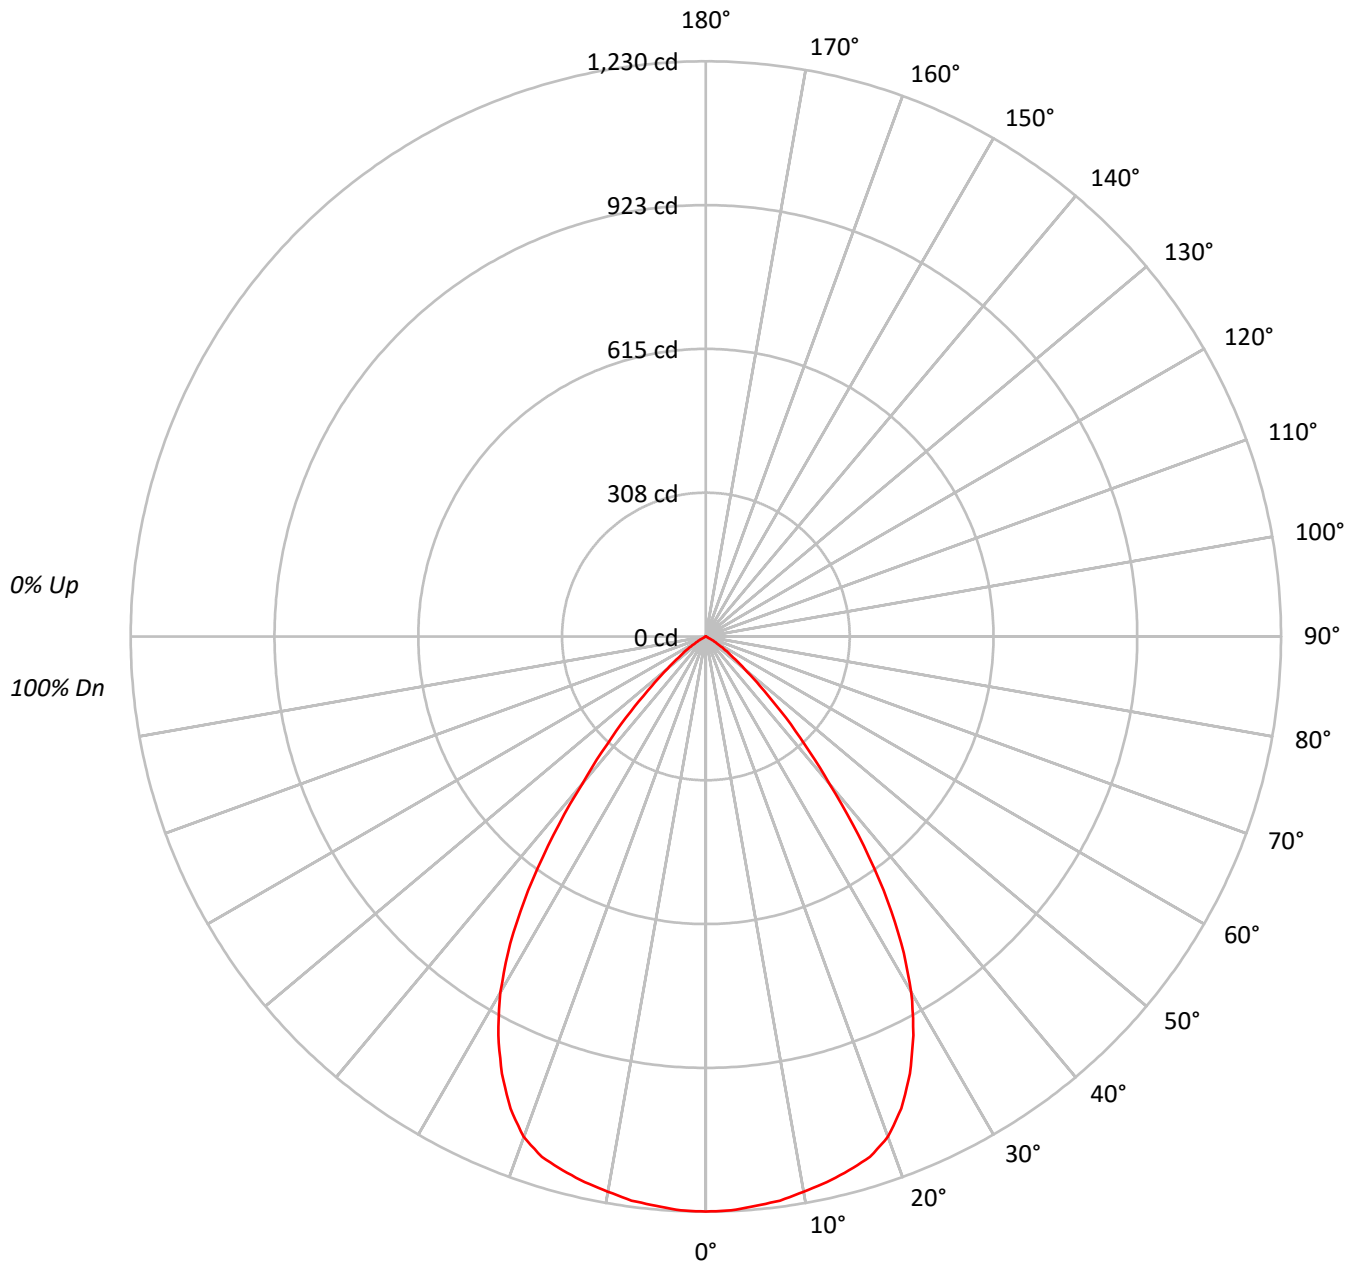



TEST NUMBER: P761806

CATALOG NUMBER: LD6D15D010-EU6DR700215IC9030-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	113	110	107	105		111	108	106	103		104	102	100		100	99	97		97	95	94
2	107	102	97	94		105	100	96	92		97	93	90		94	91	88		91	89	87
3	101	94	88	84		99	92	87	83		90	85	82		87	84	81		85	82	79
4	95	87	81	76		93	86	80	76		83	78	75		81	77	74		79	76	73
5	89	80	74	69		88	79	73	69		78	72	68		76	71	68		74	70	67
6	84	75	68	63		83	74	68	63		72	67	63		71	66	62		69	65	62
7	80	69	63	58		78	69	62	58		67	62	58		66	61	57		65	61	57
8	75	65	58	54		74	64	58	54		63	57	53		62	57	53		61	56	53
9	71	61	54	50		70	60	54	50		59	53	50		58	53	49		57	53	49
10	67	57	50	46		66	56	50	46		55	50	46		55	50	46		54	49	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	134369
5°	134027
10°	133746
15°	133713
20°	132400
25°	124378
30°	110872
35°	88406
40°	58706
45°	35091
50°	18188
55°	9563
60°	3387
65°	52
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 35091 cd/sqm



TEST NUMBER: P761806

CATALOG NUMBER: LD6D15D010-EU6DR700215IC9030-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.2	7.5
10°-20°	333.3	21.4
20°-30°	470.2	30.2
30°-40°	405.9	26.1
40°-50°	181.8	11.7
50°-60°	47.6	3.1
60°-70°	3.1	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	919.7	59.0
0°-40°	1325.7	85.1
0°-60°	1555.0	99.8
0°-90°	1558.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1558.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1230	
5°	1222	116
15°	1182	333
25°	1032	470
35°	663	406
45°	227	182
55°	50	48
65°	0	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P761806

CATALOG NUMBER: LD6D15D010-EU6DR700215IC9030-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1229.8
2.5°	1228.5
5°	1222.0
7.5°	1216.8
10°	1205.5
12.5°	1195.3
15°	1182.1
17.5°	1166.8
20°	1138.7
22.5°	1092.4
25°	1031.7
27.5°	961.1
30°	878.8
32.5°	778.2
35°	662.8
37.5°	535.4
40°	411.6
42.5°	312.7
45°	227.1
47.5°	156.6
50°	107.0
52.5°	73.9
55°	50.2
57.5°	30.3
60°	15.5
62.5°	4.9
65°	0.2
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)