

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761515

Luminaire Tested: LD6D15D010-EU6DR500215IC9035-6LBDP1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761515
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-44)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR500215IC9035-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 50° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1454.7 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.73
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761515

CATALOG NUMBER: LD6D15D010-EU6DR500215IC9035-6LBDP1MW

Luminous Intensity Polar Plot

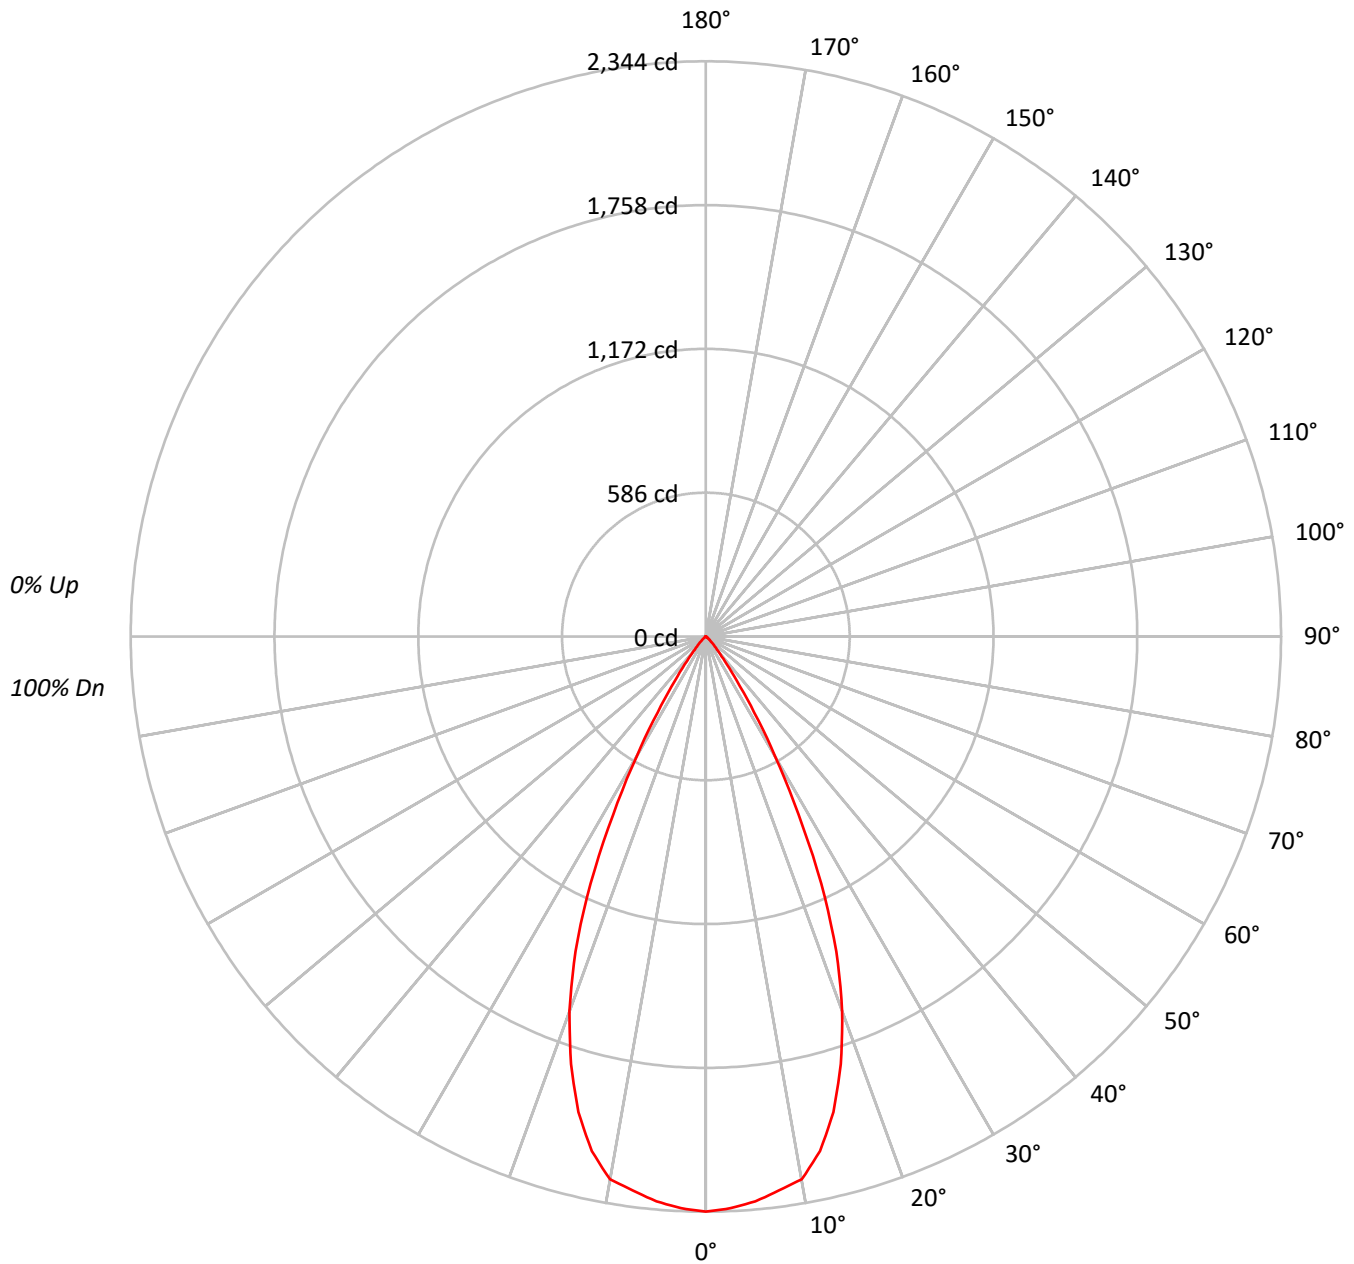



TEST NUMBER: P761515

CATALOG NUMBER: LD6D15D010-EU6DR500215IC9035-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10			50	30	10			0
RCR																				
0	119	119	119	119	116	116	116	116		111	111	111			106	106	106			100
1	114	112	109	107	112	110	108	106		106	104	102			102	101	99			95
2	109	105	101	98	107	103	100	97		100	98	95			97	95	93			90
3	105	99	95	91	103	98	94	90		95	92	89			93	90	88			85
4	100	94	89	85	99	93	88	85		90	87	84			89	85	83			80
5	96	89	84	80	95	88	83	79		86	82	79			85	81	78			76
6	92	84	79	75	91	83	79	75		82	78	74			81	77	74			72
7	88	80	75	71	87	79	74	71		78	74	71			77	73	70			69
8	85	76	71	67	84	76	71	67		75	70	67			74	70	67			65
9	81	73	68	64	80	72	67	64		71	67	64			71	67	64			62
10	78	70	64	61	77	69	64	61		68	64	61			68	64	61			59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	256085
5°	253400
10°	249230
15°	226943
20°	188839
25°	134046
30°	70954
35°	28904
40°	10740
45°	4914
50°	2023
55°	1067
60°	503
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4914 cd/sqm

TEST NUMBER: P761515

CATALOG NUMBER: LD6D15D010-EU6DR500215IC9035-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.4	15.0
10°-20°	551.9	37.9
20°-30°	495.7	34.1
30°-40°	155.2	10.7
40°-50°	27.2	1.9
50°-60°	5.4	0.4
60°-70°	0.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1266.0	87.0
0°-40°	1421.2	97.7
0°-60°	1453.9	99.9
0°-90°	1454.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1454.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2344	
5°	2310	218
15°	2006	552
25°	1112	496
35°	217	155
45°	32	27
55°	6	5
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P761515

CATALOG NUMBER: LD6D15D010-EU6DR500215IC9035-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	2343.8
2.5°	2332.1
5°	2310.4
7.5°	2277.2
10°	2246.4
12.5°	2147.6
15°	2006.3
17.5°	1826.9
20°	1624.1
22.5°	1389.6
25°	1111.9
27.5°	817.5
30°	562.4
32.5°	366.2
35°	216.7
37.5°	124.5
40°	75.3
42.5°	49.0
45°	31.8
47.5°	19.4
50°	11.9
52.5°	8.1
55°	5.6
57.5°	3.8
60°	2.3
62.5°	1.4
65°	0.6
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)