

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761614

Luminaire Tested: LD6D15D010-EU6DR550215IC9050-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761614
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR550215IC9050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1531.0 lumens
Efficiency: N/A
Efficacy: 96.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761614

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBDP1H

Luminous Intensity Polar Plot

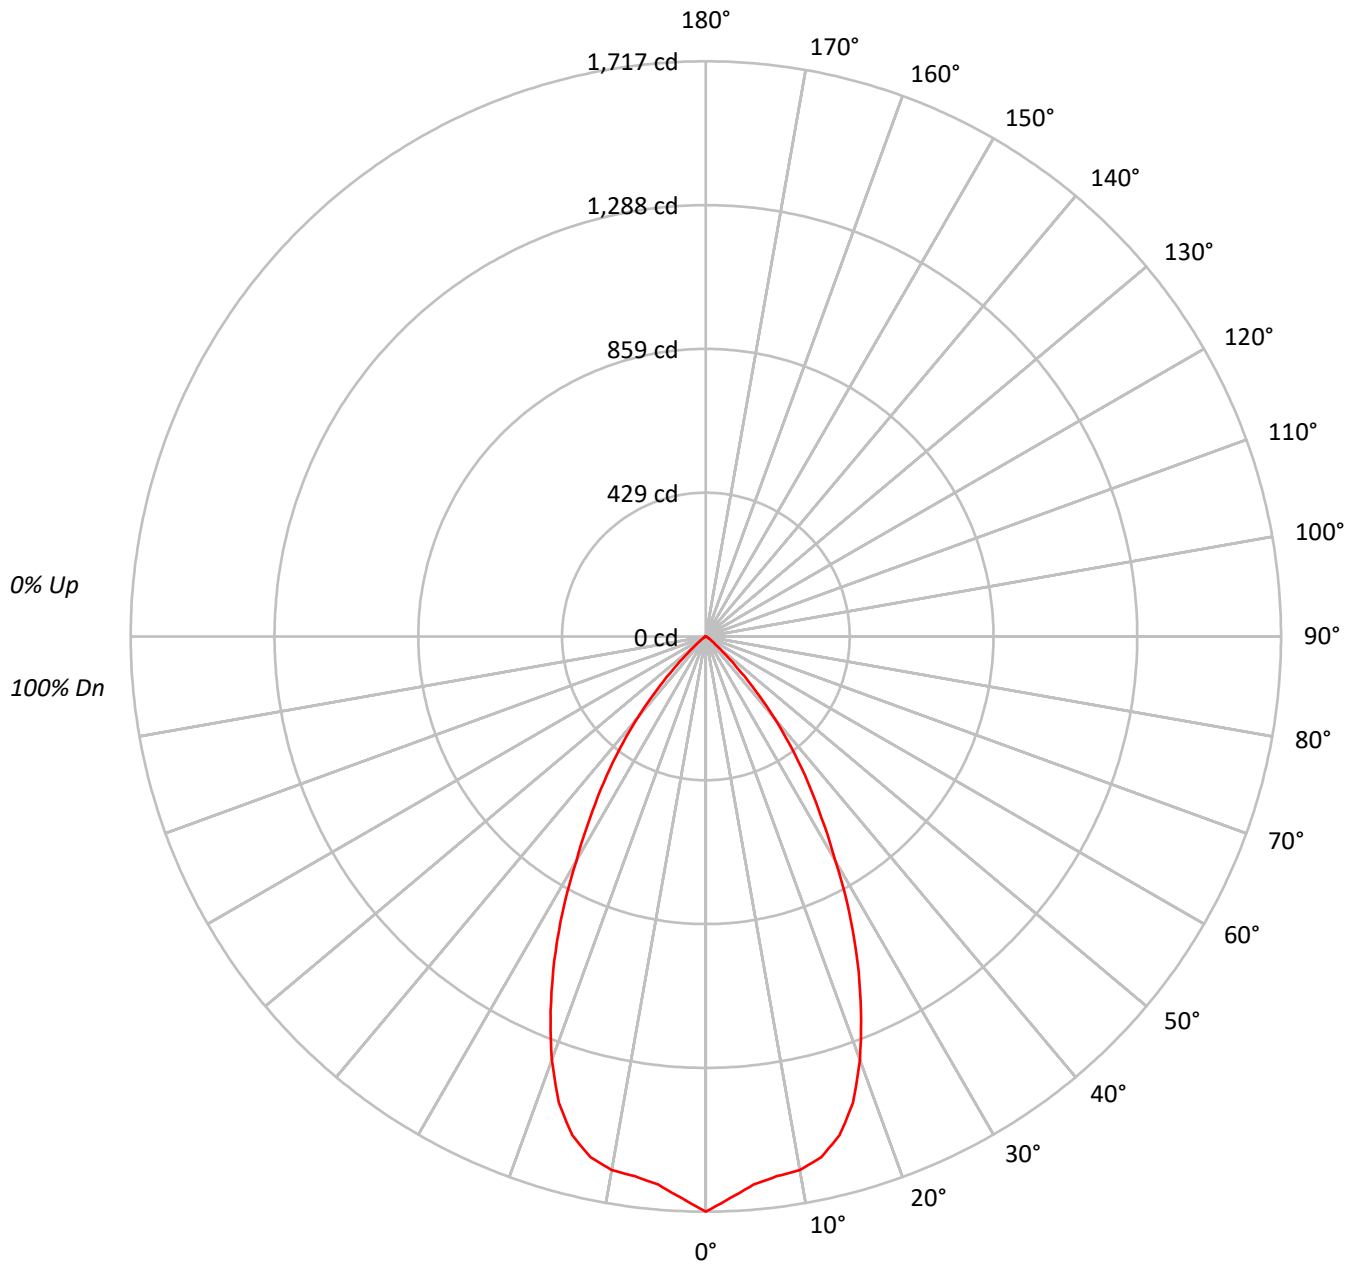



TEST NUMBER: P761614

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	114	111	108	106		111	109	106	104		105	103	101		101	99	98		97	96	95
2	108	103	99	96		106	101	98	95		98	95	92		95	93	90		92	90	89
3	102	96	91	87		100	95	90	86		92	88	85		90	86	84		87	85	82
4	97	90	84	80		95	88	83	79		86	82	78		84	81	78		82	79	77
5	92	84	78	74		91	83	77	73		81	76	73		79	75	72		78	74	71
6	88	79	73	68		86	78	72	68		76	71	68		75	70	67		74	70	67
7	83	74	68	64		82	73	67	63		72	67	63		71	66	63		70	65	62
8	79	69	63	59		78	69	63	59		68	63	59		67	62	59		66	62	58
9	75	66	60	56		74	65	59	55		64	59	55		63	58	55		62	58	55
10	72	62	56	52		71	61	56	52		61	56	52		60	55	52		59	55	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	187579
5°	180124
10°	179445
15°	174288
20°	156282
25°	129164
30°	97562
35°	70746
40°	45271
45°	20675
50°	6765
55°	2915
60°	1246
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 20675 cd/sqm



TEST NUMBER: P761614

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.3	10.2
10°-20°	426.5	27.9
20°-30°	486.1	31.7
30°-40°	330.9	21.6
40°-50°	114.0	7.4
50°-60°	15.8	1.0
60°-70°	1.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1068.8	69.8
0°-40°	1399.7	91.4
0°-60°	1529.5	99.9
0°-90°	1531.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1531.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1717	
5°	1642	156
15°	1541	427
25°	1071	486
35°	530	331
45°	134	114
55°	15	16
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P761614

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1716.8
2.5°	1677.4
5°	1642.3
7.5°	1625.1
10°	1617.4
12.5°	1591.9
15°	1540.8
17.5°	1459.8
20°	1344.1
22.5°	1210.5
25°	1071.4
27.5°	926.5
30°	773.3
32.5°	643.5
35°	530.4
37.5°	422.7
40°	317.4
42.5°	220.0
45°	133.8
47.5°	72.1
50°	39.8
52.5°	23.6
55°	15.3
57.5°	9.8
60°	5.7
62.5°	2.6
65°	0.6
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)