

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P768362

Luminaire Tested: LD6D55D010-EU6DR5555659035-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P768362
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D55D010-EU6DR5555659035-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6728.1 lumens
Efficiency: N/A
Efficacy: 115.6 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P768362

CATALOG NUMBER: LD6D55D010-EU6DR5555659035-6LBDP1H

Luminous Intensity Polar Plot

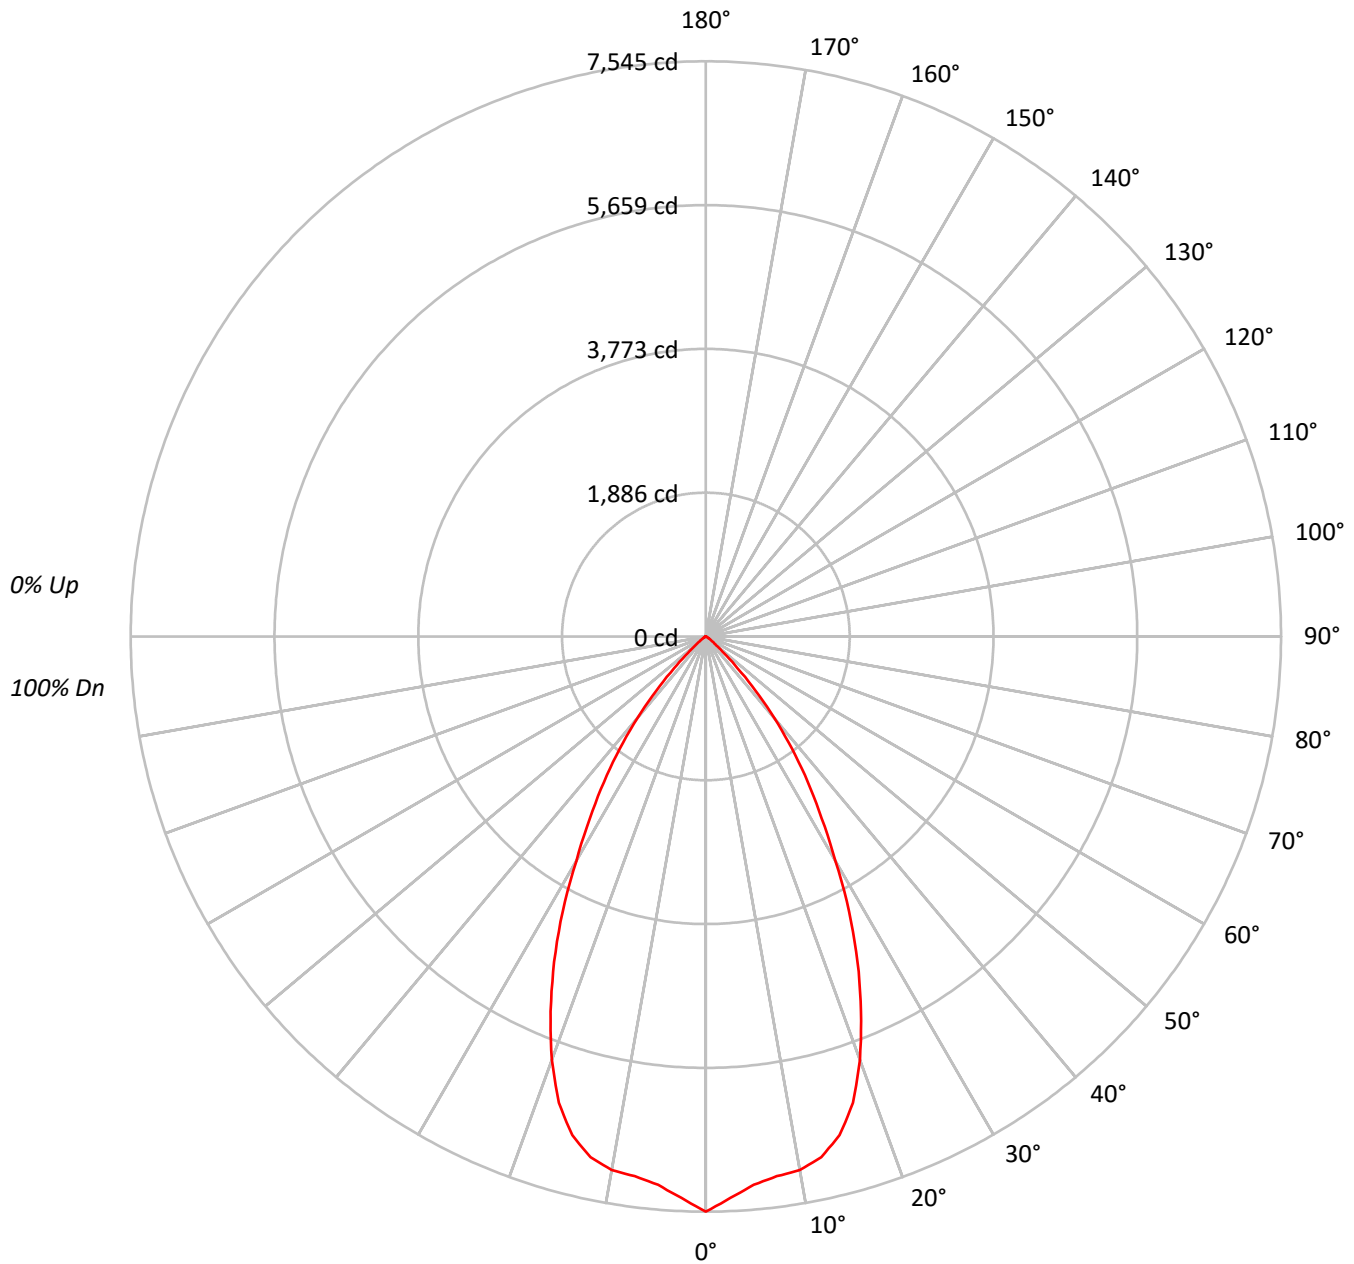



TEST NUMBER: P768362

CATALOG NUMBER: LD6D55D010-EU6DR5555659035-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74
7	83	74	68	64	82	73	67	63	72	67	63		71	66	63		70
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66
9	75	66	60	56	74	65	59	55	64	59	55		63	58	55		62
10	72	62	56	52	71	61	56	52	61	56	52		60	55	52		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	824329
5°	791580
10°	788606
15°	765947
20°	686777
25°	567589
30°	428741
35°	310875
40°	198954
45°	90857
50°	29712
55°	12820
60°	5507
65°	724
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 90857 cd/sqm



TEST NUMBER: P768362

CATALOG NUMBER: LD6D55D010-EU6DR5555659035-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	686.8	10.2
10°-20°	1874.3	27.9
20°-30°	2136.0	31.7
30°-40°	1454.1	21.6
40°-50°	501.1	7.4
50°-60°	69.3	1.0
60°-70°	6.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4697.0	69.8
0°-40°	6151.1	91.4
0°-60°	6721.4	99.9
0°-90°	6728.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6728.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7545	
5°	7217	687
15°	6771	1874
25°	4708	2136
35°	2331	1454
45°	588	501
55°	67	69
65°	3	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P768362

CATALOG NUMBER: LD6D55D010-EU6DR5555659035-6LBDP1H

CANDELA DISTRIBUTION (FULL):

0°	
0°	7544.6
2.5°	7371.6
5°	7217.3
7.5°	7141.6
10°	7108.0
12.5°	6995.8
15°	6771.4
17.5°	6415.2
20°	5906.6
22.5°	5319.5
25°	4708.1
27.5°	4071.4
30°	3398.3
32.5°	2828.0
35°	2330.7
37.5°	1857.6
40°	1394.9
42.5°	966.7
45°	588.0
47.5°	316.9
50°	174.8
52.5°	103.8
55°	67.3
57.5°	43.0
60°	25.2
62.5°	11.2
65°	2.8
67.5°	0.9
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)