

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774367

Luminaire Tested: LD6D95BD010-EU6DR4070959035-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774367
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR4070959035-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10511.4 lumens
Efficiency: N/A
Efficacy: 106.0 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P774367

CATALOG NUMBER: LD6D95BD010-EU6DR4070959035-6LBDP1B

Luminous Intensity Polar Plot

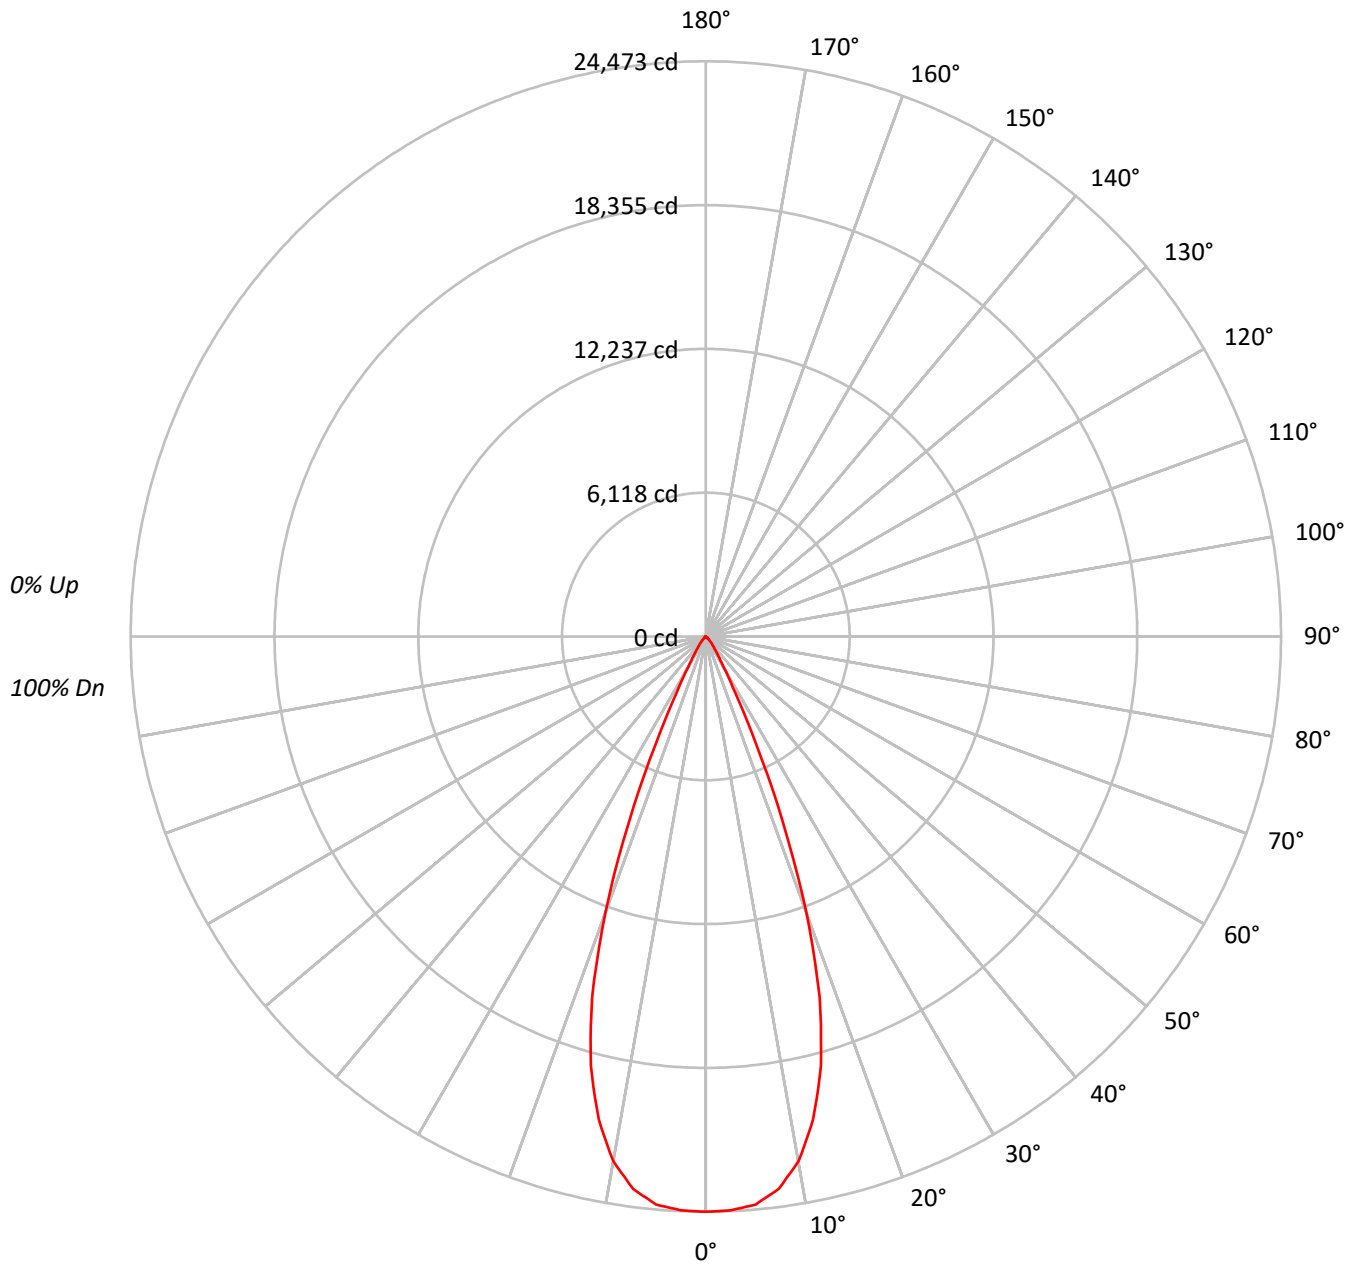



TEST NUMBER: P774367

CATALOG NUMBER: LD6D95BD010-EU6DR4070959035-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	115	112	110	108	112	110	108	107	106	105	103		103	101	100		99
2	110	106	103	100	108	105	102	99	102	99	97		99	97	95		96
3	106	101	97	94	104	100	96	93	97	94	92		95	93	90		93
4	102	97	92	89	101	95	91	88	93	90	87		92	89	86		90
5	99	92	88	84	97	91	87	84	90	86	83		88	85	83		87
6	95	88	84	80	94	88	83	80	86	82	80		85	82	79		84
7	92	85	80	77	91	84	80	77	83	79	76		82	79	76		81
8	89	82	77	74	88	81	77	74	80	76	73		79	76	73		78
9	86	79	74	71	85	78	74	71	77	73	71		76	73	70		76
10	83	76	71	68	82	75	71	68	75	71	68		74	70	68		73

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2673971
5°	2660977
10°	2515208
15°	2138248
20°	1457364
25°	608072
30°	191201
35°	88860
40°	49150
45°	22529
50°	10930
55°	6000
60°	3125
65°	1112
70°	447
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 22529 cd/sqm



TEST NUMBER: P774367

CATALOG NUMBER: LD6D95BD010-EU6DR4070959035-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2265.4	21.6
10°-20°	5075.2	48.3
20°-30°	2540.5	24.2
30°-40°	465.7	4.4
40°-50°	128.5	1.2
50°-60°	30.2	0.3
60°-70°	5.8	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	9881.1	94.0
0°-40°	10346.8	98.4
0°-60°	10505.4	99.9
0°-90°	10511.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10511.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	24473	
5°	24262	###
15°	18903	5075
25°	5044	2540
35°	666	466
45°	146	128
55°	32	30
65°	4	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774367

CATALOG NUMBER: LD6D95BD010-EU6DR4070959035-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	24473.3
2.5°	24437.6
5°	24261.7
7.5°	23701.3
10°	22670.5
12.5°	21063.5
15°	18903.3
17.5°	16093.9
20°	12534.0
22.5°	8545.2
25°	5043.9
27.5°	2666.4
30°	1515.5
32.5°	979.3
35°	666.2
37.5°	476.1
40°	344.6
42.5°	235.9
45°	145.8
47.5°	92.9
50°	64.3
52.5°	45.7
55°	31.5
57.5°	20.0
60°	14.3
62.5°	8.6
65°	4.3
67.5°	2.9
70°	1.4
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)