

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774607

Luminaire Tested: LD6D95BD010-EU6DR5570959035-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774607
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR5570959035-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12769.3 lumens
Efficiency: N/A
Efficacy: 128.7 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P774607

CATALOG NUMBER: LD6D95BD010-EU6DR5570959035-6LBS1LI

Luminous Intensity Polar Plot

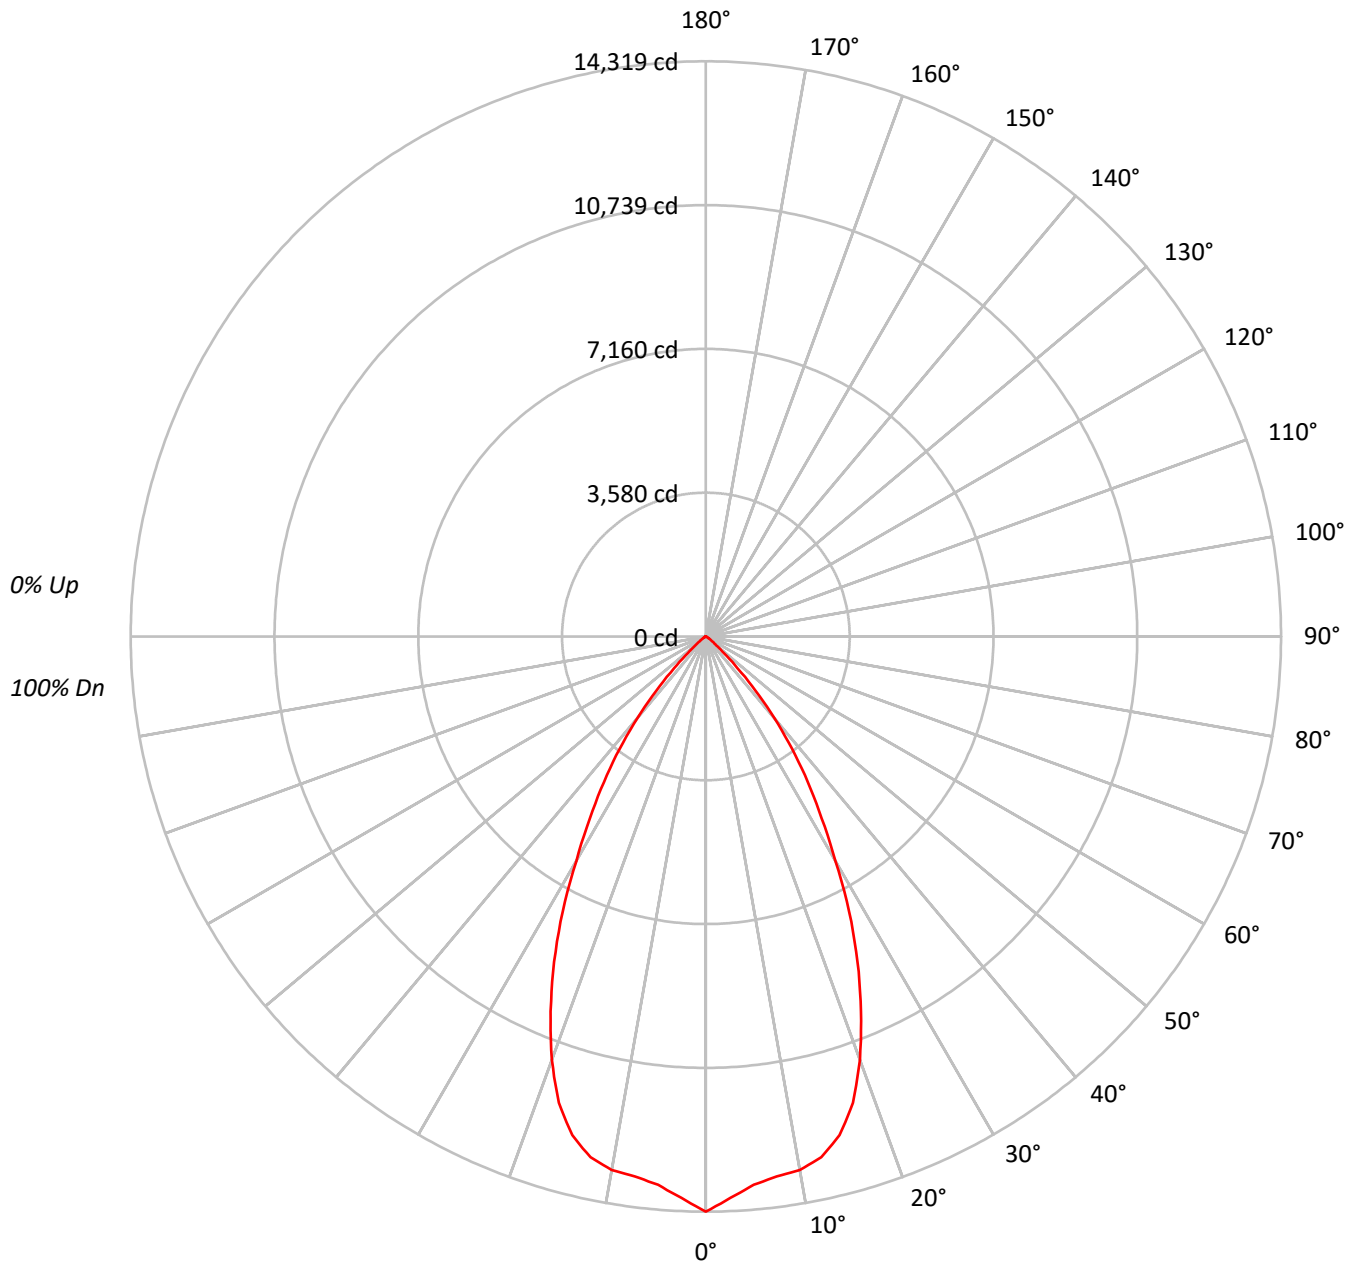



TEST NUMBER: P774607

CATALOG NUMBER: LD6D95BD010-EU6DR5570959035-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																				
0	119	119	119	119	116	116	116	116		111	111	111		106	106	106		102	102	102
1	114	111	108	106	111	109	106	104		105	103	101		101	99	98		97	96	95
2	108	103	99	96	106	101	98	95		98	95	92		95	93	90		92	90	89
3	102	96	91	87	100	95	90	86		92	88	85		90	86	84		87	85	82
4	97	90	84	80	95	88	83	79		86	82	78		84	81	78		82	79	77
5	92	84	78	74	91	83	77	73		81	76	73		79	75	72		78	74	71
6	88	79	73	68	86	78	72	68		76	71	68		75	70	67		74	70	67
7	83	74	68	64	82	73	67	63		72	67	63		71	66	63		70	65	62
8	79	69	63	59	78	69	63	59		68	63	59		67	62	59		66	62	58
9	75	66	60	56	74	65	59	55		64	59	55		63	58	55		62	58	55
10	72	62	56	52	71	61	56	52		61	56	52		60	55	52		59	55	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1564483
5°	1502338
10°	1496687
15°	1453687
20°	1303442
25°	1077227
30°	813716
35°	590005
40°	377584
45°	172442
50°	56399
55°	24345
60°	10467
65°	1370
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 172442 cd/sqm



TEST NUMBER: P774607

CATALOG NUMBER: LD6D95BD010-EU6DR5570959035-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1303.4	10.2
10°-20°	3557.3	27.9
20°-30°	4053.8	31.7
30°-40°	2759.7	21.6
40°-50°	951.0	7.4
50°-60°	131.4	1.0
60°-70°	12.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8914.5	69.8
0°-40°	11674.2	91.4
0°-60°	12756.6	99.9
0°-90°	12769.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	12769.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14319	
5°	13698	###
15°	12851	3557
25°	8936	4054
35°	4423	2760
45°	1116	951
55°	128	131
65°	5	13
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774607

CATALOG NUMBER: LD6D95BD010-EU6DR5570959035-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	14318.8
2.5°	13990.5
5°	13697.7
7.5°	13554.0
10°	13490.2
12.5°	13277.2
15°	12851.4
17.5°	12175.4
20°	11210.2
22.5°	10095.9
25°	8935.5
27.5°	7727.2
30°	6449.7
32.5°	5367.3
35°	4423.4
37.5°	3525.6
40°	2647.3
42.5°	1834.6
45°	1116.0
47.5°	601.5
50°	331.8
52.5°	196.9
55°	127.8
57.5°	81.6
60°	47.9
62.5°	21.3
65°	5.3
67.5°	1.8
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)