

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774868

Luminaire Tested: LD6D95BD010-EU6DR7070959050-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P774868
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-76)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D95BD010-EU6DR7070959050-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12017.7 lumens
Efficiency: N/A
Efficacy: 121.1 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1.1 / 1.04
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P774868

CATALOG NUMBER: LD6D95BD010-EU6DR7070959050-6LBS1MW

Luminous Intensity Polar Plot

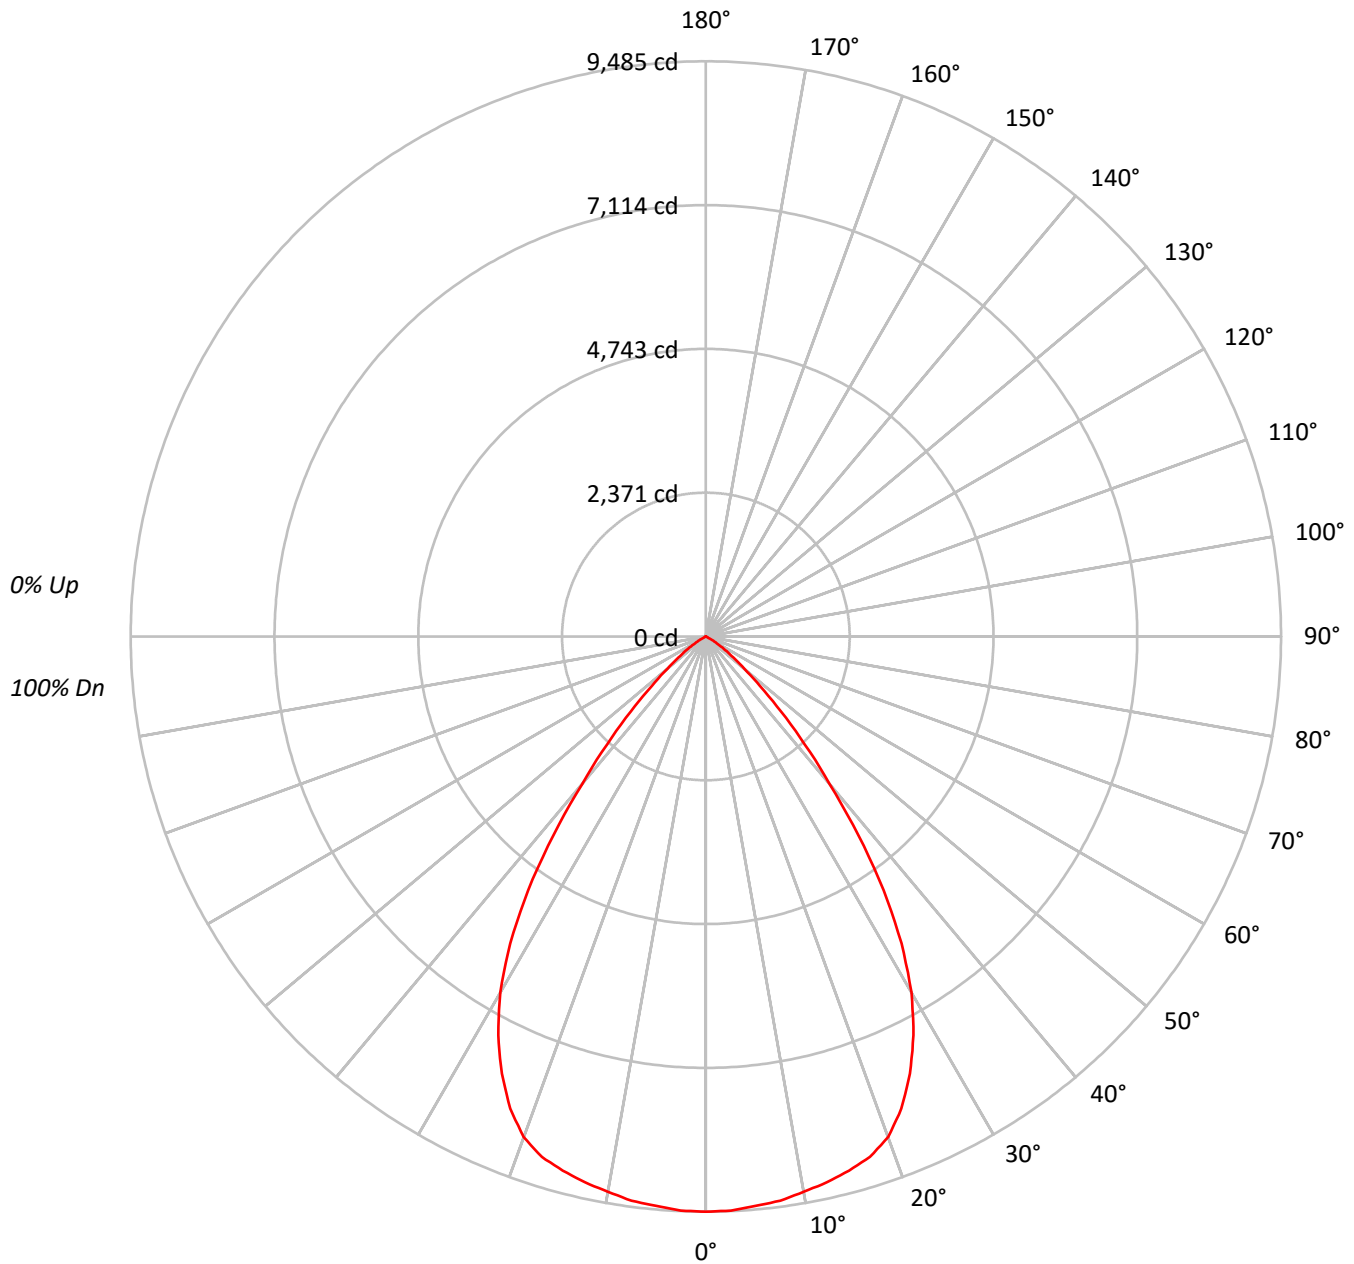



TEST NUMBER: P774868

CATALOG NUMBER: LD6D95BD010-EU6DR7070959050-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	111	108	106	103	104	102	100		100	99	97		97
2	107	102	97	94	105	100	96	92	97	93	90		94	91	88		91
3	101	94	88	84	99	92	87	83	90	85	82		87	84	81		85
4	95	87	81	76	93	86	80	76	83	78	75		81	77	74		79
5	89	80	74	69	88	79	73	69	78	72	68		76	71	68		74
6	84	75	68	63	83	74	68	63	72	67	63		71	66	62		69
7	80	69	63	58	78	69	62	58	67	62	58		66	61	57		65
8	75	65	58	54	74	64	58	54	63	57	53		62	57	53		61
9	71	61	54	50	70	60	54	50	59	53	50		58	53	49		57
10	67	57	50	46	66	56	50	46	55	50	46		55	50	46		54

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1036382
5°	1033793
10°	1031556
15°	1031270
20°	1021190
25°	959275
30°	855199
35°	681853
40°	452750
45°	270685
50°	140335
55°	73758
60°	26091
65°	440
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 270685 cd/sqm



TEST NUMBER: P774868

CATALOG NUMBER: LD6D95BD010-EU6DR7070959050-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	896.4	7.5
10°-20°	2570.8	21.4
20°-30°	3626.7	30.2
30°-40°	3130.8	26.1
40°-50°	1402.0	11.7
50°-60°	367.1	3.1
60°-70°	23.9	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7093.9	59.0
0°-40°	10224.7	85.1
0°-60°	11993.8	99.8
0°-90°	12017.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	12017.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9485	
5°	9426	896
15°	9117	2571
25°	7957	3627
35°	5112	3131
45°	1752	1402
55°	387	367
65°	2	24
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P774868

CATALOG NUMBER: LD6D95BD010-EU6DR7070959050-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	9485.4
2.5°	9475.2
5°	9425.7
7.5°	9384.8
10°	9297.8
12.5°	9219.3
15°	9117.0
17.5°	8999.3
20°	8782.7
22.5°	8426.2
25°	7957.1
27.5°	7413.0
30°	6778.5
32.5°	6002.4
35°	5112.0
37.5°	4129.5
40°	3174.3
42.5°	2411.9
45°	1751.8
47.5°	1207.6
50°	825.6
52.5°	569.7
55°	387.2
57.5°	233.7
60°	119.4
62.5°	37.5
65°	1.7
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)