

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761612

Luminaire Tested: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761612
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1515.1 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761612

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW

Luminous Intensity Polar Plot

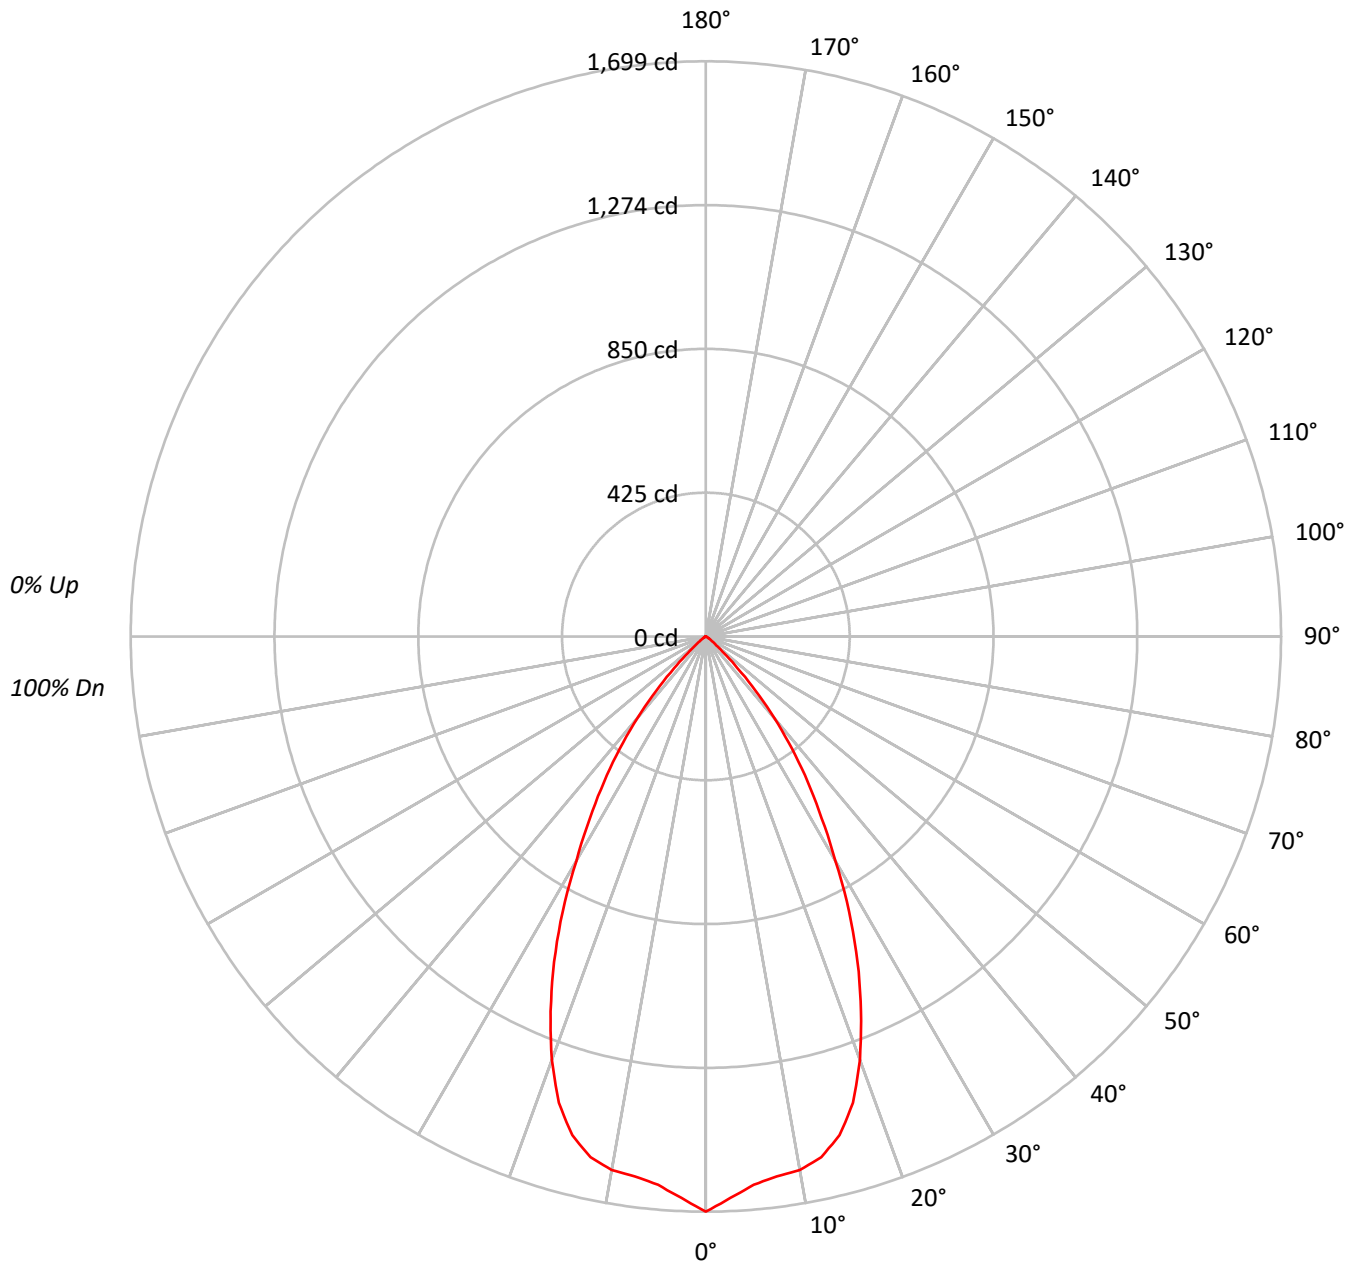

TEST NUMBER: P761612

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74
7	83	74	68	64	82	73	67	63	72	67	63		71	66	63		70
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66
9	75	66	60	56	74	65	59	55	64	59	55		63	58	55		62
10	72	62	56	52	71	61	56	52	61	56	52		60	55	52		59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	185623
5°	178249
10°	177581
15°	172478
20°	154643
25°	127813
30°	96540
35°	69999
40°	44800
45°	20458
50°	6697
55°	2895
60°	1246
65°	155
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 20458 cd/sqm



TEST NUMBER: P761612

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	154.6	10.2
10°-20°	422.1	27.9
20°-30°	481.0	31.7
30°-40°	327.4	21.6
40°-50°	112.8	7.4
50°-60°	15.6	1.0
60°-70°	1.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1057.7	69.8
0°-40°	1385.1	91.4
0°-60°	1513.6	99.9
0°-90°	1515.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1515.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1699	
5°	1625	155
15°	1525	422
25°	1060	481
35°	525	327
45°	132	113
55°	15	16
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P761612

CATALOG NUMBER: LD6D15D010-EU6DR550215IC9050-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°
0°	1698.9
2.5°	1660.0
5°	1625.2
7.5°	1608.2
10°	1600.6
12.5°	1575.3
15°	1524.8
17.5°	1444.6
20°	1330.0
22.5°	1197.9
25°	1060.2
27.5°	916.8
30°	765.2
32.5°	636.8
35°	524.8
37.5°	418.3
40°	314.1
42.5°	217.7
45°	132.4
47.5°	71.4
50°	39.4
52.5°	23.4
55°	15.2
57.5°	9.7
60°	5.7
62.5°	2.5
65°	0.6
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)