

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1192131

Luminaire Tested: **LDA6A30950D010TE LARL15SP 6LFC1**

Issue Date: 3/3/2020

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

**Test Information**

Test Method: LM-41-14
Report Number: P1192131
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26262)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA6A30950D010TE LARL15SP 6LFC1
Description: PORTFOLIO 6" Flat Cone, Self-flange Trim Ring, 15° Spot Optic, at 0° tilt
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2965.1 lumens
Efficiency: N/A
Efficacy: 74.5 lumens/watt
Spacing Criteria (0/90/45): 0.21 / 0.21 / 0.26
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 39.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1192131

CATALOG NUMBER: LDA6A30950D010TE LARL15SP 6LFC1

Luminous Intensity Polar Plot

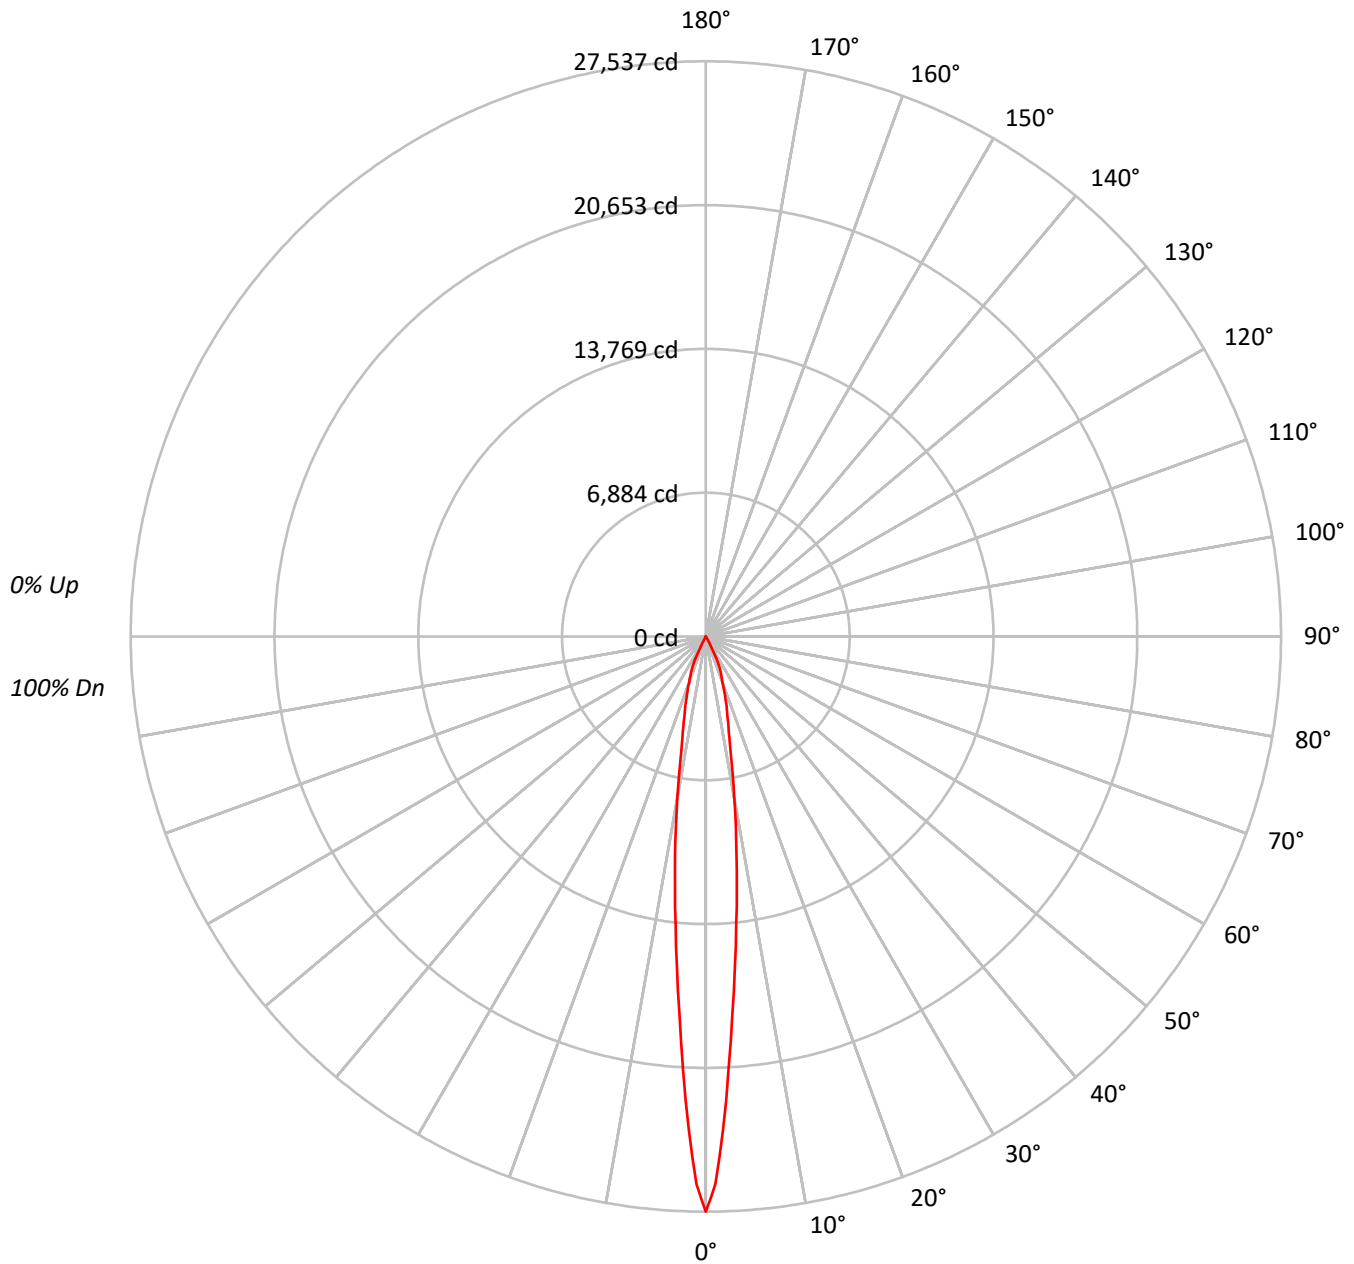

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1192131

CATALOG NUMBER: LDA6A30950D010TE LARL15SP 6LFC1

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97		
2	112	108	106	103	110	107	104	102	104	102	100	101	99	98	98	97	96	95		
3	109	104	101	98	107	103	100	98	101	98	96	98	96	95	96	95	93	92		
4	106	101	97	94	104	100	96	94	98	95	93	96	94	92	94	92	91	90		
5	103	97	94	91	102	97	93	90	95	92	90	94	91	89	92	90	88	87		
6	100	95	91	88	99	94	90	88	93	89	87	91	89	87	90	88	86	85		
7	98	92	88	85	97	91	88	85	90	87	85	89	86	84	88	86	84	83		
8	95	89	86	83	95	89	85	83	88	85	83	87	84	82	86	84	82	81		
9	93	87	83	81	92	87	83	81	86	83	81	85	82	80	85	82	80	79		
10	91	85	81	79	90	85	81	79	84	81	79	83	81	79	83	80	78	78		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1509583
5°	874029
10°	436966
15°	227958
20°	135538
25°	82674
30°	1671
35°	415
40°	265
45°	202
50°	102
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P1192131

CATALOG NUMBER: LDA6A30950D010TE LARL15SP 6LFC1

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1274.4	43.0
10°-20°	1156.3	39.0
20°-30°	527.0	17.8
30°-40°	5.5	0.2
40°-50°	1.7	0.1
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2957.8	99.8
0°-40°	2963.3	99.9
0°-60°	2965.1	100.0
0°-90°	2965.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2965.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	27537	
5°	15883	###
15°	4017	1156
25°	1367	527
35°	6	5
45°	3	2
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1192131

CATALOG NUMBER: LDA6A30950D010TE LARL15SP 6LFC1

CANDELA DISTRIBUTION (FULL):

	0°
0°	27537.0
1°	26221.7
2°	23629.7
3°	20779.3
4°	18162.1
5°	15882.9
6°	13894.7
7°	12132.4
8°	10555.9
9°	9158.9
10°	7849.8
11°	6688.8
12°	5712.3
13°	4990.5
14°	4454.5
15°	4016.6
17.5°	3092.8
20°	2323.3
22.5°	1850.2
25°	1366.8
27.5°	454.4
30°	26.4
32.5°	10.0
35°	6.2
37.5°	5.0
40°	3.7
42.5°	2.6
45°	2.6
47.5°	1.2
50°	1.2
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0

Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



TEST NUMBER: P1192131
CATALOG NUMBER: LDA6A30950D010TE LARL15SP 6LFC1

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



85°	0.0
87.5°	0.0

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)