

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1192682

Luminaire Tested: **LDA6A70927D010TE LARH20SP 6LAL1LI**

Issue Date: 3/3/2020



Test Information

Test Method: LM-41-14
Report Number: P1192682
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26678)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA6A70927D010TE LARH20SP 6LAL1LI
Description: PORTFOLIO 6" Lensed Adjustable, Self-flanged, 20° Spot
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4776.5 lumens
Efficiency: N/A
Efficacy: 61.2 lumens/watt
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.45
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1192682

CATALOG NUMBER: LDA6A70927D010TE LARH20SP 6LAL1LI

Luminous Intensity Polar Plot

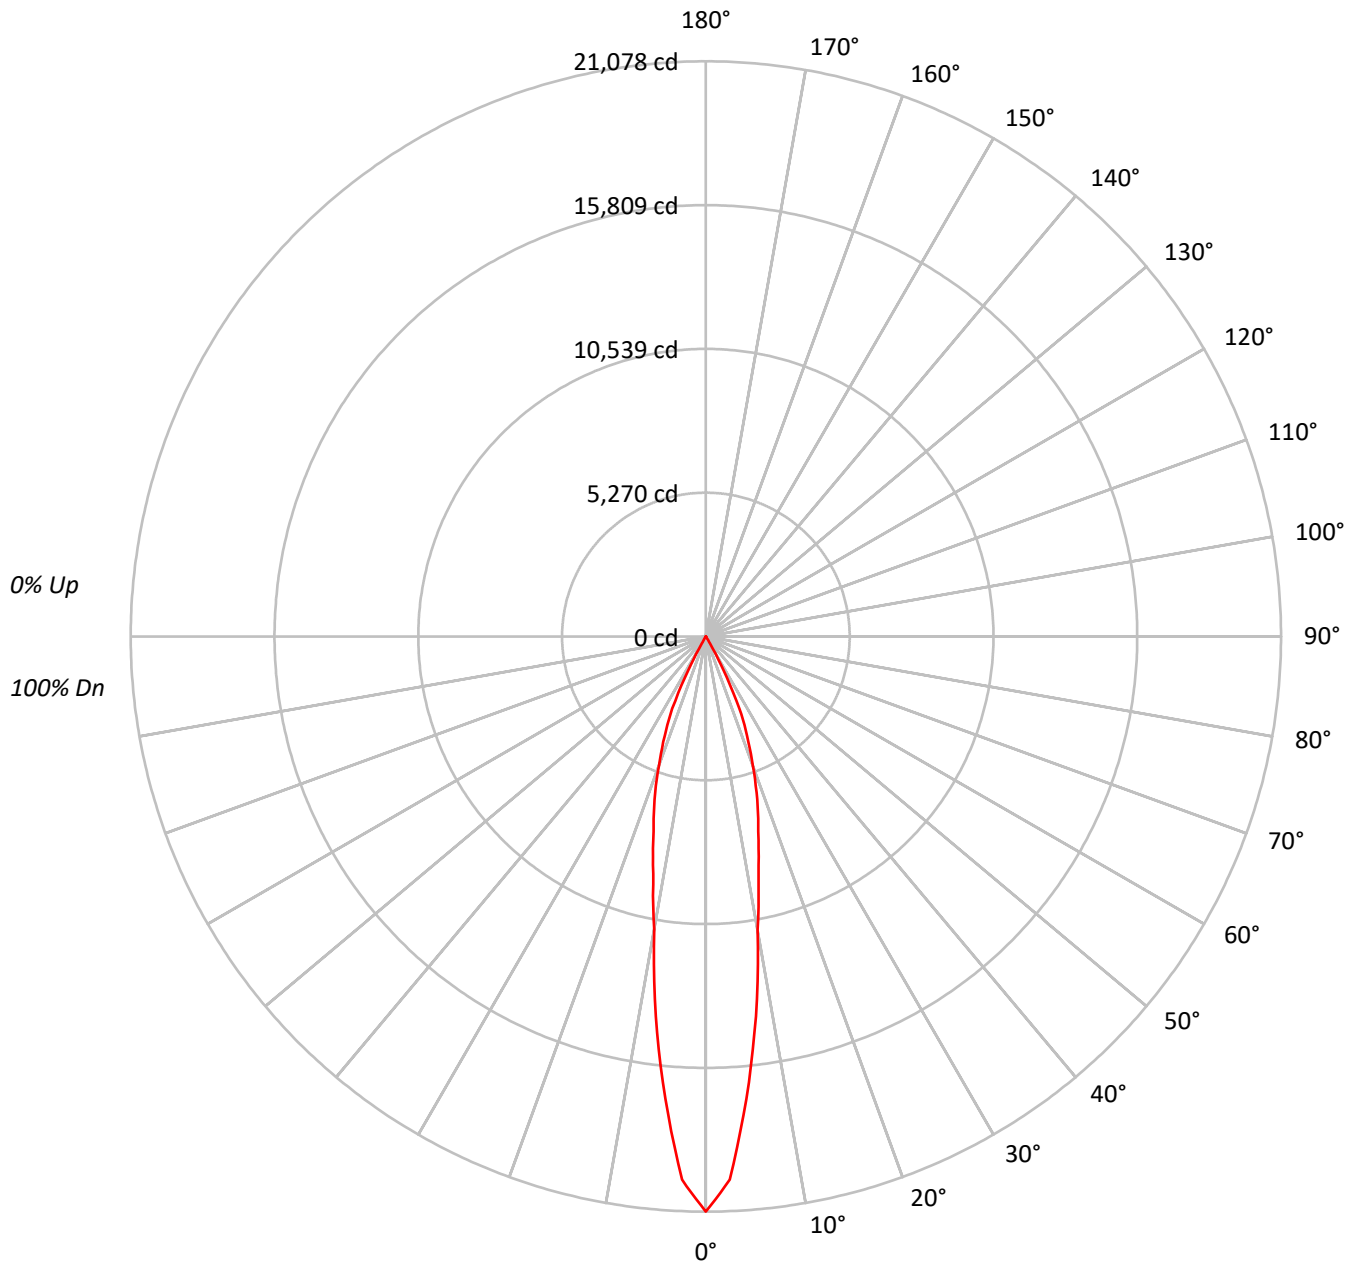

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1192682

CATALOG NUMBER: LDA6A70927D010TE LARH20SP 6LAL1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	100	99	98	96		
2	111	107	104	102	109	106	103	100	102	100	98	100	98	96	97	96	94	93		
3	107	103	99	96	106	101	98	95	99	96	94	96	94	92	94	92	91	90		
4	104	98	94	91	102	97	94	91	95	92	90	93	91	89	92	89	88	86		
5	101	94	90	87	99	94	90	87	92	89	86	91	88	85	89	87	85	83		
6	97	91	87	84	96	90	86	83	89	85	83	88	85	82	87	84	82	81		
7	95	88	84	81	93	87	83	80	86	83	80	85	82	80	84	81	79	78		
8	92	85	81	78	91	84	80	78	83	80	77	83	79	77	82	79	77	76		
9	89	82	78	75	88	82	78	75	81	77	75	80	77	75	80	77	74	73		
10	87	80	75	73	86	79	75	73	79	75	72	78	75	72	77	74	72	71		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1155489
5°	935910
10°	606936
15°	420082
20°	293460
25°	176375
30°	18598
35°	1800
40°	1081
45°	667
50°	640
55°	918
60°	1053
65°	843
70°	689
75°	678
80°	695
85°	629



TEST NUMBER: P1192682

CATALOG NUMBER: LDA6A70927D010TE LARH20SP 6LAL1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1437.2	30.1
10°-20°	2082.0	43.6
20°-30°	1195.3	25.0
30°-40°	35.0	0.7
40°-50°	7.5	0.2
50°-60°	8.2	0.2
60°-70°	6.8	0.1
70°-80°	3.7	0.1
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4714.5	98.7
0°-40°	4749.5	99.4
0°-60°	4765.2	99.8
0°-90°	4776.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4776.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	21078	
5°	17007	###
15°	7402	2082
25°	2916	1195
35°	27	35
45°	9	8
55°	10	8
65°	6	7
75°	3	4
85°	1	1
90°	0	



TEST NUMBER: P1192682

CATALOG NUMBER: LDA6A70927D010TE LARH20SP 6LAL1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	21077.8
2.5°	19926.6
5°	17007.4
7.5°	14042.9
10°	10903.2
12.5°	8898.5
15°	7401.8
17.5°	6260.2
20°	5030.3
22.5°	3943.6
25°	2915.9
27.5°	1380.4
30°	293.8
32.5°	36.5
35°	26.9
37.5°	19.4
40°	15.1
42.5°	11.8
45°	8.6
47.5°	7.5
50°	7.5
52.5°	8.6
55°	9.6
57.5°	9.6
60°	9.6
62.5°	8.6
65°	6.5
67.5°	5.3
70°	4.3
72.5°	4.3
75°	3.2
77.5°	3.2
80°	2.2
82.5°	1.0
85°	1.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)