

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P1212693

Luminaire Tested: **LDSQA6A70930D010TE LARH20SP 6LSQA1H**

Issue Date: 3/3/2020

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

**Test Information**

Test Method: LM-41-14
Report Number: P1212693
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P26676)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDSQA6A70930D010TE LARH20SP 6LSQA1H
Description: PORTFOLIO 6" SQUARE ADJUSTABLE REFLECTOR, ANGLE-CUT TRIM,
SELF-FLANGED, 20° SPOT
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4716.1 lumens
Efficiency: N/A
Efficacy: 60.4 lumens/watt
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.48
Luminous Opening: Rectangular (W 0.5' x L: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P1212693

CATALOG NUMBER: LDSQA6A70930D010TE LARH20SP 6LSQA1H

Luminous Intensity Polar Plot

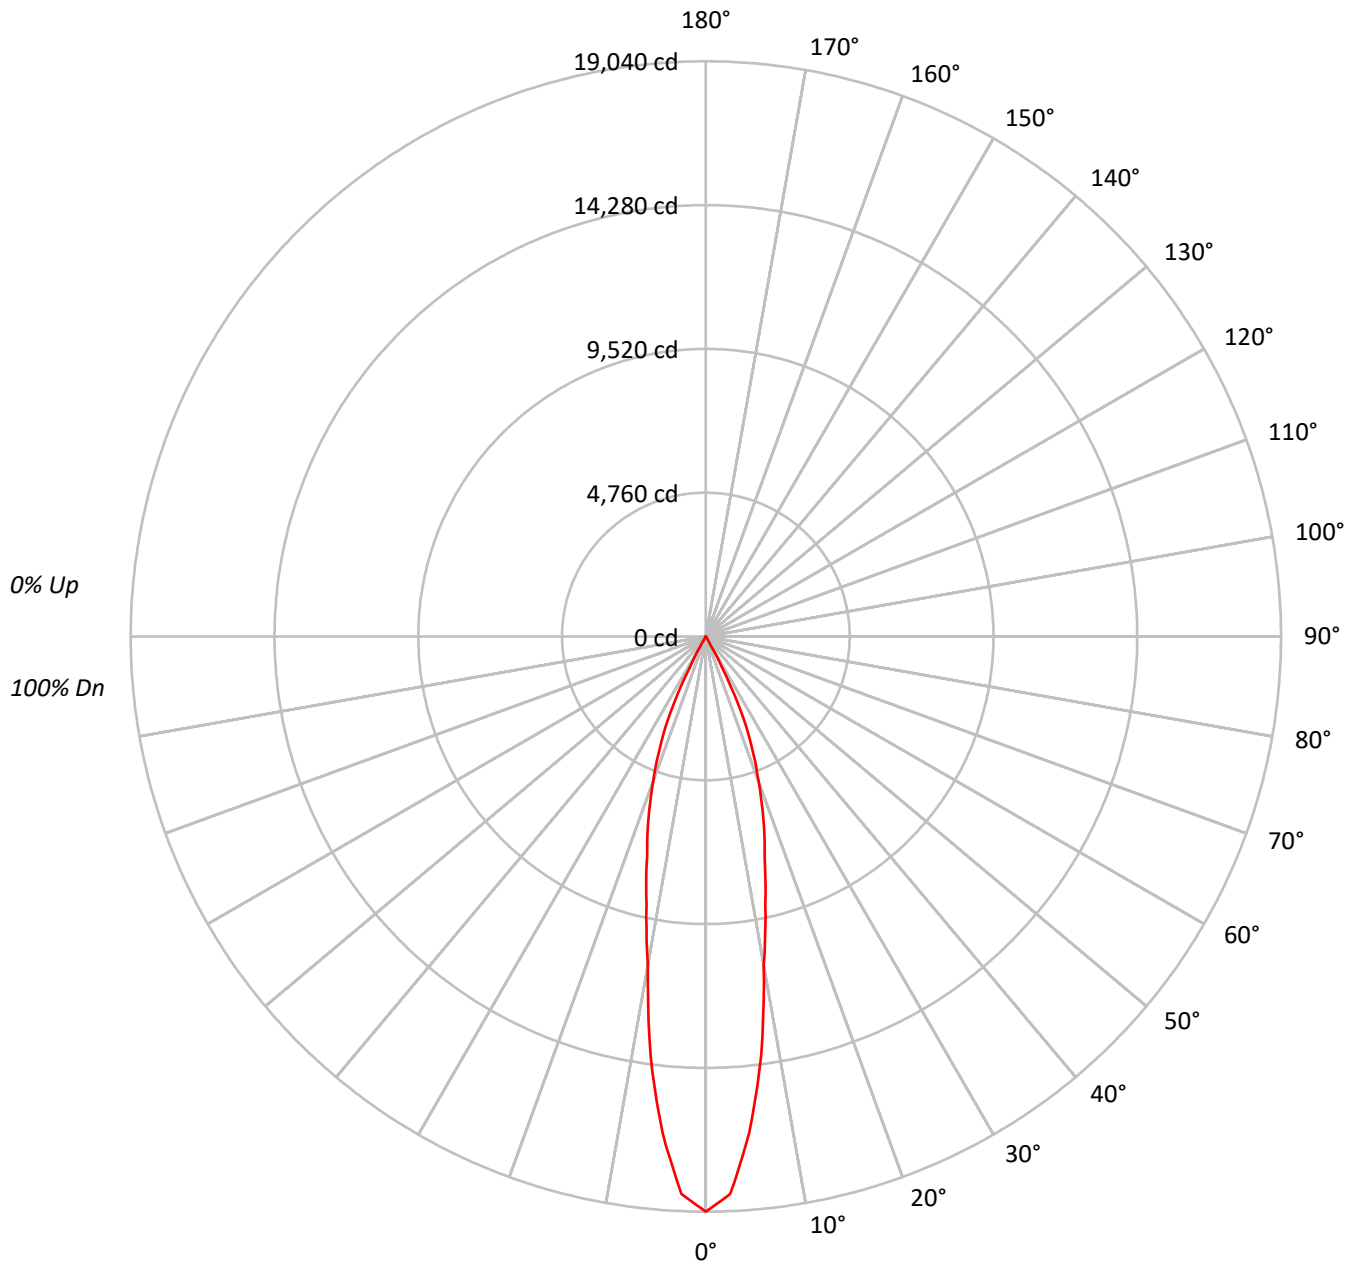

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P1212693

CATALOG NUMBER: LDSQA6A70930D010TE LARH20SP 6LSQA1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	100	99	98	96		
2	111	107	104	102	109	106	103	101	103	100	98	100	98	96	97	96	94	93		
3	107	103	99	96	106	101	98	95	99	96	94	97	94	92	94	93	91	90		
4	104	98	94	91	102	97	94	91	95	92	90	94	91	89	92	90	88	87		
5	101	95	90	87	99	94	90	87	92	89	86	91	88	86	89	87	85	84		
6	98	91	87	84	96	91	87	84	89	86	83	88	85	83	87	84	82	81		
7	95	88	84	81	94	87	83	81	86	83	80	85	82	80	84	82	79	78		
8	92	85	81	78	91	85	81	78	84	80	78	83	80	77	82	79	77	76		
9	89	82	78	75	88	82	78	75	81	78	75	80	77	75	80	77	75	74		
10	87	80	76	73	86	80	76	73	79	75	73	78	75	73	78	75	72	71		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	819758
5°	712678
10°	482895
15°	334746
20°	233278
25°	134235
30°	10530
35°	862
40°	438
45°	292
50°	261
55°	218
60°	250
65°	295
70°	252
75°	150
80°	223
85°	0



TEST NUMBER: P1212693

CATALOG NUMBER: LDSQA6A70930D010TE LARH20SP 6LSQA1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1403.3	29.8
10°-20°	2113.7	44.8
20°-30°	1164.4	24.7
30°-40°	24.1	0.5
40°-50°	3.9	0.1
50°-60°	2.9	0.1
60°-70°	2.5	0.1
70°-80°	1.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4681.4	99.3
0°-40°	4705.5	99.8
0°-60°	4712.3	99.9
0°-90°	4716.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4716.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19040	
5°	16490	###
15°	7510	2114
25°	2826	1164
35°	16	24
45°	5	4
55°	3	3
65°	3	3
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1212693

CATALOG NUMBER: LDSQA6A70930D010TE LARH20SP 6LSQA1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	19039.5
2.5°	18469.9
5°	16489.5
7.5°	14015.8
10°	11045.2
12.5°	9095.7
15°	7509.8
17.5°	6331.0
20°	5091.3
22.5°	3982.2
25°	2825.6
27.5°	1205.9
30°	211.8
32.5°	27.0
35°	16.4
37.5°	10.7
40°	7.8
42.5°	5.9
45°	4.8
47.5°	3.9
50°	3.9
52.5°	3.9
55°	2.9
57.5°	2.9
60°	2.9
62.5°	2.9
65°	2.9
67.5°	2.0
70°	2.0
72.5°	0.9
75°	0.9
77.5°	0.9
80°	0.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)